

Stormwater Source Control Design Guidelines 2005



Greater
Vancouver
Regional
District

Lanarc Consultants Ltd.
Kerr Wood Leidal Associates Ltd.
Goya Ngan

FINAL REPORT

April 2005

Table of Contents

Foreword

Acknowledgements

Introduction	1
Summary Posters	7
Rainwater Source Control Around the World	17
Design Guidelines	23
1. Absorbent Landscape.....	25
2. Infiltration Swale System	33
3. Infiltration Rain Garden.....	43
4. Pervious Paving	53
5. Green Roof.....	63
6. Infiltration Trench and Soakaway Manhole.....	75
Design, Construction and Maintenance Process	81
Candidate Plant List	119
Glossary	127
Key Contacts	133
Key References	139
Appendix A – Jurisdiction Summaries	A-1
Washington State	A-3
Oregon	A-7
Australia	A-12
Europe	A-17
United Kingdom	A-19
Germany	A-24
France.....	A-30
Netherlands	A-35
Belgium.....	A-40
Appendix B: Criteria for Choosing Priorities	B-1

List of Figures

Figure 1-1: Stormwater Variables of Absorbent Landscape
Figure 1-2: Interception, stemflow and throughfall data
Figure 1-3: Infiltration rate of a sandy loam
Figure 5-1: Grain Size Distribution Range for Substrates
Figure F1: Typical 24 Hour Rainfall Depths in the GVRD
Figure F2: Alternative Stormwater Treatment Chains for High Density Development
Figure F3: Alternative Stormwater Treatment Chains for Low Density Development
Figure F4: Example of Engineering Plan
Figure F5: Example of Landscape Plan
Figure F6: Example of Engineering Cross Section Detail
Figure F7: Example of Landscape Cross Section Detail
Figure F8: Example of Engineering Profile
Figure F9: Example of Landscape Profile
Figure A-1: Simplified Approach for Stormwater Management
Figure A-2: Outflow Options
Figure A-3: Cross-section – Swale-trench System
Figure A-4: Comparison on Investment Costs and Project Value
Figure A-5: Street with Porous Pavement and Reservoir Structure
Figure A-6: Networked Swale System
Figure A-7: Shaft Infiltration
Figure A-8: Reconstructed and New Eeuwkanthen
Figure A-9: Section of a Watercourse with Eeuwkanthen in Auvergne Polder

List of Tables

Table 1-1: Typical Infiltration Rates
Table 5-1: Weights of Common Building Materials
Table F1: Stormwater Source Control Design Process
Table F2: DFO Stormwater Guidelines
Table F3: Stormwater Criteria from Provincial Stormwater Guidebook
Table F4: Typical Stormwater Source Control Applications
Table F5: Typical Rainfall Capture Targets
Table F6: Tentative Match: Source Control Type to Soil Infiltration Rate
Table A-1: Example: Comparative present values of drainage system options
Table A – 2: Space Required to Retain and Store Water
Table B-1: Criteria for Selection of Priority Stormwater Source Controls

List of Drawings

Drawing 2A: Infiltration Swale Longitudinal Profile
Drawing 2B: Full Infiltration Swale
Drawing 2C: Full Infiltration Swale with Reservoir
Drawing 2D: Partial Infiltration Swale with Reservoir and Subdrain
Drawing 2E: Curbing Options
Drawing 3A: Rain Garden - Full Infiltration
Drawing 3B: Rain Garden - Full Infiltration with Reservoir
Drawing 3C: Rain Garden - Partial Infiltration
Drawing 3D: Rain Garden - Partial Infiltration with Flow Restrictor
Drawing 3E: Flow Through Planter
Drawing 3F: Infiltration Planter
Drawing 4A: Pervious Paving - Full Infiltration
Drawing 4B: Pervious Paving - Partial Infiltration
Drawing 4C: Pervious Paving - Partial Infiltration with Flow Restrictor
Drawing 5A: Multiple Layer Extensive Green Roof
Drawing 5B: Multiple Layer Extensive Green Inverted Roof
Drawing 5C: Single Layer Extensive Green Roof
Drawing 6A, 6B, 6C: Sedimentation Manhole and Soakaway Manholes
Drawing 6D: Infiltration Trench

Foreword

This document represents the “Final” Release of Phase 1 research results concerning Stormwater Source Control Design Guidelines for the Greater Vancouver Regional District in British Columbia, Canada.

In the spring of 2003, the Greater Vancouver Sewerage and Drainage District issued a proposal call for initial research work on Stormwater Source Control Design Guidelines. A contract for Phase 1 of the work was established with a consortium of landscape architects and engineers, including:

Lanarc Consultants Ltd.
Kerr Wood Leidal Associates Ltd.
Goya Ngan, Landscape Architect

As required by the terms of reference, the production of Design Guidelines was to be phased. Priorities for Phase One Research were set in consultation with the Client group. On submission and review of an Interim Draft Report in the fall of 2003, it was decided to extend the contract to complete a set of posters that publicized the results of the first phase work. A set of six posters were produced.

In winter 2004, the work was further reviewed by the Stormwater Interagency Liaison Group, a standing committee representing local and regional governments, as well as senior government agencies. The work was well received, and comments were made requesting further work.

While this further work was arranged and completed, an ‘Interim’ Release provided the benefit of the Phase 1 research findings to member municipalities of the GVRD.

This report is the ‘Final’ release of the research findings. The Interim Report is superseded by this Final Version. Primary changes in the Final Version include additional chapters on Infiltration Trench and Shaft, a Design Process Chapter, and a web-based Case Study module.

Comments, or queries about the status of the research should be directed to the Greater Vancouver Regional District, in the name of either:

Mark Wellman, P. Eng., Greater Vancouver Regional District

Mark.Wellman@gvrd.bc.ca

Ed von Euw, P.Eng., Greater Vancouver Regional District

Ed.vonEuw@gvrd.bc.ca

Acknowledgements

It is a rare opportunity as consultants to be given a mandate to search the world for design precedents and guidelines on any subject – and even moreso when the subject has worldwide innovation taking place – as is the case in stormwater source controls. The authors wish to recognize and thank the many organizations and individuals that provided their time and experience to this project – listed below, in no order of priority:

Lanarc Consultants Ltd.

David Reid, FCSLA, Landscape Architect, Planner, Principal
Harriet Rueggeberg, B.Sc., M.R.M., Environmental/Resource
Planner

Don Crockett, BCSLA, Landscape Architect, Principal
Doug Backhouse, BCSLA, Landscape Architect, Principal
Nigel P.I. Gray, B.L.A., Landscape Architectural Intern
Yongxu Yu, Landscape Architectural Intern
Jana Zelenski, Landscape Architectural Intern
Alexe Lohvinen, Graphic Designer
Linda Dawes, Library Assistant

Kerr Wood Leidal Associates Ltd.

Chris Johnston, P.Eng.
Crystal Campbell, P.Eng.
Ken Ferraby, P.Eng.
Troy Jones, P.Eng.

Goya Ngan, Landscape Architect

Greater Vancouver Regional District (Client)

Robert Hicks, P.Eng.
Ed von Euw, P.Eng.
Mark Wellman, P.Eng.
Hugh Kellas, FCIP

Stormwater Interagency Liaison Group

In particular, we would also like to express our gratitude to the many experts around the world that we contacted – either as a part of this research project or in advance – who gave freely of their time and expertise to help us understand that current state of the art in stormwater source controls. For those listed in the Contact List in the body of this report, we give our thanks.

We hope to be able to share this Report with many of those on the Contact List – and would value whatever additional comments or direction that they could offer.

Thank you.

INTRODUCTION

This page is intentionally left blank.

The Project

The objective of this project is to reduce information barriers that stand in the way of effective implementation of stormwater source controls in the Greater Vancouver Regional District. It focuses on the technical details of practices in landscape areas that treat stormwater through plant materials and soils by infiltration, retention, detention and evapotranspiration.

The Greater Vancouver Regional District (GVRD) provides regional government services to its member municipalities, and is the third largest metropolitan area in Canada. A related body, the Greater Vancouver Sewerage & Drainage District (GVSD), provides regional utility services. In 1999, the GVSD produced a Best Management Practices Guide for Stormwater, which can be viewed at http://www.gvrd.bc.ca/sewerage/management_guide.htm.

Stormwater - Rainwater

'Stormwater management' is the term traditionally used – mostly in North America - to refer to managing rainfall runoff using conventional "storm-based" approaches to sizing and designing drainage facilities. Urban design thinking has evolved, however, to address the entire spectrum of rainfall events, not just storms, in ways that reflect more natural water systems. 'Rainwater management' – generally used in Europe - more accurately describes this more holistic approach.

This document uses the more familiar term 'stormwater' with the intent that it refers to the broader scope of 'rainwater' management.



Vancouver, British Columbia, Canada is a world-class city framed by the coastal mountains, the estuary of the Fraser River, and the sea.

The Source Controls

In 2003, a team of consulting engineers and landscape architects was commissioned by the GVSD to create technical design guidelines for a selection of these Best Management Practices that related to stormwater source control. The team compiled technical literature from regions of the world that have climates similar to Vancouver on the following source control topics:

- ❑ **Absorbent landscapes**, including native soils and woods, compost-amended soils, planters and other treatments to reduce runoff from landscape areas;
- ❑ **Bioretention facilities**, which can include rain gardens, sunken landscape areas, and infiltration areas, with or without an underdrain;
- ❑ **Vegetated swales**, including bioswales and associated vegetated filter strips;
- ❑ **Pervious paving**, including both vegetated and unvegetated types;
- ❑ **Infiltration trenches, sumps and drywells**, including various underground infiltration devices; and
- ❑ **Extensive green roofs**.

The Information

Of particular interest were technical standards or design guidelines that are supported by government agencies or industry associations. The research aimed to acquire a technical level of detail appropriate to a 'typical design standard' that is suitable for testing, and which can be adapted to a given site or context by design professionals – specifically:

- ❑ Source control application, performance, scale, site-suitability and limitations;
- ❑ Generalized material specifications;
- ❑ Consideration of material availability, complexity and costs of construction and maintenance of the technique;
- ❑ Typical construction drawings as appropriate;
- ❑ Candidate plant species, maintenance requirements and related aspects; and
- ❑ Any relevant guidelines, standards, drawings or images of the specified source control.

The Products

The project has two groups of products:

- ❑ A **review of technical literature** on source controls and their use from jurisdictions with climates similar to Vancouver, including the Pacific Northwest, Germany, the Netherlands, Belgium, France, the United Kingdom, and parts of Australia and New Zealand. Some aspects of documents have been translated into English. The specific products are:
 - Written literature assembled into a set of binders organized under the six source control topics. These binders are available for viewing at the library of the Greater Vancouver Regional District, in Burnaby, B.C.
 - A report that reviews the status of stormwater management, key concepts, source controls in use and case studies from each jurisdiction. A summary of the report is contained in Part 2 of this document, and the full report is presented in Appendix A.
- ❑ **Design guidelines** applicable to Greater Vancouver for selected best management practices (prioritized in Appendix B), including typical details, general specifications, and guidelines for use. These are presented in two formats:
 - A series of posters that presents a summary of the jurisdictional study and the key features of each of the source controls in a highly illustrated and user-friendly manner.
 - A report - Part 3 of this document - that discusses the application, limitations, functions, design guidelines and specifications for each of the six priority source control topics.

The intent is that these posters and report files will be adapted to web delivery as well, so that the information can be made accessible to a wide audience of engineers, landscape architects, architects, planners, developers, builders, inspectors and universities.

However, these design guidelines are not intended to be used as detail designs. Proper site investigation and site-specific designs by appropriate professionals that comply with applicable laws, bylaws or regulations are required. These design guidelines can provide guidance and inspiration on innovative means of achieving stormwater management objectives.

This page is intentionally left blank.

SUMMARY POSTERS

Summary Posters

The applied research regarding stormwater source controls is only effective if the information is communicated to user groups.

To reach the target audience of design professionals, developers, construction management and approval agency staff, a series of technical posters have been produced to introduce the research results.

Reduced versions of the posters are printed on the following pages. Mid-size (A3 - 11 x 17 inch) versions are available for download through the GVRD website, at

http://www.gvr.bc.ca/sewerage/stormwater_reports.htm .

Full size (A1 – 24 x 36 inch) versions of the posters may also be available by special arrangement with the GVRD.

Australia Belgium British Columbia France Germany Netherlands Oregon State United Kingdom Washington State



UNITED KINGDOM
"Sustainable Urban Drainage Systems" (SUDS) use "Soakaway" methods such as rock pits, dry wells and infiltration trenches.

400,000 sq.m of permeable paving block designs were sold in 2001. Research is showing that microbes in rock base courses treat oil entering the pavement.



BELGIUM
Some municipalities offer subsidies for source controls; e.g., Mortsel pays \$5.60/sq.m for green roofs and 50% of the cost of an infiltration system.

CURRENT PRACTICE



NETHERLANDS
Infiltration trenches, green roofs and permeable pavement are common. Flood storage on roads is allowed, but not on bikeways!

Dutch wadis are broad vegetated swales that fill with water during heavy rainfalls and then drain in about 24 hours.



FRANCE
Swales ("noues") are valued as visible stormwater treatment. Porous pavements are used both as a source control and to reduce traffic noise.

The grate leads to an underground geo-membrane lined trench filled with sand and pebbles that filters particles and allows infiltration. Excess water flows to further settling and filtration systems.



GERMANY
In use for over 30 years, about 1 in 7 of new flat roofs are green roofs - 13.5 million sq.m in 2001. Most cities reduce stormwater fees when source controls are used.

A swale /trench system reduces stormwater volumes to 1/10th of a conventional system, saving 30% in stormwater fees.



BRITISH COLUMBIA/CANADA
Policies supporting source controls have been in the works since the 1990's. Pilot projects with source controls have been completed and monitoring is on-going. Implementation is accelerating.

Over 600 green roof installations exist in Coastal BC, including this monitored Green Roof at the Vancouver Library.



WASHINGTON
"Low Impact Development" (LID) techniques try to preserve 'natural' watershed characteristics. Stormwater manuals have provided guidance since 1992.

Seattle's "Street Edge Alternatives" (SEA) project captures 98% of the wet season runoff - beautifully.



OREGON
Portland provides "tree credits" in stormwater calculations, and also offers an "eco-roof density bonus" as a green roof incentive.

Buckman Terrace Apartments in Portland uses source controls to avoid runoff into combined sewers.



AUSTRALIA
Australia uses "Water Sensitive Urban Design" (WSUD) to maximize on-site retention, infiltration, treatment and re-use-even in clay soils. Aquifer storage and recovery is widely used.

Rainwater reuse on this site reduces the consumption of water from the main system by 77%.

Precedents Around the World



Greater
Vancouver
Regional
District

Stormwater Source Control Design Guidelines 2005




Goya Ngan
Landscape Architect


Detailed design guidelines can be found in the Design Guidelines 2005 report, available at www.gvrd.bc.ca

DESIGN PRINCIPLES

- Maximize the area of absorbent landscape – either existing or constructed – on the site. Conserve as much existing vegetation and undisturbed soil as possible.
- Minimize impervious area by using multi-storey buildings, narrower roads, minimum parking, larger landscape areas, green roof, and pervious paving.
- Disconnect impervious areas from the storm sewer system, having them drain to absorbent landscape.
- Design absorbent landscape areas as dished areas that temporarily store stormwater and allow it to soak in, with overflow for large rain events to the storm drain system.
- Maximize the vegetation canopy cover over the site. Multi-layered evergreens are ideal, but deciduous cover is also beneficial for stormwater management.
- Ensure adequate growing medium depth for both horticultural and stormwater needs – a minimum 150mm for lawn areas, and 450mm depth for shrub/tree areas. In wetter climates with till subsoils, a minimum depth of 300mm for lawn is required to store 60mm of rainfall.
- Cultivate compost into surface soils to create minimum 8% organic matter for lawns, and 15% for planting beds.
- To avoid surface crusting and maintain surface permeability, install vegetative (grass, groundcovers, shrubs, trees) or organic cover (mulch, straw, wood fibre) as early as possible in the construction process, and prior to winter storms.
- Provide effective erosion control during construction, including erosion control on upstream sites that may flow into the absorbent landscape.



Winter tree canopies intercept 15% to 27% of rainfall.




1. Crown Interception
2. Throughfall and Stemflow
3. Evapotranspiration
4. Soil Water Storage
5. Soil Infiltration
6. Surface Vegetation
7. Organics and Compost
8. Soil Life
9. Interflow
10. Deep Groundwater
11. Water Quality Improvement
12. Impermeable Surfaces and Surface Runoff

Impermeable surfaces create 8-10 times more runoff than absorbent landscapes.

Organic matter and soil micro-organisms are vital to maintaining soil infiltration rates.

Rainfall storage in soil is 7% to 18% of soil volume.



Influence of surface cover on infiltration rate of sandy loam

Absorbent Landscapes



Greater
Vancouver
Regional
District

Stormwater Source Control Design Guidelines 2005




Detailed design guidelines can be found in the Design Guidelines 2005 report, available at www.gvrd.bc.ca



Compost Demonstration at UvicerCity
At SEU's community development, a 7m x 10m compost layer over absorbent soil has demonstrated effectiveness in erosion control and runoff interception. It has also supported rapid vegetation establishment.





DESIGN PRINCIPLES

- Literature suggests swale areas of about 10-20% of upstream impervious area. For GVRD, calculate swale area by continuous flow modelling.
- Flow to the swale should be distributed sheet flow, travelling through a grassy filter area at the swale verges. Provide pre-treatment and erosion control to avoid sedimentation in the swale.
- Provide a 25mm drop at the edge of paving to the swale soil surface, to allow for positive drainage and buildup of road sanding/organic materials at this edge.
- Swale planting is typically sodded lawn. Low volume swales can be finished with a combination of grasses, shrub, groundcover and tree planting.
- Swale bottom - flat cross section, 600 to 2400mm width, 1-2% longitudinal slope or dished between weirs.
- Swale side slopes - 3(horizontal):1(vertical) maximum, 4:1 preferred for maintenance.
- Weirs to have level top to spread flows and avoid channelization, keyed in 100mm minimum.
- Maximum ponding level - 150mm. Drawdown time for the maximum surface ponded volume - 24 hours.
- Treatment soil depth - 450mm desirable, minimum 150mm if design professional calculates adequate pollutant removal.
- Design stormwater conveyance using Manning's formula or weir equations whichever governs with attention to channel stability during maximum flows.
- Drain rock reservoir and underdrain may be avoided where infiltration tests by a qualified professional, taken at the depth of the proposed infiltration, show an infiltration rate that exceeds the inflow rate.



INFILTRATION SWALE

Not To Scale

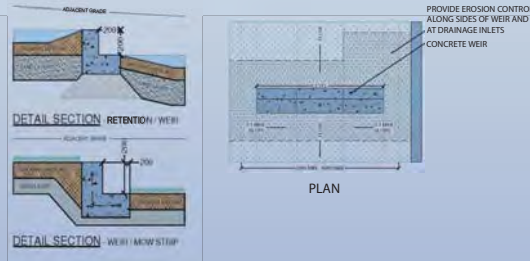

1. Weir Keyed into Swale Side Slope
2. Growing Medium (300mm Min.)
3. Sand
4. Existing Scarified Subsoil

An Infiltration Swale is a shallow grassed or vegetated channel designed to capture, detain and treat stormwater and convey larger flows. It takes surface flows from adjacent paved surfaces, holds the water behind weirs, and allows it to infiltrate through a soil bed into underlying soils. The swale and weir structures provide conveyance for larger storm events to the storm drain system. Variations on designs include an underlying drain rock reservoir, with or without a perforated underdrain.

Full Infiltration

Where water entering the swale is filtered through a grass or groundcover layer, and then passes through sandy growing medium and a sand layer into underlying scarified subgrade. Suitable for sites with small catchments and subsoil permeability > 30mm/hr.

Full Infiltration with Reservoir

Designed to reduce surface ponding by providing underground storage in a drain rock reservoir. Suitable for sites with small catchments and subsoil permeability > 15mm/hr.

Partial Infiltration with Reservoir and Subdrain

Where a perforated drain pipe is installed at the top of the reservoir, providing an underground overflow that removes excess water before it backs up to the surface of the swale. Suitable for sites with larger catchments and low infiltration rates into subsoil permeability < 15mm/hr. Provides water quality treatment even if infiltration into subsoils is limited.

5. Perforated Underdrain (150mm Dia. Min.)
6. Drain Rock Reservoir (300mm Min.)
7. Geotextile Along All Sides of Reservoir
8. Trench Dams at All Utility Crossing

Infiltration Swale System



Greater
Vancouver
Regional
District

Stormwater Source Control Design Guidelines 2005




Goya Ngan
Landscape Architect



DESIGN PRINCIPLES

- Literature suggests rain garden areas of about 10-20% of upstream impervious area. For GVRD, calculate rain garden area by continuous flow modelling. Optimum rain garden size is about 50sq.m. draining 250sq.m. of impervious area.
- Smaller, distributed rain gardens are better than single large scale facilities.
- Locate rain gardens a minimum 30.5m from wells, 3m downslope of building foundations, and only in areas where foundations have footing drains and are not above steep slopes.
- Provide pretreatment and erosion control i.e. grass filter strip to avoid introducing sediment into the garden.
- At point-source inlets, install non-erodible material, sediment cleanout basins, and weir flow spreaders.
- Bottom width - 600mm (Min.) to 3000mm (desirable). Length-width ratio of 2:1.
- Side slopes - 2:1 maximum, 4:1 preferred for maintenance. Maximum ponded level - 150 - 300mm.
- Draw-down time for maximum ponded volume - 72 hours.
- Treatment soil depth - 450mm (Min.) to 1200mm (desirable); use soils with minimum infiltration rate of 13mm/hr.
- Surface planting should be primarily trees, shrubs, and groundcovers, with planting designs respecting the various soil moisture conditions in the garden. Plantings may include rushes, sedges and grasses as well as lawn areas for erosion control and multiple uses.
- Apply a 50-75mm layer of organic mulch for both erosion control and to maintain infiltration capacity.
- Install a non-erodible outlet or spillway to discharge overflow.
- Avoid utility or other crossings of the rain garden. Where utility trenches must be constructed below the garden, install trench dams to avoid infiltration water following the utility trench.
- Drain rock reservoir and perforated drain pipe may be avoided where infiltration tests by a design professional show a subsoil infiltration rate that exceeds the inflow rate.

An Infiltration Rain Garden is a form of bioretention facility designed to have aesthetic appeal as well as a stormwater function. Rain gardens are commonly a concave landscaped area where runoff from roofs or paving infiltrates into deep constructed soils and subsoils below. On subsoils with low infiltration rates, Rain Gardens often have a drain rock reservoir and perforated drain system to convey away excess water.



1. Tree, Shrub and Groundcover Plantings
2. Growing Medium Minimum 450mm Depth
3. Drain Rock Reservoir
4. Flat Subsoil - scarified
5. Perforated Drain Pipe 150mm Dia. Min.
6. Geotextile Along All Sides of Drain Rock Reservoir
7. Overflow (standpipe or swale)
8. Flow Restrictor Assembly
9. Secondary Overflow Inlet at Catch Basin
10. Outflow Pipe to Storm Drain or Swale System
11. Trench Dams at All Utility Crossings

Full Infiltration

Where all inflow is intended to infiltrate into the underlying subsoil. Candidate in sites with subsoil permeability > 30mm/hr. An overflow for large events is provided by pipe or swale to the storm drain system.

Full Infiltration with Reservoir

Adding a drain rock reservoir so that surface water can move quickly through the installed growing medium and infiltrate slowly into subsoils from the reservoir below. Candidate in sites with subsoil permeability > 15mm/hr.

Partial Infiltration

Designed so that most water may infiltrate into the underlying soil while the surplus overflow is drained by perforated pipes that are placed near the top of the drain rock reservoir. Suitable for sites with subsoil permeability > 1 and < 15mm/hr.

Partial Infiltration with Flow Restrictor

For sites with subsoil permeability < 1mm/hr, the addition of a flow restrictor assembly with a small orifice slowly decants the top portion of the reservoir and rain garden. Provides water quality treatment and some infiltration, while acting like a small detention facility.

Rain Garden




Greater
Vancouver
Regional
District

Stormwater Source Control Design Guidelines 2005



Detailed design guidelines can be found in the Design Guidelines 2005 report, available at www.gvrd.bc.ca



DESIGN PRINCIPLES

- Pervious paving is most suitable for low traffic areas – driveways, parking areas (maximum 1 - 2 vehicles per day per parking space), walkways, recreational vehicle pads, service roads, fire lanes.
- The ratio of impermeable surface area draining onto pervious pavement area should be 1.2:1 maximum.
- To avoid surface plugging, it is critical to protect pervious paving from sedimentation during and after construction.
- Identify pollutant sources, particularly in industrial/ commercial hotspots, that require pre-treatment or source control upstream.
- For designs which rely entirely on infiltration into underlying soils, the infiltration rate should be 12.5mm/hr minimum.
- Soil subgrade analysis should include soil texture class, moisture content, 96 hour soaked California Bearing Ratio (CBR) and on-site infiltration tests at the elevation of the base of the reservoir.
- Surface slope should be 1% minimum to avoid ponding and related sedimentation of fines.
- Wrap paver bedding material with geotextile filter cloth on bottom and sides to maintain water quality performance and keep out intrusion of fines.
- Provide edge restraint to contain pavers, similar to standard unit paving.
- Design reservoir water levels using continuous flow modelling. Drawdown time - 96 hrs max., 72 hrs desirable.
- Bottom of reservoir: flat in full infiltration designs, minimum 0.1% slope to drain in piped systems.
- Where utility trenches must be constructed below the reservoir, install trench dams at exits to avoid infiltration water following the utility trench.
- Pavers with wide joints should not be used for disabled persons parking or pedestrian ramps at street crossings.
- If being designed for heavy loads, optional reinforcing grids may be included in the pavement subbase.




Pervious paving is a surface layer that allows rainfall to percolate into an underlying reservoir base where rainfall is either infiltrated to underlying soils or removed by a subsurface drain. The surface component of pervious paving can be:

- Porous asphalt or porous concrete.
- Concrete or plastic grid structures filled with unvegetated gravel or vegetated soil.
- Concrete modular pavers with gapped joints that allow water to percolate through.


Pervious pavement designs may be one of three types:

- Full infiltration.
- Partial infiltration.
- Partial infiltration with flow restrictor.




Full Infiltration

Where rainfall is intended to infiltrate into the underlying subsoil. Candidate in sites with subsoil permeability > 15mm/hr.



Partial Infiltration

Designed so that most water may infiltrate into the underlying soil while the surplus overflow is drained by perforated pipes that are placed near the top of the drain rock reservoir. Suitable for subsoil permeability >1 and < 15mm/hr.



Partial Infiltration with Flow Restrictor

Where subsoil permeability is < 1mm/hr, water is removed at a controlled rate through a bottom pipe system and flow restrictor assembly. Systems are essentially underground detention systems, used where the underlying soil has very low permeability or in areas with high water table. Also provides water quality benefits.

1. Permeable Pavers (Min. 80mm thickness)
2. Aggregate Bedding Course - not sand (50mm depth)
3. Open Graded Base (depth varies by design application)
4. Open Graded Sub-base (depth varies by design application)
5. Subsoil - flat and scarified in infiltration designs
6. Geotextile on All Sides of Reservoir
7. Optional Reinforcing Grid for Heavy Loads
8. Perforated Drain Pipe 150mm Dia. Min.
9. Geotextile Adhered to Drain at Opening
10. Flow Restrictor Assembly
11. Secondary Overflow Inlet at Catch Basin
12. Outlet Pipe to Storm Drain or Swale System. Locate Crown of Pipe Below Open Graded Base (no. 3) to Prevent Heaving During Freeze/Thaw Cycle
13. Trench Dams at All Utility Crossings

Pervious Paving



Greater
Vancouver
Regional
District

Stormwater Source Control Design Guidelines 2005



Goya Ngan
Landscape Architect

Detailed design guidelines can be found in the Design Guidelines 2005 report, available at www.gvrd.bc.ca




DESIGN PRINCIPLES

- Suitable for flat roofs and, with proper design, roofs of 20° (4:12 roof pitch) or less.
- Suitable for many rooftop situations – industrial, warehousing, commercial buildings, office complexes, hospitals, schools, institutional/ administrative buildings, residential and garages.
- Design a green roof at the same time as designing the building or retrofit, so that the structural load can be balanced with the design of the building.
- In calculating structural loads, always design for the saturated weight of each material.
- Provide construction and maintenance access to extensive green roofs. Access through a 'man door' is preferable to a roof hatch.
- Roofs with less than 2% slope require special drainage construction so that no part of the growing medium is continuously saturated.
- Avoid monocultures when planting a green roof; the success of establishing a self-maintaining plant community is increased when a mix of species is used.
- Provide intensive maintenance for the first 2 years after plant installation – irrigation in dry periods, weed removal, light fertilization with slow release complete fertilizers, and replacement of dead plants.
- To facilitate access and prevent moisture on exposed structural components, provide plant free zones along the perimeter, adjacent facades, expansion joints, and around each roof penetration.
- Fire breaks of non-combustible material, 50cm wide, should be located every 40m in all directions and at roof penetrations.
- Provide protection against root penetration of the waterproof membrane by either adding a root barrier or using a membrane that is itself resistant to root penetration.


A Green Roof is a roof with a veneer of drainage and growing media that supports living vegetation. Green roofs provide a wide range of benefits – from reduction in peak flows and volumes to building heat gain reductions. There are two basic types:

- Intensive – deeper growing medium to support larger plants and trees; designed for public use as well as stormwater and insulation functions.
- Extensive - shallow, lightweight growing medium; designed for stormwater, insulation and environmental functions; vegetation is low and hardy; usually no public access.



Extensive Green Roof

1. Wall Cap Flashing, waterproof membrane extends to 100mm above finished grade
2. Drain Rock, Paving Slab, or Other Buffer Equivalent
3. Wood, Steel or Concrete Curb/Edging (Optional)
4. Planting
5. Growing Medium
6. Filter Layer
7. Drainage Layer
8. Protection Layer and Root Barrier
9. Waterproof Membrane
10. Thermal Insulation
11. Vapour Barrier
12. Area Drain
13. Structural Slab
14. Building Interior
15. Wall Flashing, waterproof membrane extends to 150mm above finished grade



Green Roof Benefits

- Reduced peak flows & stormwater volume
- Mitigation of urban heat island effect
- Insulation against heat loss and gain
- Extended roof membrane life
- Sound insulation and air filtration
- Urban habitat
- Aesthetics

Green Roof



Greater
Vancouver
Regional
District

Stormwater Source Control Design Guidelines 2005



Goya Ngan
Landscape Architect



DESIGN PRINCIPLES

■ Infiltration Trench System:

- Locate infiltration trench at least 3m from any building, 1.5m from property lines, and 6m from adjacent infiltration facilities (or as recommended by a geotechnical engineer).
- Sump: Provide a lid for periodic inspection and cleanout. Include a T-inlet pipe to trap oils, sediments and debris.
- Infiltration Trench: installation of distribution pipe and bottom of drainrock to be level. If more than one section of infiltration trench is required, design so that underground water is temporarily 'ponded' in each infiltration section.
- Install the Infiltration Trench in native ground, and avoid over-compaction of the trench sides and bottom, which reduces infiltration.
- Observation well for each infiltration trench (optional): vertical standpipe, with perforated sides, and locking lid, to allow the monitoring of water depth.

■ Soakaway Manholes System:


- Provide a report from an engineer with experience in geotechnical engineering including on-site test data of infiltration rates at the depth of the proposed infiltration. The bottom of the shaft shall be at least 600mm above the seasonal high water table or bedrock, or as recommended by the engineer.
- If steep slopes or drinking water wells exist within 200m horizontally from the proposed Soakaway Manhole, provide a hydro-geotechnical report to analyze site-specific risks and determine setbacks.
- Provide a sedimentation manhole, and a maximum of two Soakaway Manholes in series, unless otherwise approved.
- Provide an overflow from the Soakaway Manhole to the storm drainage system or major storm flow path.

An Infiltration Trench System includes an inlet pipe or water source, catch basin sump, perforated distribution pipe, infiltration trench and overflow to the storm drainage system.

A Soakaway Manhole (Sump, or Dry Well) System includes an inlet pipe, a sedimentation manhole, and one or more infiltration shafts with connecting pipes. Use of Infiltration Shaft will be limited by hydro-geotechnical conditions in much of GVRD.

Limitations of Infiltration Trench or Soakaway Manholes:

- To avoid groundwater pollution, do not direct un-treated polluted runoff to Infiltration Trench or Shaft:
 - Direct clean runoff (roof, non-automobile paving) to Infiltration Trench or Shaft.
 - For polluted runoff (roads > 1000 vehicles / day, parking areas, other pollution sources), provide upstream source control for pollutant reduction prior to release to Infiltration Trench or Shaft.
- Use infiltration trench or shaft only in areas with footing drains.




Infiltration Trench

Notes:

All precast sections shall conform to the requirements of ASTM C 478. Provide a min. of 150mm of 25mm or 19mm clean crushed rock under all pipes.

Invert shall be level and smooth.

Soakaway Manhole barrel shall not be perforated within 1200mm of the cone.



Sedimentation Manhole

Soakaway Manhole

Soakaway Manhole

- Grass or Other Planting
- Finish Grade
- Growing Medium Backfill
- 100mm Dia PVC DR28 Perforated Pipe
- Light Non-woven Polyester Geotextile c/w Min. 400mm Laps
- 50mm Drain Rock or Rock of Equal Porosity
- Maximum Groundwater Elevation
- Non-polluted Drainage From Building or Terrace
- Alternate Surface Route - With Splash Pad and Vegetated Swale to CB
- CB Lid / Access Hatch for Cleanout, Inspection and Inflow / Overflow from Sump
- Solid Pipe c/w Inlet Tee
- Observation Well (Optional)
- Provide pipe elbows to have outlet pipe invert at top of infiltration pipe
- PVC Solid Pipe
- Discharge to Storm Drainage System. Ensure Drainage Does Not Impact Neighbouring Uses. Direct Discharge to Road Right-of-way if Necessary
- Infiltration Trench with Level Bottom
- Catch Basin
- Building Footing Drain (Not Connected to Infiltration Facility)
- Building
- 50mm Dia Drain Hole
- Standard Manhole Frame and Cover
- Seal Joints with Cement Grout or Approved Mastic
- Street Inlet Connection
- Ladder Rung
- 25mm Crush Gravel or Drain Rock Base
- Native Soil Back Fill
- Undisturbed Ground
- 1200mm Perforated Barrel (Langley Concrete or Equal)
- Overflow to storm drainage system.

Infiltration Trench & Soakaways



Greater
Vancouver
Regional
District

Stormwater Source Control Design Guidelines 2005



Goya Ngan
Landscape Architect

Detailed design guidelines can be found in the Design Guidelines 2005 report, available at www.gvrd.bc.ca



This page is intentionally left blank.

RAINWATER SOURCE CONTROL AROUND THE WORLD

Rainwater Source Control Around the World

The research reveals a surprising level of activity in implementation of rainwater source controls around the world. The goals of water quality improvement and management of stormwater volume resonate around the globe. Water reuse is also a major objective in some jurisdictions.

The research findings from jurisdictions with climates similar to GVRD are presented in Appendix A. This section provides a sampling of the efforts that are underway in these jurisdictions.

Washington, U.S.A.

“Low Impact Development” (LID) is the term used in the U.S. Northwest to refer to designs that try to preserve ‘natural’ characteristics of a watershed, of which source controls are a major component. Since 1992, Washington State’s **stormwater management manuals** have provided guidance for meeting federal and state regulations for protecting water quality and salmon habitat. The long term effectiveness of permeable pavement systems have been a particular focus of research.

Photo Credit: Seattle Public Utilities




The ‘Street Edge Alternatives’ (SEA) project in Seattle, Wash. aims to reduce runoff as well as create an attractive landscape.

Oregon, U.S.A.

Oregon State, and particularly the City of Portland, have been leaders in promoting LID. For example, Portland provides “tree credits” in stormwater calculations, recognizing the flow control and pollution reduction benefits of urban trees. The City also offers an “eco-roof density bonus” whereby a square foot of green roof can earn additional square feet of developable floor area depending on the extent of the green roof.

Photo Credit: Lanarc Consultants Ltd.



A variety of source control BMPs allows the **Buckman Terrace Apartment** complex in Portland to be built with only an overflow connection to a stormwater sewer system.

British Columbia, Canada

Policies supporting source controls have been in the works since the 1990s, and projects implementing some of these practices are now being developed. **Green roofs** have been installed and their performance is being monitored at research facilities in Vancouver (BC Institute of Technology) and Ottawa (National Research Council). There is also new focus on **alternative road standards** to reduce impervious surfaces and promote greater infiltration.

Photo Credit: National Research Council Canada



Participants at a green roof workshop tour the roof garden of the Vancouver Public Library.

Photo Credit: Melbourne Water



At Figtree Place in Newcastle, rainwater collected and used on-site reduces water consumption by 77%.

Photo Credit: Bettess, R, 2001,



Use of pervious paving has grown significantly, with some 400,000 m² of permeable block designs sold in 2001 (Pratt et al., 2002).

Photo Credit: K. Johaentges (Johaentges, K. and E. Holtz, 2000)



In Kronsberg, a *Mulden-Rigolen-System* of combined swales and trenches reduces stormwater volumes to 1/10th of a conventional system. While more expensive to build, the system results in about 30% savings in annual stormwater fees.

Australia

Australia has coined the term **Water Sensitive Urban Design** (WSUD) to focus on controlling runoff sources and maximizing on-site retention, infiltration, treatment and re-use. The use of **infiltration techniques** in different soil types is a focus of attention, especially in the clay soils that predominate in many Australian cities. Aquifer storage and recovery is widely used where land values and evaporation rates are high or catchment areas are intensively developed.

United Kingdom

“Sustainable Urban Drainage Systems” (SUDS) is the phrase used for stormwater measures that take account of water quantity, quality and amenity issues. “Soakaway” is the term used for such methods as rock pits, dry wells and infiltration trenches. Filter drains – a perforated pipe in a trench filled with filter material - are used extensively to replace catch basins in roads and parking lots, and are reported to be effective in removing suspended solids (85%), total lead (83%), zinc (81%) and oil (estimated 70%). Research at Coventry University is proving that pervious paving is effective in trapping and biodegrading oil due to microbial populations that flourish in the subsurface structure (Newman *et al.*, 2001).

Germany

In Germany, where **green roofs** have been used for over 30 years, about 1 in 7 of new flat roofs are green roofs - which translated to 13.5 million m² of green roofs in 2001. In most large cities, a **stormwater fee** is charged on the basis of impervious surface area that discharges to a public system; e.g., 1.30 € (\$1.95)/m²/year in Berlin. Use of source controls qualifies for a discount from these fees.

France

“La ville est son assainissement” is a national guideline in France covering the principles, methods and tools for integrated urban stormwater management. **Swales (“noues”)** are considered desirable source controls because they integrate into the landscape as well as sensitize the public to stormwater issues by making stormwater management more visible. **Porous pavements** are also being used as a source control as well as to reduce urban traffic noise.

Photo Credit: Communauté de Lyon



A road run-off purifying system in Lyon, France. The grate leads to an underground geo-textile lined trench filled with sand and pebbles that filters particles and allows some infiltration. Excess water flows to further settling and filtration systems before releasing to a lake.

Netherlands

The Dutch have developed clear **national objectives** on source control. Separation of stormwater from sewer systems is a primary focus. Infiltration trenches, green roofs and permeable pavement systems are recognized measures. Temporary storage of water on streets is used to reduce peak flows, but bicycle paths and sidewalks are not to be flooded – reflecting that country’s transportation preferences.

Photo Credit: Mr. Dubbeling




A common sight in Dutch neighborhoods, wadis are broad swales covered with a layer of humus and planted with grass or vegetation. They are intended to fill with water during heavy rainfalls and then drain in about 24 hours.

Belgium

Like the Netherlands, the emphasis in Belgium is on disconnecting impervious areas from combined sewer systems. Some municipalities offer subsidies for source controls; e.g., the city of Mortsels pays 3.75€ (\$5.60)/ m² for green roofs to a maximum of 743.68 € (\$1100) and 50% of the cost of an infiltration system up to a maximum of 309.87 € (\$465).

The roof leader from this building in Belgium empties into a cobble gutter, which takes the rainwater to a pervious lawn surface. Note also the pervious pathway surfacing.

Photo Credit: Vlaamse Milieumaatschappij



This page is intentionally left blank.

DESIGN GUIDELINES

This page is intentionally left blank.

Absorbent Landscape

Application

Most landscape – either natural or manmade – acts like a sponge to soak up, store and slowly release rainfall. In most GVRD natural wooded conditions without paving and roof development, 90% of rainfall volume that lands on natural watersheds never becomes runoff, but is either soaked into the soils or evaporates (Stephens *et al.*, 2002). The trees, shrubs, grasses, surface organic matter, and soils all play a role in this absorbent landscape.

Stormwater Variables of Absorbent Landscape

Figure 1-1: Stormwater variables of absorbent landscape.

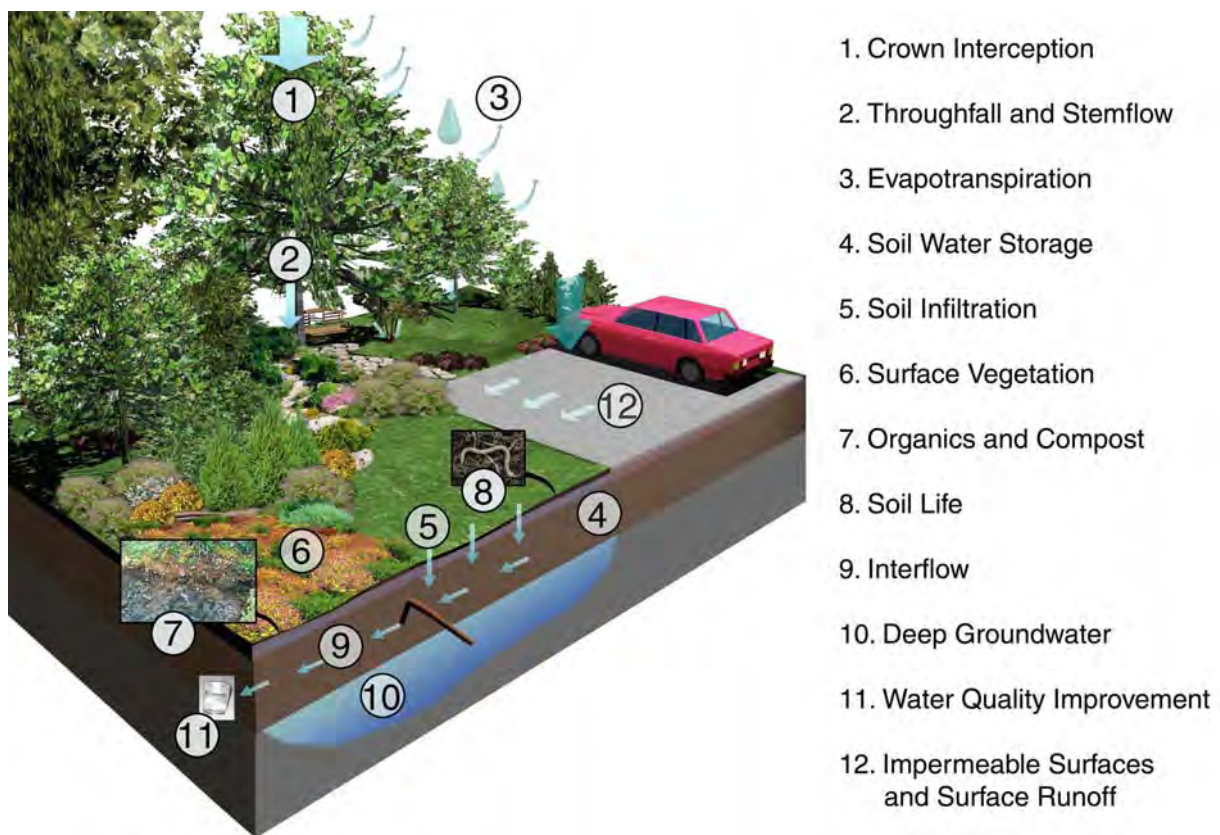


Figure 1-1 shows a schematic representation of the 12 stormwater variables of absorbent landscape discussed below. Keeping these variables in balance is the key to successful stormwater source control using absorbent landscape.

Winter Tree Canopies Intercept 15%-27% of Rainfall

1. Crown Interception




Figure 1-2: Interception, stemflow and throughfall data from California (Xiao et al., 2000)

Scientific studies have shown that a significant amount of gross precipitation is intercepted (i.e., never reaches the ground) by tree crowns. A 50 year old evergreen forest in Scotland had canopy interception of 28% of annual rainfall (Johnston, 1990). Studies of open grown urban trees in Davis, California (average annual rainfall of 446 mm) have shown significant crown interception even in winter - about 15% by a leafless pear tree, and about 27% by a broadleaf evergreen oak (Figure 1-2 - Xiao et al., 2000).

2. Throughfall and Stemflow

Plants provide a stormwater detention function, slowing down rain before it hits the ground surface. Although some rain falls through the canopy as free throughfall, a significant portion lands on either leaf or twigs, where it is delayed prior to creating canopy drip. Some of this rainfall flows down twigs and branches to become stemflow at the tree trunk. The twigs, branches and rough bark of leafless deciduous trees play a significant role in stormwater detention.

3. Evapotranspiration

Trees, shrubs, grasses and other plants draw water up from the soil to the leaves, where the stomata (openings) in the leaves allow for evapo-transpiration. Evaporation also occurs from surface water (puddles, lakes, streams, rooftops) and from surface soils, snow and tree/plant surfaces. The combination of tree canopy interception and evapotranspiration in a natural rainforest can approach 40% of annual rainfall (Stephens et al., 2002).

Rainfall Storage in Soil is 7% to 18% of Soil Volume

4. Soil Water Storage

Soils are the most significant landscape storage mechanism for stormwater. Landscape soils typically store from 7% (sand) to 18% (loam) of their volume as water before becoming saturated to field capacity and generating flow-through or runoff. Loamy soils store more water than sandy soils (Ferguson, 1994).

5. Soil Infiltration

The rate at which water soaks into soils (the infiltration rate or saturated hydraulic conductivity) varies depending on the texture and amount of organic matter in the soil. Fine textured soils with silt and clay exceeding 35% by volume tend to have low infiltration rates (0.6 to 6 mm/hr), whereas sand surface soils are very open to infiltration (210 mm/hr), with loam soils having moderate infiltration rates (13 mm/hr).

Surface crusting and compaction of the top 2 mm of soil can be an important limitation. Thin crusts can be formed on all bare soil surfaces, including fine sand, due to raindrop impact. Surface crusting risks can be addressed by avoiding erosion and sedimentation that carries fines onto the soil surface, and by providing surface mulching, vegetation, organic matter and related soil life in the surface soil (Figure 1-3 - Ferguson, 1994).




Figure 1-3: Infiltration rate of a sandy loam under continuous water sprinkling at a rate in excess of intake with a series of 4 surface conditions (Ferguson, 1994: 191)

Organic Matter Maintains Soil Infiltration Rates

6. Surface Vegetation

Plant materials work to condition the soil – providing a regular supply of organic matter through leaf drop, and opening up macropores in the soil through the process of root growth, death and decay. Soils with vegetated surfaces have higher maintained surface infiltration rates than bare soils, because macroporosity of the soil is continually regenerated by plants and animals (Ferguson, 1994). Surface vegetation is also very effective at stopping erosion from starting. Leaves of grasses and similar plants on the soil surface also act as physical filters to runoff – causing sediments and attached pollutants like metals and phosphorus to drop out of the water.

7. Organics and Compost

Addition of organic matter or compost to soils increases the infiltration and moisture holding capability of sandy, silt/clay or till soils that are not permanently saturated. Organic matter in the soil reduces the need for fertilization and can reduce the need for supplementary watering by 60% when compared to sites with unamended topsoil (Chollak and Rosenfeld, 1999). For stormwater purposes, organic matter targets of 8% for lawn areas and 15% for shrub areas are recommended. Compost blankets and berms for erosion control have been tested and proven to be as effective as silt fence (Tyler, 2002).

8. Soil Life

Compost and soil is a living material – a mature topsoil with 5% organic matter can contain as much as 7.5 tons of organisms per hectare (Carpenter-Biggs, 2002). Together with plant roots, soil fauna such as earthworms, insects, ants, and moles form and maintain macropores in the soil. These larger organisms rely on a soil ecosystem of microscopic species sustained by organic matter. In soils or surface crusts of low conductivity, even a small amount of macroporosity can increase hydraulic conductivity by more than 10 times (Ferguson, 1994).

9. Interflow

Summer base flow in streams is maintained by 'interflow' of rainfall in shallow soils. With a typical water flow rate of 12.5mm/hr in loam, a raindrop would travel through the soil at 300mm/day, taking 100 days to travel 30 metres.

10. Deep Groundwater

Soil water also flows by gravity through soils or fractured rock to deep groundwater, which stores 98.4% of the unfrozen fresh water of the earth, as compared to 1.4% in lakes and streams (Montgomery, 1987). Protection of the quality of this groundwater through the filtration processes in surface soils is critical to drinking water supplies.

11. Water Quality Improvement

Infiltration of stormwater through healthy soil is one of the most effective practices to improve water quality and remove urban pollutants.

Impermeable Surfaces Create 8-10 times the Runoff of Absorbent Landscape

12. Impermeable Surfaces and Surface Runoff

Impermeable pavement and rooftop removes the functions of absorbent landscape. Volume of runoff from impermeable roof and pavement without any best management practices is 8-10 times the runoff from absorbent landscape. This increased runoff dramatically increases flows in streams, exceeding the mean annual flood level more often, which results in stream erosion, flooding and loss of property and habitat (Stephens *et al.*, 2002).

Typical Infiltration Rates of Soils

Soil is comprised of sand, silt, clay and organic matter in varying proportions that affect the infiltration rate. For design purposes, infiltration rates should be measured at the location and depth of the proposed infiltration using a percolation test or a double-ring infiltrometer.

Typical published infiltration rates shown in Table 1-1 are Saturated Hydraulic Conductivity (Ferguson, 1994).

Even minor infiltration rates are significant when applied over time – a 1 mm/hour infiltration rate absorbs 24 mm per day, or 168 mm per week.

Table 1-1: Typical Infiltration Rates

USDA Soil Class	Saturated hydraulic conductivity (mm/hr)
Sand	210
Loamy sand	61*
Sandy loam	26*
Loam	13
Silt loam	6.8
Sandy clay loam	4.3
Clay loam	2.3
Silty clay loam	1.5
Sandy clay	1.2
Silty clay	0.9
Clay	0.6

*Target soil texture for growing medium Level 2 “Groomed” and Level 3 “Moderate” landscape areas in B.C. Landscape Standard, which represent a good balance between infiltration performance and water retention capabilities.

Limitations

- ❑ Absorbent landscape needs to be implemented properly to avoid conditions that would cause reduced infiltration at the surface due to sedimentation, excessive compaction, or lack of vegetative cover. Quality control is necessary regarding installed soil properties, erosion and sediment control, and establishment of vegetation.
- ❑ Site plans that drain large areas of impervious area into small areas of landscape risk overwhelming the absorbent capabilities of soil. All designs should calculate the projected flows and water balance, and should provide for an overflow – surface or piped – to the major storm flood control system.
- ❑ To meet typical performance targets (e.g., infiltrating the first 25 – 60mm of rainfall), the amount of absorbent landscape area on a site or in a drainage basin must be balanced with the amount of impervious area. This will impact many aspects of urban design - e.g., by promoting building forms that minimize impervious building footprints, by placing landscape over parking or rooftops, or by designing narrower roads and larger landscape islands in parking areas.

Design Guidelines

1. Maximize the area of absorbent landscape – either existing or constructed – on the site.
2. Conserve as much natural forest land, existing trees and undisturbed soil as is compatible with the project. Provide temporary fencing of these protected areas during construction.
3. Minimize impervious area through such techniques as multi-storey buildings, narrower roads, minimum parking, larger landscape areas, green roof, and pervious paving.
4. Disconnect impervious areas from the storm sewer system, having them drain to absorbent landscape with only an overflow to the storm drainage system.
5. Design absorbent landscape areas as gently sloping (2%) or dished (concave) areas that temporarily store stormwater and allow it to soak in (maximum ponding time of 2 days), with overflow only occurring in large rain events.
6. When planting, maximize the vegetation canopy cover over the site. Cover by multi-layered evergreen trees and shrubs is ideal, but deciduous tree cover also is beneficial for stormwater management.
7. Use native planting species where feasible. Non-native plantings with similar attributes to native may be suitable in conditions where natives would grow too large or not meet other urban design objectives.
8. Ensure adequate growing medium depth for both horticultural and stormwater needs – generally a minimum of 150mm depth for lawn areas, and 450mm depth for shrub/tree areas. In wetter areas of the GVRD near the mountains with till subsoils, a minimum growing medium depth of 300mm for lawn areas is required to store 60mm of rainfall.
9. Test growing medium for physical and chemical properties, and amend it to provide approximately 8% organic matter for lawns, and 15% organic matter for planting beds, in the upper 200mm of growing medium.
10. Do not over-compact landscape subgrade or growing medium. Optimum compaction is firm against deep footprints (about 80% Proctor Density). Excessive compaction reduces infiltration rates. Rip or till subsoils that are excessively compacted. Aerate compacted surface soils.

Photo Credit: Lanarc Consultants Ltd.



Drainage from parking area to landscape.

11. Scarify subgrade surfaces prior to placing growing medium, and rototill through layers of growing medium to create a transition in soil texture rather than discrete soil layers. Do not install soils in layers of different textures, as this can create barriers to infiltration.
12. Provide vegetative cover (grass, groundcovers, shrubs, trees) or organic cover (mulch, straw, wood fibre) to absorbent landscape as early as possible in the construction process, and prior to winter storms, to avoid surface crusting from raindrop impact and to maintain surface permeability.
13. Provide effective erosion control during construction, including erosion control on upstream sites that may flow into the absorbent landscape. Delay installation of constructed absorbent landscape until sources of potential erosion in the upstream drainage area have been permanently stabilized.

Photo Credit: Lanarc Consultants Ltd.



Straw laid on surface to prevent erosion and crusting from raindrop impact.

Guideline Specifications

Materials and methods shall meet Master Municipal Construction Document 2000 requirements, including the Section 02921 requirements for Growing Medium, with organic matter requirements amended as follows:

For lawn areas	minimum 8%
For planting areas	minimum 15%

Infiltration Swale System

Description

The Infiltration Swale System combines aspects of grass swales and infiltration trenches.

The surface component of an infiltration swale is a shallow grassed channel, accepting flows from small areas of adjacent paved surfaces such as roads and parking. The swale is designed to hold the water quality storm behind a weir, and then allow it to infiltrate slowly through a soil bed to an underlying drain rock reservoir system.

The surface soils and drain rock reservoir are sized to store the design storm event, and to allow it to infiltrate slowly into underlying soils. A perforated drain placed near the top of the drain rock reservoir provides an underground overflow, which also maintains drainage of adjacent road base courses. The surface swale and weir structures provide conveyance for larger storm events to a surface outlet.

Other common terms used are *Dry Swale with Underdrain* (Stephens *et al.*, 2002) or *Swale/Trench Element* (MUNLV-NRW, 2001).

Application

- ❑ Designed to treat the water quality volume and convey larger flows (Stephens *et al.*, 2002).
- ❑ Provision of underground overflow allows use of the technique in most soils, including clay with infiltration rates as low as 0.6mm/hr.
- ❑ Suitable for most development situations – residential areas, municipal office complexes, rooftop runoff, parking and roadway runoff, parks and greenspace, golf courses (Stephens *et al.*, 2002).
- ❑ With proper weir spacing, practical for profiles up to 10% slope.

Limitations

- ❑ Maximum contributing area 2 ha (Stephens *et al.*, 2002).
- ❑ Minimum depth from base of drain rock reservoir to water table 610 mm (Stephens *et al.*, 2002).
- ❑ Identify pollutant sources, particularly in industrial/commercial hotspots, that require pre-treatment or source control upstream of this BMP. (Maryland Dept. Environmental Resources Program, 2000).

Photo Credit: Lanarc Consultants



Drop curb at pavement edge to grass infiltration swale.

- ❑ Design should provide for drain rock reservoir to drain in 96 hours to allow aerobic conditions for water quality treatment.

Design Guidelines

1. The swale infiltration area should be approximately 10-20% of the upstream impervious area that it serves, with its sizing preferably calculated by continuous flow modelling.
2. Flow to the swale should be distributed sheet flow, travelling through a grassy filter area at the swale verges (500 mm min., >3000 mm desirable). Provide pre-treatment erosion control to avoid sedimentation in the swale. Provide non-erodable material, sediment cleanout basins, and weir flow spreaders at point-source inlets (Maryland Dept. Environmental Resource Programs, 2001).
3. Provide vegetated erosion control along all sides of weir and at drainage inlets.
4. Pavement edge at the swale may be wheel stop, flush curb, or reverse curb (Figure 2E). Provide a 25mm drop at the edge of paving to the swale soil surface, to allow for positive drainage and buildup of road sanding/organic materials at this edge.
5. Swale planting is typically sodded lawn. Low volume swales can be finished with a combination of grasses, shrub, groundcover and tree planting to provide a 100% vegetated cover within 2 years of planting.
6. Swale longitudinal slope should be 1-2%, or dished between weirs.
7. Swale bottom width - 600mm minimum, 2400mm maximum, flat in cross section.
8. Swale surface side slopes - 3(horizontal):1(vertical) maximum, 4:1 preferred for maintenance.
9. Weirs to have level top to spread flows and avoid channelization, keyed in 100mm minimum. Integrated mowing strip is desirable in lawn areas.
10. Design stormwater conveyance using Manning's formula, with attention to erosion and channel stability during maximum flows.
11. Maximum ponded level: 150mm (Maryland Dept. Environmental Resource Programs, 2001).
12. Drawdown time for the maximum surface ponded volume – 48 hours maximum (24 hours maximum - Maryland Dept. Environmental Resource Programs, 2001).

Photo Credit: Lanarc Consultants



Flush curb (left) to grass filter to vegetated (shrubs, groundcover) swale.

13. Minimum freeboard to adjacent paving: 100mm or in accordance with swale conveyance design.
14. Treatment soil depth: 450mm is desirable, minimum 150mm if design professional calculates adequate pollutant removal (Maryland Dept. Environmental Resource Programs, 2001), or 100 min. growing medium over 100mm min washed sand (MUNLV-NRW, 2001).
15. Drain rock reservoir bottom shall be level.
16. Underground weirs (Figure 2A) of undisturbed native material or constructed ditch blocks shall be provided to create underground pooling in the reservoir sufficient for infiltration performance.
17. A non-erodible outlet or spillway must be established to discharge overflow (Maryland Dept. Environmental Resource Programs, 2001).
18. Avoid utility or other crossings of the swale. Where utility trenches must be constructed crossing below the swale, install trench dams to avoid infiltration water following the utility trench.

Design Options

Drain rock reservoir and underdrain may be deleted where infiltration tests by the design professional taken at the level of the base of the proposed construction show an infiltration rate that exceeds the maximum inflow rate for the design storm.

The attached Drawings 2B through 2D, and the Infiltration Swale System Summary Poster illustrate the options.

Photo Credit: Water Concept Kronsberg



Swale with check dams under construction.

Photo Credit: Water Concept Kronsberg



Swale with check dams in operation.

Guideline Specifications

Materials shall meet Master Municipal Construction Document 2000 requirements, and:

1. Infiltration Drain Rock: clean round stone or crushed rock, 75mm max, 38mm min, 40% porosity (Maryland Dept. Environmental Resource Programs, 2001).
2. Pipe: PVC, DR 35, 150 mm min. dia. with cleanouts.
3. Geosynthetics: as per Section 02498, select for filter criteria or from approved local government product lists.
4. Sand: Pit Run Sand as per Section 02226.
5. Growing Medium: As per Section 02921 Topsoil and Finish Grading, Table 2, including the requirement for minimum saturated hydraulic conductivity of 2 cm/hr., with organic matter requirements amended as follows:
 - a. For lawn areas minimum 8%
 - b. For planting areas minimum 15%
6. Seeding: to Section 02933 Seeding or 02934 Hydraulic Seeding (note – sodding will be required for erosion control in most swales, subject to the erosion control professional's decision).
7. Sodding: to Section 02938 Sodding.

Construction practices shall meet Master Municipal Construction Document 2000 requirements, and:

1. Isolate the swale site from sedimentation during construction, either by use of effective erosion and sediment control measures upstream, or by delaying the excavation of 300mm of material over the final subgrade of the swale until after all sediment-producing construction in the drainage area has been completed (Maryland Dept. Environmental Resource Programs, 2001).
2. Prevent natural or fill soils from intermixing with the Infiltration Drain Rock. All contaminated stone aggregate must be removed and replaced (Maryland Dept. Environmental Resource Programs, 2001).
3. Infiltration Drain Rock shall be installed in 300mm lifts and compacted to eliminate voids between the geotextile and surrounding soils (Maryland Dept. Environmental Resource Programs, 2001).
4. Maintain grass areas to mowed height between 50mm and 150mm., but not below the design water level. Landscape Maintenance standards shall be to the BC Landscape Standard, 6th Edition, Maintenance Level 4: Open Space / Play Area.

Photo Credit: Lanarc Consultants




Infiltration swale in parking area –
Water Pollution Control Laboratory,
Portland, Oregon.

- ① OUTLET TO PIPE SYSTEM OR WATERCOURSE
- ② WEIR KEYED INTO SWALE SIDE SLOPE

- ③ GROWING MEDIUM
- ④ SAND

- ⑤ UNDERGROUND WEIR OF COMPACTED NATIVE MATERIAL OR EQUIVALENT TO CREATE SUBSURFACE BASIN
- ⑥ EXISTING SCARIFIED SUB-SOIL


- ⑦ DRAIN ROCK RESERVOIR (OPTIONAL)
- ⑧ PERFORATED DRAIN PIPE (OPTIONAL)
- ⑨ HIGH FLOW OVERFLOW




2 INFILTRATION SWALE

Not To Scale


Longitudinal Profile




PLAN




DETAIL SECTION - WEIR WITH PONDING



DETAIL SECTION - WEIR WITHOUT PONDING




- ① WEIR KEYED INTO SWALE SIDE SLOPE
- ② GROWING MEDIUM
- ③ SAND
- ④ EXISTING SCARIFIED SUBSOIL
- ⑤ TRENCH DAMS AT ALL UTILITY CROSSING
- ⑥ PROVIDE EROSION CONTROL ALONG ALL SIDES OF WEIR AND AT DRAINAGE INLETS




FULL INFILTRATION SWALE

Not To Scale


Plan / Section




PLAN



DETAIL SECTION - WEIR WITH PONDING




DETAIL SECTION - WEIR WITHOUT PONDING



SECTION



- ① WEIR KEYED INTO SWALE SIDE SLOPE
- ② GROWING MEDIUM
- ③ SAND
- ④ EXISTING SCARIFIED SUBSOIL
- ⑤ DRAIN ROCK RESERVOIR
- ⑥ GEOTEXTILE FILTER ALONG ALL SIDES OF RESERVOIR
- ⑦ TRENCH DAMS AT ALL UTILITY CROSSINGS
- ⑧ PROVIDE EROSION CONTROL ALONG ALL SIDES OF WEIR AND AT DRAINAGE INLETS




FULL INFILTRATION SWALE WITH RESERVOIR

Not To Scale


Plan / Section




DETAIL SECTION - WEIR WITH PONDING



DETAIL SECTION - WEIR WITHOUT PONDING



- ① WEIR KEYED INTO SWALE SIDE SLOPE
- ② GROWING MEDIUM
- ③ SAND
- ④ EXISTING SCARIFIED SUBSOIL
- ⑤ PERFORATED UNDERDRAIN (150mm DIA MIN.)
- ⑥ DRAIN ROCK RESERVOIR
- ⑦ GEOTEXTILE FILTER ALONG ALL SIDES OF RESERVOIR
- ⑧ TRENCH DAMS AT ALL UTILITY CROSSING
- ⑨ PROVIDE EROSION CONTROL ALONG ALL SIDES OF WEIR AND AT DRAINAGE INLETS




PARTIAL INFILTRATION SWALE WITH RESERVOIR AND SUBDRAIN


Not To Scale

Plan / Section


- ① 25mm VERTICAL DROP (TYP)
- ② 4:1 MAX. SLOPE FOR FIRST $\geq 500\text{mm}$
- ③ REINFORCED WITH EROSION CONTROL TREATMENT AND FLOW SPREADER AT POINTS OF WATER ENTRY (TYP.)




WHEEL STOP WITH GAPS



FLUSH CURB



REVERSE CURB



CURBING OPTIONS

Not To Scale

Section

This page is intentionally left blank.

Infiltration Rain Garden

Description

The Infiltration Rain Garden is a form of bioretention facility, designed to have the aesthetic appeal of a garden, as opposed to a purely functional appearance. Rain Gardens are commonly a concave landscape area where treated runoff from roofs or paving is allowed to pond temporarily while infiltrating into deep constructed soils below (See Drawing 3A).

The surface planting of Rain Gardens is dominated by trees, shrubs, and groundcovers, with planting designs respecting the various soil moisture conditions in the garden. Plantings may also include rushes, sedges and other grass-like plants, as well as sodded lawn areas for erosion control and multiple uses.

On subsoils with low infiltration rates, Rain Gardens often have a drain rock reservoir and perforated drain system to collect excess water. (See Drawing 3B & 3C). The perforated drain system may connect to a control structure in a catch basin that provides overflow while maintaining a slow decanting of the water in the rain garden between storms (See Drawing 3D).

While usually designed as a 'standalone' facility without conveyance, new designs are evolving that put a series of Rain Gardens along linear areas like roads – with weirs and surface conveyance similar to Infiltration Swales.

Other common terms used are *Bioretention and Dry Swale with Underdrain* (Stephens et al., 2002) or *Swale / Trench Element* (MUNLV-NRW, 2001).

Application and Limitations

Application and Limitations are similar to Infiltration Swales.

Photo Credit: Lanarc Consultants Ltd.



Formal rain garden, Buckman Terrace, Portland Oregon.

Photo Credit: Lanarc Consultants Ltd.



Informal rain garden, Water Pollution Control Laboratory, Portland Oregon

Photo Credit: Lanarc Consultants Ltd.



Rain garden overflow, Buckman Terrace, Portland Oregon.

Design Guidelines

1. The Rain Garden area should be 10-20% of the upstream impervious area that it serves, preferably sized by continuous flow modelling. Common rain garden size is about 50 m² draining 250m² of impervious area, although this sizing and proportion will vary by rainfall and soil characteristics. Smaller, distributed Rain Gardens are better than single large scale facilities.
2. Site Rain Gardens similar to other infiltration facilities – minimum 30m from wells, minimum 3 m downslope of building foundations, and only in areas where foundations have footing drains.
3. Provide pretreatment erosion control to avoid sedimentation in the garden. Provide non-erodable material, sediment cleanout basins, and weir flow spreaders at point-source inlets. Flow to the swale should be distributed sheet flow, travelling through a grassy filter area or grass swale prior to entering the Rain Garden (500 mm minimum, greater than 3000 mm desirable grassy pretreatment swale length; Claytor and Schueler, 1996).
4. Rain Garden bottom (Drawing 3A): flat cross section, with a longitudinal slope of 2% (or 1% by US001, or dished by GE004). Provide a 50mm – 75mm layer of organic mulch – well aged compost, bark mulch or similar weed free material. The mulch is important for both erosion control and maintaining infiltration capacity.
5. Rain Garden bottom width: 600mm minimum, 3000mm desirable, length:width ratio of 2:1 (Gibb *et al.*, 1999).
6. Rain Garden side slopes 2 horizontal : 1 vertical maximum, 4:1 preferred for maintenance. Provide organic mulch on side slopes similar to bottom.
7. Maximum ponded level: 150mm (Gibb *et al.*, 1999), 300mm (NRW).
8. Drawdown time for the maximum surface ponded volume: 48 hours (72 hours max. - Maryland Dept. Environmental Resource Programs, 2001).
9. Treatment soil depth: 450mm minimum (City of Portland, 2002), 1200mm desirable (Gibb *et al.*, 1999). Treatment soil should have a minimum infiltration rate of 13mm/hr, with 6mm/hr used for design.
10. Slope of the drain rock reservoir bottom shall be level.
11. A non-erodible outlet or spillway must be established to discharge overflow (Maryland Dept. Environmental Resource Programs, 2001).

12. Avoid utility or other crossings of the Rain Garden. Where utility trenches must be constructed crossing below the garden, install trench dams to avoid infiltration water following the utility trench.
13. Rain gardens can be constructed in a variety of shapes, including formal rectilinear flow-through planters (Drawing 3E). Get geotechnical advice prior to siting rain gardens closer than 3m to building foundations.

Design Options:

Infiltration Rain Gardens may take a variety of shapes, from informal, organically shaped 'bowls' to formal, rectilinear planting areas and planters.

Drain rock reservoir and underdrain may be deleted where infiltration tests by the design professional taken at the level of the base of the proposed construction show an infiltration rate that exceeds the inflow rate for the design storm.

Photo Credit: Lanarc Consultants Ltd.



Flow-thru planter – a formal-shaped rain garden that provides water quality treatment and limited flow attenuation – adapted to a near-building location at Buckman Terrace in Portland, Oregon.


Guideline Specifications

Materials shall meet Master Municipal Construction Document 2000 requirements, and:

1. Infiltration Drain Rock: clean round stone or crushed rock, 75mm max, 38mm min, 40% porosity (Maryland Dept. Environmental Resource Programs, 2001).
2. Pipe: PVC, DR 35, 150 mm min. dia., with cleanouts.
3. Geosynthetics: as per Section 02498, select for filter criteria or from approved local government product lists.
4. Sand: Pit Run Sand as per Section 02226.
5. Growing Medium: As per Section 02921 Topsoil and Finish Grading, Table 2, including the requirement for minimum saturated hydraulic conductivity of 2 cm/hr., with organic matter requirements amended as follows:
 - a. For lawn areas minimum 8%
 - b. For planting areas minimum 15%
6. Seeding: to Section 02933 Seeding or 02934 Hydraulic Seeding (note – sodding will be required for erosion control in most instances).
7. Sodding: to Section 02938 Sodding.

Construction Practices shall meet Master Municipal Construction Document 2000 requirements, and:


1. Isolate the swale site from sedimentation during construction, either by use of effective erosion and sediment control measures upstream, or by delaying the excavation of 300mm of material over the final subgrade of the swale until after all sediment-producing construction in the drainage area has been completed (Maryland Dept. Environmental Resource Programs, 2001).
2. Prevent natural or fill soils from intermixing with the Infiltration Drain Rock. All contaminated stone aggregate must be removed and replaced (Maryland Dept. Environmental Resource Programs, 2001).
3. Infiltration Drain Rock shall be installed in 300mm lifts and compacted to eliminate voids between the geotextile and surrounding soils (Maryland Dept. Environmental Resource Programs, 2001).
4. Maintain grass areas to mowed height between 50mm and 150mm., but not below the design water quality flow level. Landscape Maintenance standards shall be to the BC Landscape Standard, 6th Edition, Maintenance Level 4: Open Space / Play.

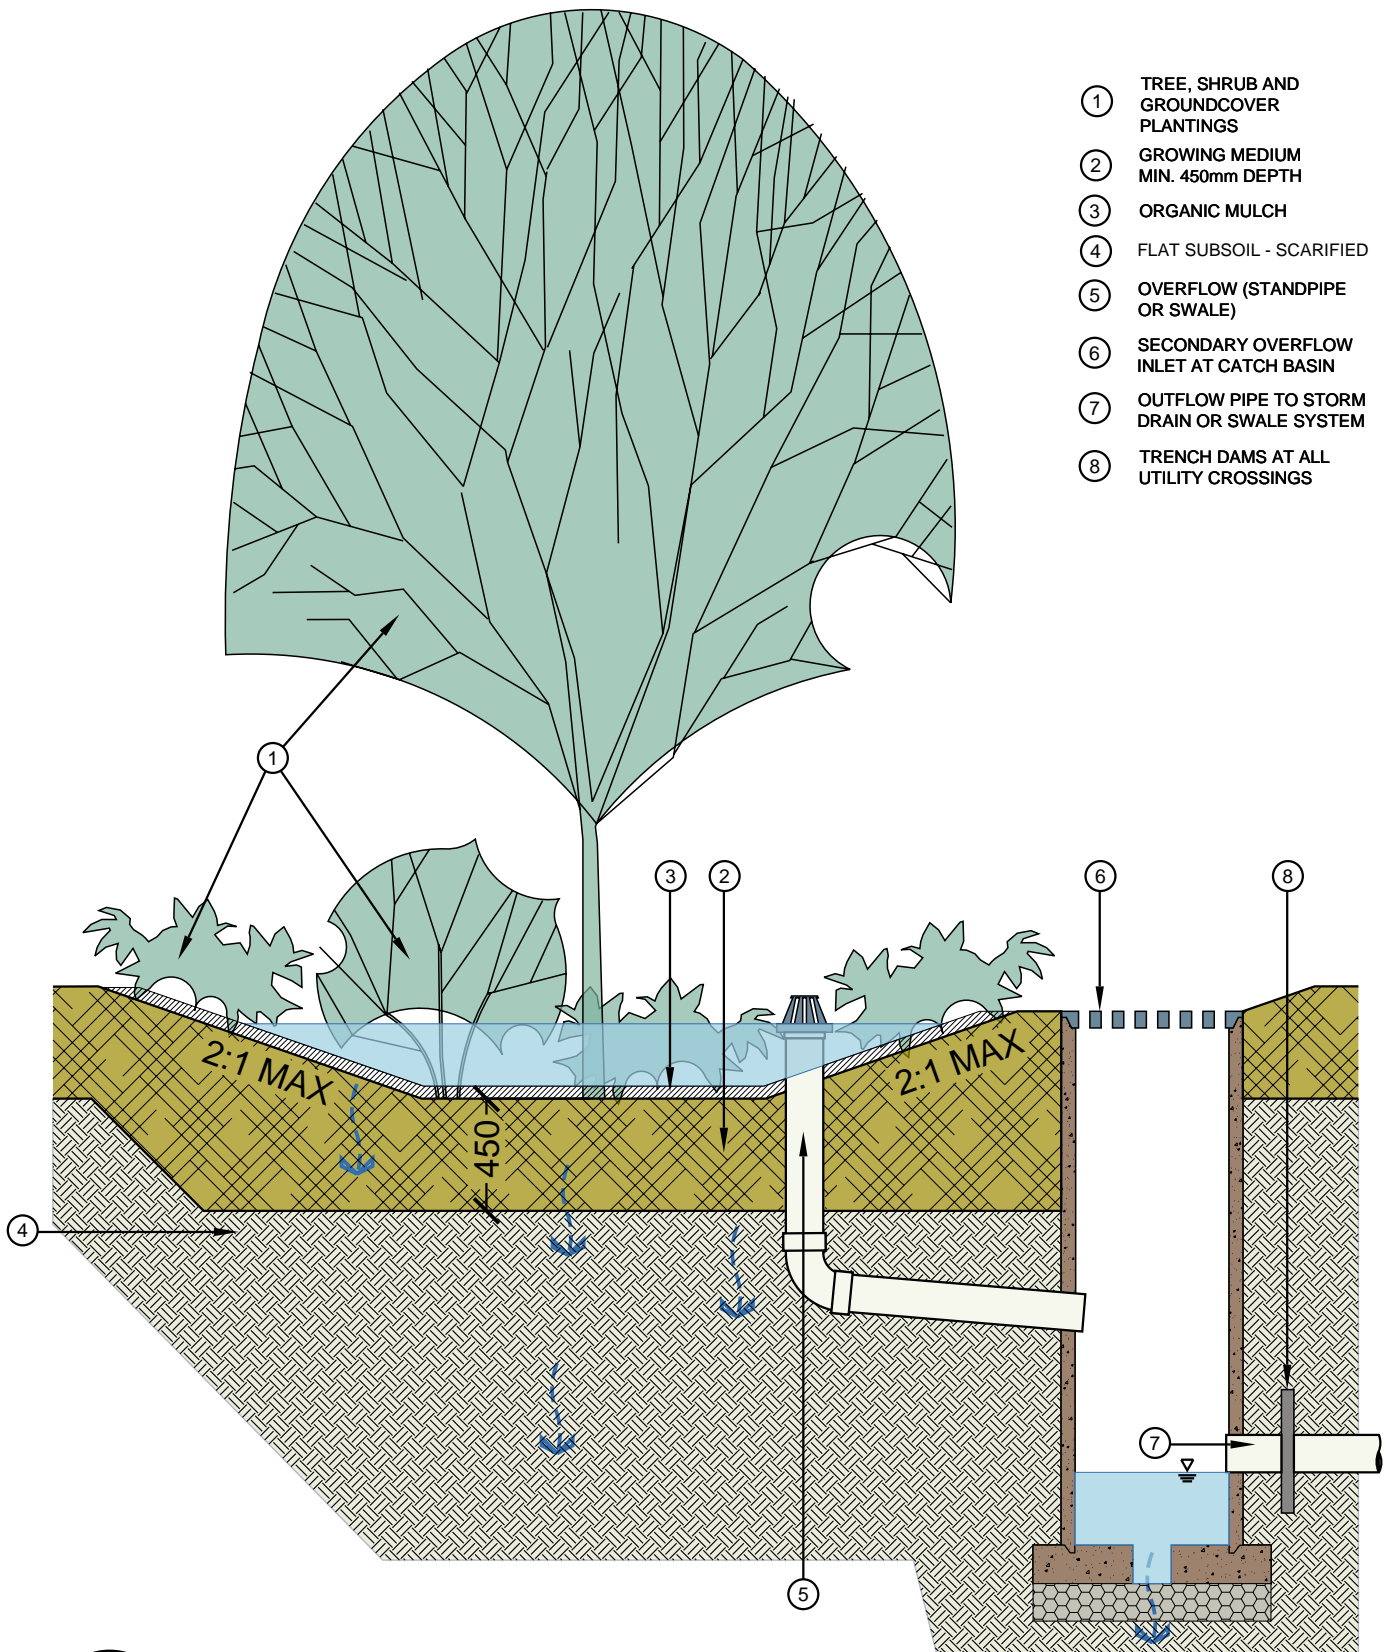



- ① TREE, SHRUB AND GROUND COVER PLANTINGS
- ② GROWING MEDIUM MIN. 450mm DEPTH
- ③ ORGANIC MULCH
- ④ FLAT SUBSOIL - SCARIFIED
- ⑤ OVERFLOW (STANDPIPE OR SWALE)
- ⑥ SECONDARY OVERFLOW INLET AT CATCH BASIN
- ⑦ OUTFLOW PIPE TO STORM DRAIN OR SWALE SYSTEM
- ⑧ TRENCH DAMS AT ALL UTILITY CROSSINGS

3 RAIN GARDEN - FULL INFILTRATION
A Not To Scale

Section

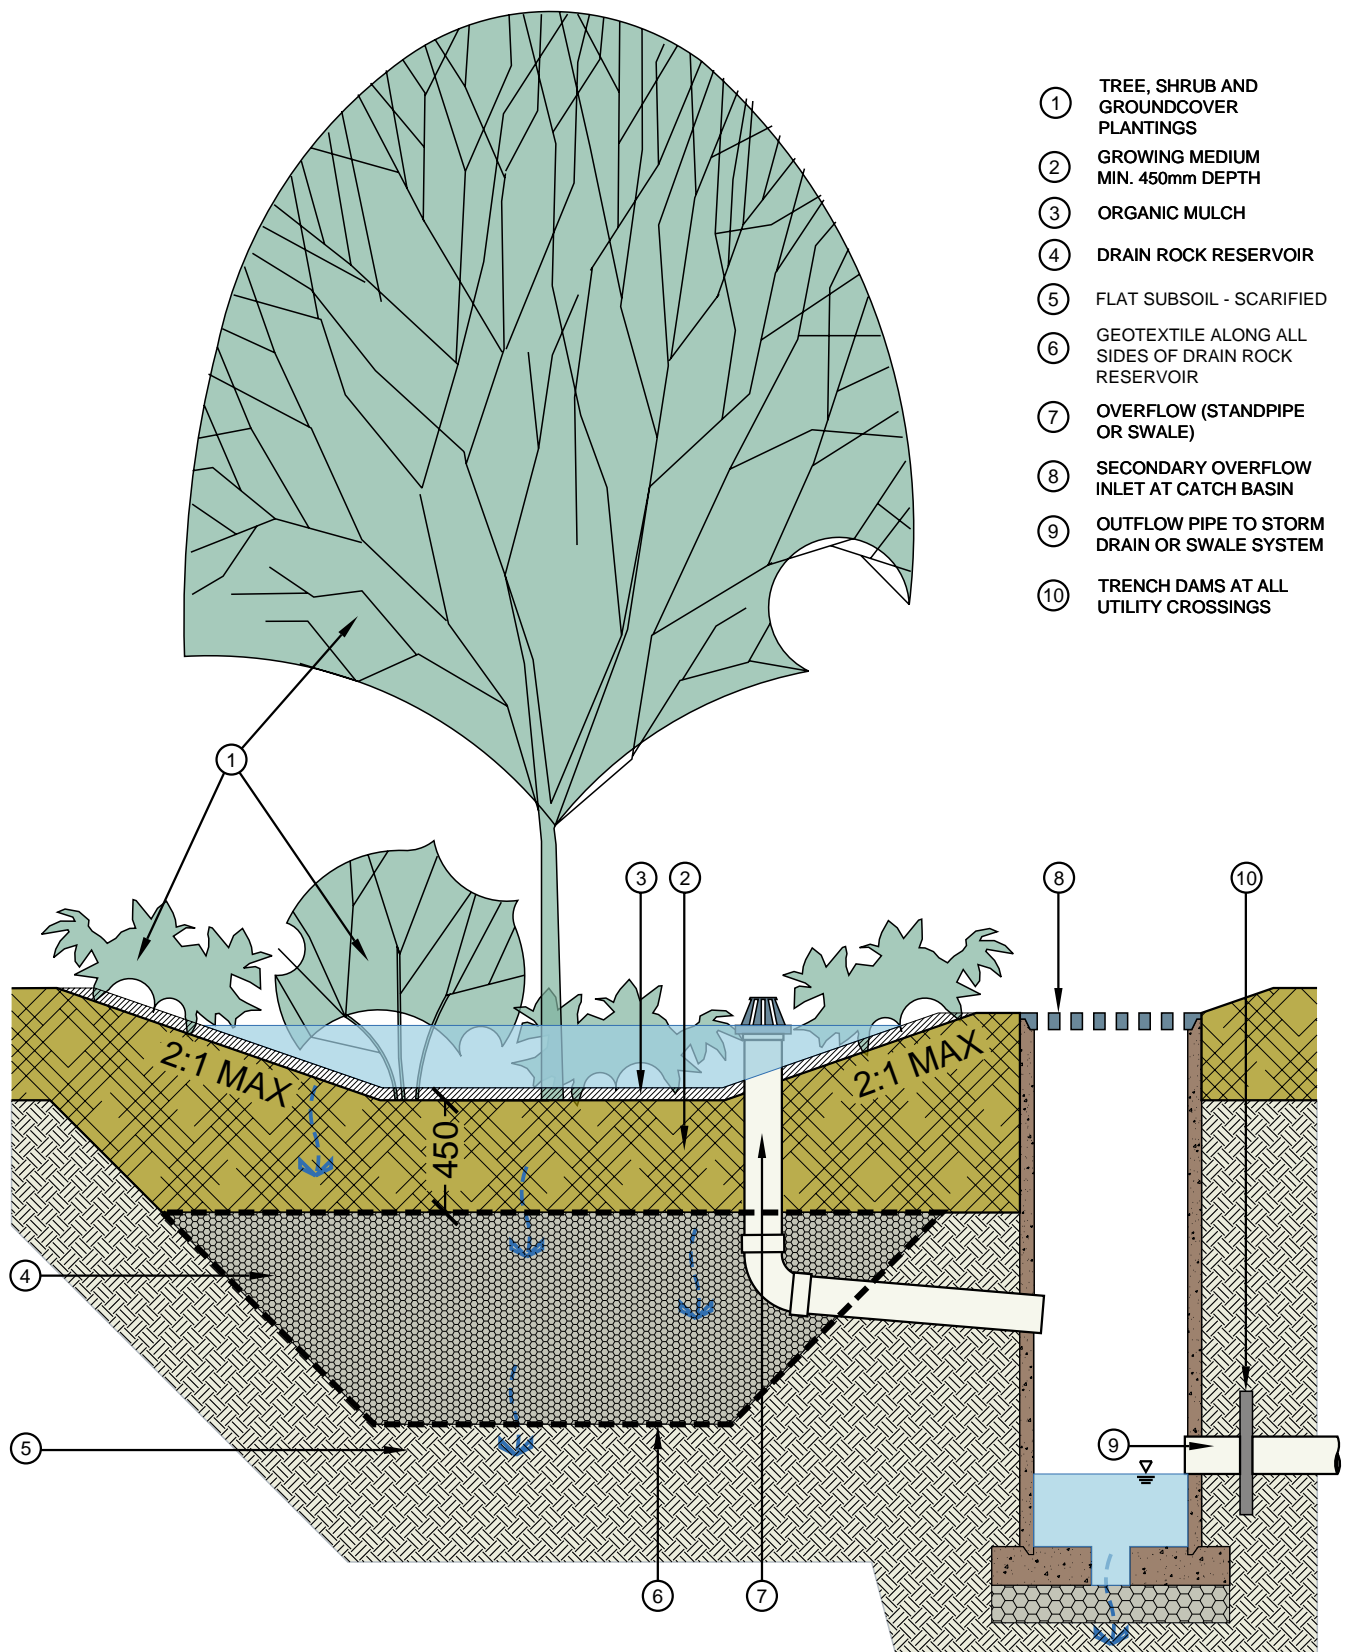

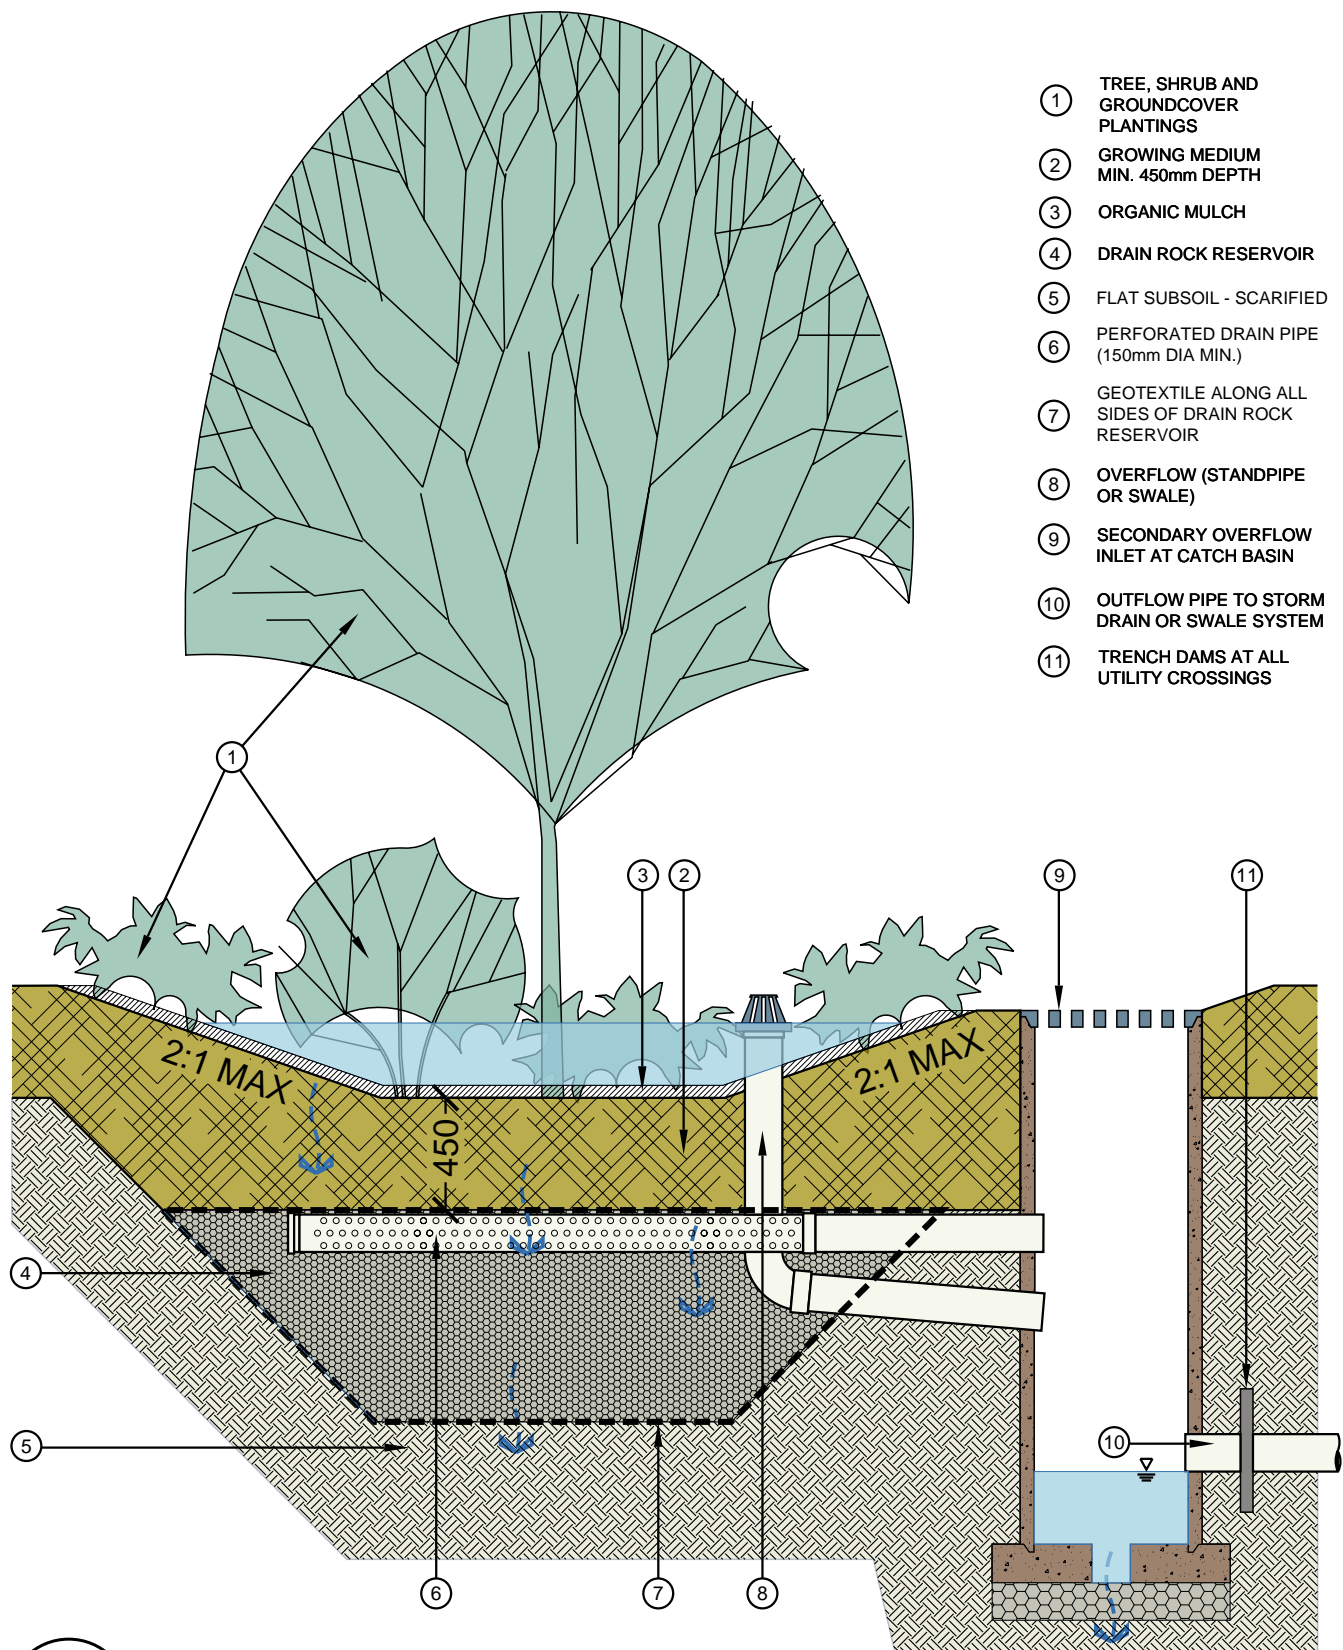


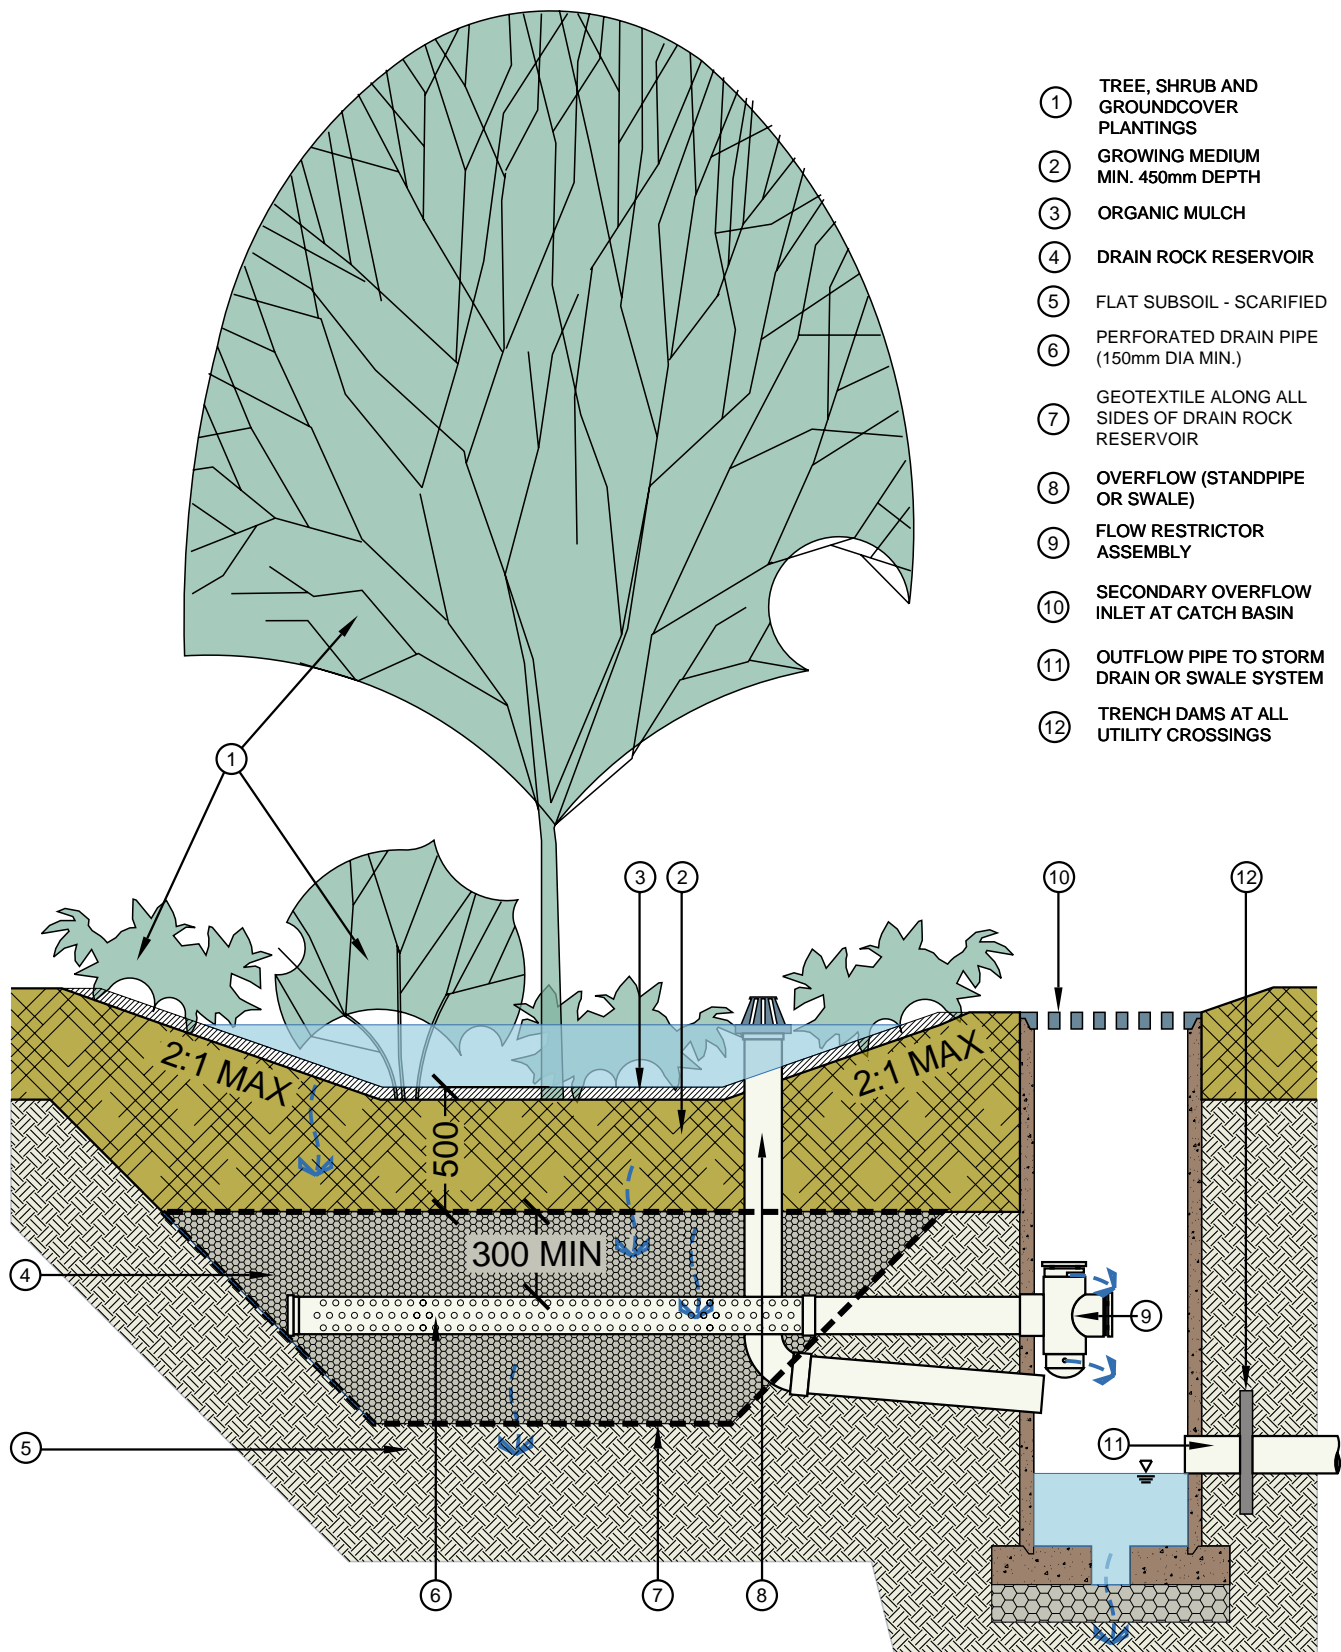

- ① TREE, SHRUB AND GROUND COVER PLANTINGS
- ② GROWING MEDIUM MIN. 450mm DEPTH
- ③ ORGANIC MULCH
- ④ DRAIN ROCK RESERVOIR
- ⑤ FLAT SUBSOIL - SCARIFIED
- ⑥ PERFORATED DRAIN PIPE (150mm DIA MIN.)
- ⑦ GEOTEXTILE ALONG ALL SIDES OF DRAIN ROCK RESERVOIR
- ⑧ OVERFLOW (STANDPIPE OR SWALE)
- ⑨ FLOW RESTRICTOR ASSEMBLY
- ⑩ SECONDARY OVERFLOW INLET AT CATCH BASIN
- ⑪ OUTFLOW PIPE TO STORM DRAIN OR SWALE SYSTEM
- ⑫ TRENCH DAMS AT ALL UTILITY CROSSINGS

3 RAIN GARDEN - PARTIAL INFILTRATION WITH FLOW RESTRICTOR
D Not To Scale

Section

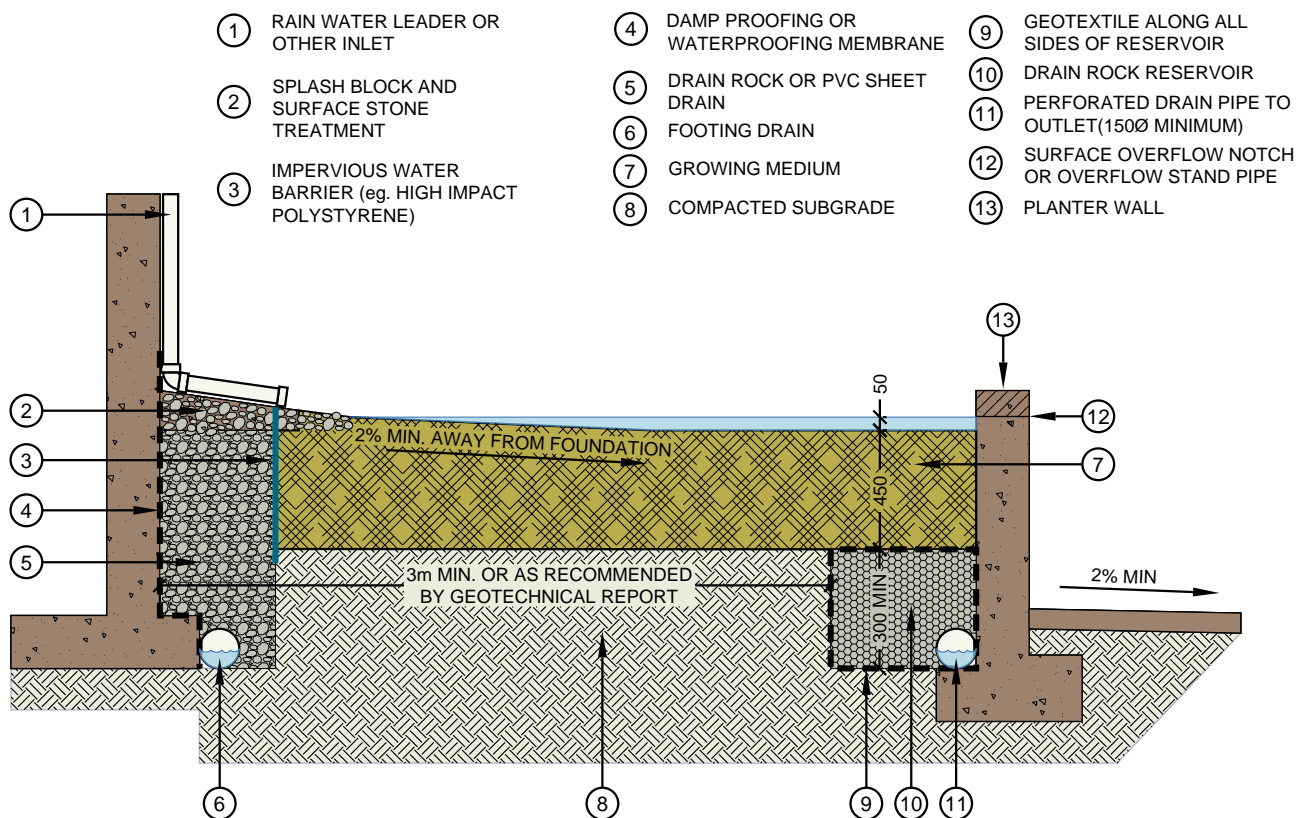


3

E

FLOW THROUGH PLANTER

Not To Scale

Section

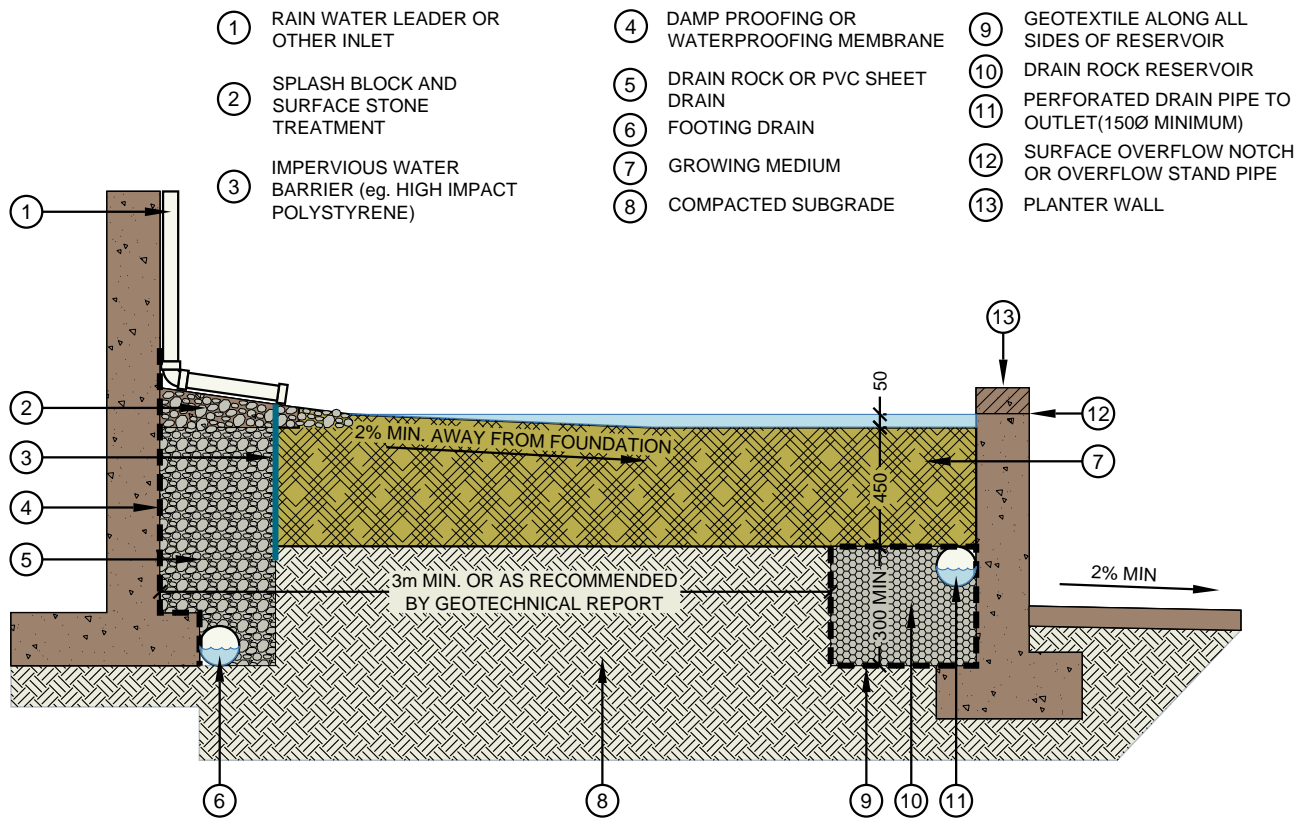

3
F

INFILTRATION PLANTER

Not To Scale

Section

Pervious Paving

Description

Pervious paving is a surface layer of paving systems which allows rainfall to percolate into an underlying reservoir base, where rainfall is stored and either exfiltrated to underlying subgrade, or removed by a subdrain.

The surface component of pervious paving can be:

- Porous asphalt or porous concrete, where fines are not included in the mix, providing a high void ratio that allows water to pass through. There have been problems with surface clogging of this type of pavement.
- Concrete or plastic grid pavers, where a structural load bearing matrix has large voids that are filled with a permeable material – usually gravel or soil - and which often have grass in these voids.
- Permeable unit pavers, made up of impervious concrete modular pavers with gapped joints that allow water to percolate between the pavers.

The focus of this section is on the permeable unit pavers, as they have been used with consistent success and appear more resilient to clogging than porous paving alternatives. (James *et al.*, 2003)

Application

- ❑ Suitable for low traffic areas – e.g., driveways, parking areas, storage yards, bike paths, walkways, recreational vehicle pads, service roads, fire lanes (GVSD, 1999).
- ❑ Can receive runoff from other areas, provided protection from sediment loads is provided (GVSD, 1999).
- ❑ Suitable for reduction in peak flows and runoff volumes, contaminant removal, groundwater recharge (GVSD, 1999).
- ❑ May be used to retrofit existing developments and redeveloping areas as well as new developments (GVSD, 1999).

Photo Credit: Lanarc Consultants Ltd.



Plastic grid pavers in parking, White Rock Operations Centre.

Photo Credit: Lanarc Consultants Ltd.



Plastic grid paver detail

Limitations

- ❑ A greater design and construction control effort is required when compared with impermeable pavements (Smith, 2001).
- ❑ Minimum depth from base of drain rock reservoir to water table or solid bedrock 610 mm (Smith, 2001).
- ❑ The pavement should be downslope from building foundations, and the foundations should have piped drainage at the footing (Smith, 2001).
- ❑ At least 30m should be maintained between permeable pavements and water supply wells (Smith, 2001).
- ❑ Total catchment area draining onto the permeable pavement is not greater than 2 ha (Smith, 2001).
- ❑ To avoid surface plugging, it is critical to protect this BMP from sedimentation both during and after construction. In addition, identify pollutant sources, particularly in industrial/commercial hotspots, that require pre-treatment or source control upstream of this BMP (Maryland Dept. Environmental Resource Programs, 2001).
- ❑ For designs which rely on full exfiltration from the reservoir into underlying soils, the infiltration rate of underlying soil should be 12.5 mm/hr. minimum (Smith, 2001), or as determined by detailed geotechnical engineering.
- ❑ Types of permeable interlocking concrete pavements that have wide joints (some manufacturers) should not be used for disabled persons parking stalls or pedestrian ramps at street crossings (Smith, 2001).

Photo Credit: Lanarc Consultants Ltd.



Permeable unit paving streetside parking in the Netherlands.

Design Guidelines for Permeable Interlocking Concrete Paving

Pervious pavement designs may be one of three types (Smith, 2001):

- Full Infiltration – where all inflow is intended to infiltrate into the underlying subsoil (See Drawing 4A).
- Partial Infiltration – designed so that some water may infiltrate into the underlying soil while the remainder is drained by perforated pipes (See Drawing 4B).
- Partial Infiltration with Flow Restrictor – designed with a perforated pipe and flow restrictor located at the bottom of the drain rock reservoir. A small orifice in the flow restrictor allows the gradual decanting of water above the perforated pipe, with infiltration occurring as much as possible. These systems are essentially underground detention systems, and are used in cases where the underlying soil has low permeability or there is high water table (See Drawing 4C).

Photo Credit: Lanarc Consultants Ltd.



Pervious paving reservoir base.

Design Guidelines for all three types include the following:

1. Soil subgrade sampling and analysis should be provided by a professional engineer knowledgeable in the local soils. Testing of soil cores taken at the proposed area to be paved should include soil texture classification, sampled moisture content, 96 hour soaked California Bearing Ratio (CBR) with a target of at least 5% for light vehicular traffic, 15% for heavy vehicles, and on-site infiltration tests using a Double-Ring Infiltrometer taken at the elevation of the proposed base of the reservoir.
2. Minimum recommended tested infiltration rate for a full infiltration pavement design is 12.5 mm/hr. Sites with lower rates will require partial infiltration solutions with drain pipes, and care must be taken that the subbase will remain stable while saturated. (Smith, 2001)
3. Where it is proposed to drain impermeable surfaces onto pervious pavement surfaces, it is recommended that a maximum ratio of 2:1 impermeable to permeable is used (Formpave, 2003). This may vary by rainfall and soil characteristics as determined by modelling.
4. Permeable Unit Pavers should be selected and designed based on a manufacturer's tests that the installed unit paving system can maintain a minimum 28mm/hr infiltration rate over the pavement life (usually 20 years). This rate includes a factor of safety of 10 – the initial infiltration rate should be >280mm/hr (Smith, 2001).

5. Permeable unit pavers are usually 80mm depth. Provide edge restraint to contain the pavers, similar to standard unit paving. Edgers that use spikes are not recommended (Smith 2001).
6. Permeable unit paving surface slope should be 1% minimum to avoid ponding on the surface, and related settlement of clay sized particles (Smith, 2001).
7. Provision of vegetated joints, and overhanging trees which drop needles onto the pavement have, in research studies, helped to maintain high infiltration capabilities of pervious unit paving (James *et al.*, 2003). Vegetated joints are not suitable in heavily shaded areas such as under long-term parking.
8. Paver bedding material shall be wrapped with geotextile filter cloth on bottom and all sides. This is critical to the water quality performance of the pavement, and also keeps any intrusion of fines near the surface, where localized clogging could be repaired by replacing only the aggregate above the filter cloth and patching the cloth, reusing the pavers.
9. Bottom of reservoir: flat in full infiltration designs, minimum 0.1% slope to drain in piped systems (Formpave, 2003).
10. If the pavement is being designed for heavy loads, optional reinforcing grids may be included in the pavement subbase.
11. With infiltration designs, the bottom and sides of all reservoir base and subbase courses shall be contained by a geotextile filter cloth. Geotextile shall be adhered to the drains (Formpave 2003).
12. Design reservoir water levels and stormwater detention using a continuous modelling program. Drawdown time for the reservoir: 96 hours maximum, 72 hours desirable.
13. If the design is for partial infiltration with a flow restrictor assembly, size the orifice for a design flow that meets local requirements or replicates base flow from the drainage area.
14. Provide a secondary overflow inlet and inspection chamber (catch basin or manhole) at the flow control assembly. If no secondary overflow inlet is installed, provide a non-erodible outlet or spillway to the major storm flow path. (Smith, 2001).
15. Underground weirs of undisturbed native material or constructed ditch blocks shall be provided to create underground pooling in the reservoir sufficient for infiltration performance.

16. Avoid utility or other crossings of the pervious pavement area. Where utility trenches must be constructed crossing below the reservoir, install trench dams at exits to avoid infiltration water following the utility trench.

Guideline Specifications


Materials shall meet Master Municipal Construction Document 2000 requirements, and:

1. Pavers: Permeable Interlocking Concrete Pavers meeting CSA A231.2, designed and tested by the manufacturer for use as part of a permeable unit paving system with a initial infiltration rate $>280\text{mm/hr.}$ and a maintained $>28\text{mm/hr}$ infiltration rate over the pavement life (usually 20 years) (Smith, 2001).
2. Paver bedding course (50mm thick) and joint filling material shall be open-graded crush 5mm aggregate (or ASTM No.8 - no sand). A surface finish of 3mm clean crush aggregate (or ASTM No 89) should be applied to the finish surface and brushed in (Formpave, 2003; Smith, 2001).
3. Reservoir Base course shall be clean crushed stone graded from 5mm to 20mm (approximately 100mm deep or greater – varies with design) (Formpave, 2003). In cases where this finer base is not required for water quality treatment, the Reservoir Base may be the same material as the Reservoir Subbase.
4. Reservoir Subbase shall be clean crushed stone graded from 10mm to 63mm, with void space ratio $>35\%$ (or ASTM No. 57 – approximately 250mm deep or greater – varies with design) (Formpave, 2003; Smith 2001).
5. Pipe: PVC, DR 35, 150 mm min. diameter, with cleanouts. Practical depth of cover over the pipe may be a determinant in depth of base courses.
6. Geosynthetics: as per Section 02498, select for filter criteria or from approved local government product lists.

Construction Practices shall meet Master Municipal Construction Document 2000 requirements, and:


1. Isolate the permeable paving site from sedimentation during construction, either by use of effective erosion and sediment control measures upstream, or by delaying the excavation of 300mm of material over the final subgrade of the pavement until after all sediment-producing construction in the drainage area has been completed (Maryland Dept. Environmental Resource Program, 2001).
2. The subgrade should be compacted to 95% standard proctor for walk/bike areas, and 95% modified proctor for vehicular areas. Remove and replace soft areas (Smith, 2001).
3. Prevent natural or fill soils from intermixing with the reservoir base, sub-base, or bedding courses and filter cloths. All contaminated stone aggregate and cloth must be removed and replaced (Smith, 2001).
4. Reservoir drain rock sub base and base courses shall be installed in 100 to 150mm lifts and compacted with at least 4 passes with a minimum 9 T steel drum roller (Smith, 2001).
5. When all base courses are compacted the surface should be topped with filter cloth and a layer of bedding aggregate, and the surface graded carefully to final slopes, as the bedding aggregate will compact down much less than sand. Unit pavers shall be placed tightly butt jointed according to manufacturers specifications. Blocks should be vibrated with a vibrating plated compactor. Following a first pass, a light dressing of 3mm single size clean stone should be applied to the surface and brushed in, approximately 2 kg/m². Blocks should again be vibrated and any debris brushed off (Formpave, 2003).
6. For maintenance, the surface should be brushed at least twice a year with a mechanical suction brush (vacuum sweeper) – in the spring and in autumn after leaf fall (Formpave, 2003).

Photo Credit: Lanarc Consultants



Pervious unit paving with aggregate joints at bike rack.

- | | |
|---|--|
| ① PERMEABLE PAVERS (MIN. 80mm THICKNESS) | ⑥ GEOTEXTILE ON ALL SIDES OF RESERVOIR |
| ② AGGREGATE BEDDING COURSE -NOT SAND (50mm DEPTH) | ⑦ OPTIONAL REINFORCING GRID FOR HEAVY LOADS |
| ③ OPEN GRADED BASE (DEPTH VARIES BY DESIGN APPLICATION) | ⑧ OVERFLOW INLET AT CATCH BASIN |
| ④ OPEN GRADED SUB-BASE (DEPTH VARIES BY DESIGN APPLICATION) | ⑨ OUTLET PIPE TO STORM DRAIN OR SWALE SYSTEM.
LOCATE CROWN OF PIPE BELOW OPEN GRADED BASE (NO. 3) TO PREVENT HEAVING DURING FREEZE/THAW CYCLE |
| ⑤ SUBSOIL - FLAT AND SCARIFIED IN INFILTRATION DESIGNS | ⑩ TRENCH DAMS AT ALL UTILITY CROSSINGS |




4 A **PERVIOUS PAVING - FULL INFILTRATION**

Not To Scale

Section


- | | |
|--|--|
| <ul style="list-style-type: none"> ① PERMEABLE PAVERS (MIN. 80mm THICKNESS) ② AGGREGATE BEDDING COURSE -NOT SAND (50mm DEPTH) ③ OPEN GRADED BASE (DEPTH VARIES BY DESIGN APPLICATION) ④ OPEN GRADED SUB-BASE (DEPTH VARIES BY DESIGN APPLICATION) ⑤ SUBSOIL - FLAT AND SCARIFIED IN INFILTRATION DESIGNS ⑥ GEOTEXTILE ON ALL SIDES OF RESERVOIR ⑦ OPTIONAL REINFORCING GRID FOR HEAVY LOADS | <ul style="list-style-type: none"> ⑧ PERFORATED DRAIN PIPE 150mm DIA MIN. ⑨ GEOTEXTILE ADHERED TO DRAIN AT OPENING ⑩ OVERFLOW INLET AT CATCH BASIN ⑪ OUTLET PIPE TO STORM DRAIN OR SWALE SYSTEM. LOCATE CROWN OF PIPE BELOW OPEN GRADED BASE (NO. 3) TO PREVENT HEAVING DURING FREEZE/THAW CYCLE ⑫ TRENCH DAMS AT ALL UTILITY CROSSINGS |
|--|--|



4 B PERVIOUS PAVING - PARTIAL INFILTRATION Not To Scale

Section

- | | |
|---|---|
| ① PERMEABLE PAVERS (MIN. 80mm THICKNESS) | ⑧ PERFORATED DRAIN PIPE 150mm DIA MIN. |
| ② AGGREGATE BEDDING COURSE -NOT SAND (50mm DEPTH) | ⑨ GEOTEXTILE ADHERED TO DRAIN AT OPENING |
| ③ OPEN GRADED BASE (DEPTH VARIES BY DESIGN APPLICATION) | ⑩ FLOW RESTRICTOR ASSEMBLY |
| ④ OPEN GRADED SUB-BASE (DEPTH VARIES BY DESIGN APPLICATION) | ⑪ OVERFLOW INLET AT CATCH BASIN |
| ⑤ SUBSOIL - FLAT AND SCARIFIED IN INFILTRATION DESIGNS | ⑫ OUTLET PIPE TO STORM DRAIN OR SWALE SYSTEM. LOCATE CROWN OF PIPE BELOW OPEN GRADED BASE (NO. 3) TO PREVENT HEAVING DURING FREEZE/THAW CYCLE |
| ⑥ GEOTEXTILE ON ALL SIDES OF RESERVOIR | ⑬ TRENCH DAMS AT ALL UTILITY CROSSINGS |
| ⑦ OPTIONAL REINFORCING GRID FOR HEAVY LOADS | |



4 C PERVIOUS PAVING - PARTIAL INFILTRATION WITH FLOW RESTRICTOR Not To Scale

Section

This page is intentionally left blank.

Green Roof

Description

A green roof is a conventional roof with a veneer of drainage and growing media that supports living vegetation.

Green roofs with a relatively shallow growing medium thickness are generally called 'Extensive Green Roofs'. These are often designed for stormwater, insulation and climate amelioration functions, and usually have no public access. Vegetation is selected for its ability to withstand harsh conditions and its ability to maintain itself over the long-term.

'Intensive Green Roofs' are usually designed with public access and use in mind, and have deeper growing medium depths to support larger plants and trees. Intensive green roofs also have stormwater benefits, but are heavier and more expensive to develop, and therefore less affordable for the large flat roof expanses that are common in industrial/commercial developments.

This section is focused on the stormwater aspects of Extensive Green Roofs.

Applications

- ❑ Suitable for many rooftop situations – industrial and warehousing, commercial buildings, municipal office complexes, hospitals, schools, institutional/administrative buildings and offices, residential developments and garages.
- ❑ Suitable for flat roofs and, with proper design, roofs of 20° slope or more (Peck & Kuhn, 2001). These may be inverted or traditional roofing systems. Shingle and tile roofs are not suitable for greening (Forschungsgesellschaft Landschaftsentwicklung Landschaftsbau e.V (FLL), 2002).

Photo Credit: Goya Ngan



Extensive green roof – Halle Zoo, Germany

Photo Credit: Lanarc Consultants



Extensive green roof – Amsterdam

- ❑ Green roofs provide multiple benefits, including:
 - Reduction in stormwater peak flows.
 - Reduction in rainfall volume leaving the roof due to evaporation and evapo-transpiration. A typical extensive green roof of about 75mm in growing media can be designed to reduce annual runoff by more than 50% (Miller, 2001b; FLL, 2002).
 - Mitigation of the urban heat island effect, which is raising the temperatures of cities and increasing energy use as well as increasing the effects of air pollution (Peck & Kuhn, 2001).
 - Air filtration, removing fine particulates from the air (Peck & Kuhn, 2001).
 - Reduction in heat gain and the need for air conditioning in the summer – modeled savings are as high as 25% (Peck & Kuhn, 2001).
 - Reducing heat loss in the winter; studies show that with 30 cm of growing medium, roof temperatures do not drop below 0°C even when outside temperatures are -20°C (Peck & Kuhn, 2001).
 - Roof membrane protection and life extension. European studies have revealed that green roof installation can double the life span of a conventional roof, by helping to protect the membrane from extreme temperature fluctuations, ultraviolet radiation, and mechanical damage (Peck & Kuhn, 2001).
 - Sound insulation – tests show that 12 cm of growing medium can reduce sound by 40 db (Peck & Kuhn, 2001).
 - Increasing biodiversity in urban areas by providing habitat for birds, insects, native plants, and rare or endangered species.
 - Aesthetic value and increased urban green space.

Limitations

- ❑ Green roofs must be designed with an awareness of the loading of the roof on the underlying structure. However, use of lightweight growing media has created solutions where saturated growing media can be installed without structural upgrading beyond the standard requirements, especially in concrete buildings or new construction. (Peck & Kuhn, 2001).
- ❑ Canada does not have official green roof standards. Until such standards are published, the German FLL guidelines and test procedures represent the only comprehensive standards for green roof design, installation and maintenance. Green roofs, as extensions of the roofing system, should comply with the BC Building Code.

Extensive Green Roof Types

Extensive green roofs can be one of following designs:

- Multiple layer construction (Drawing 5A and 5B) - consists of either: i) a three-layer system including separate drainage course, filter layer and growing medium or; ii) a two layer system where the growing medium is sized to not require a filter between it and the underlying drainage layer. Extensive Green Roof may be installed over either a conventional or an inverted roof system.
- Single layer construction (Drawing 5B) - consists of a growing medium which includes the filter and drainage functions.

Design Guidelines

1. Start the design of the green roof at the same time as the design of the building or retrofit project, so that the structural load of the green roof can be balanced with the structural design of the building. From the outset, involve all design disciplines – structural, mechanical and electrical engineers, architects and landscape architects – and include roofing design professionals in a collaborative and optimization effort (Oberlander *et al.*, 2002).
2. Provide construction and maintenance access to extensive green roofs. Access through a 'man door' is preferable to access through a small roof hatch (Peck & Kuhn, 2001). Provide areas of storage for maintenance equipment. Review Workers Compensation Board requirements for safety of maintenance workers – can gardeners working near the edge of the roof use the same harness fastenings as window washers? (Oberlander *et al.*, 2002) Provide a

hose bib for manual watering during establishment if no automatic irrigation system is planned.

3. Roofs with less than 2% slope require special drainage construction so that no part of the growing medium is continuously saturated. As the slope increases, so does the rate of rainfall leaving the roof. This can be compensated for by using a medium with high water storage capacity. Roofs with over 20° require special precautions against sliding and shearing (FLL, 2002). If inverted roof systems are used with exterior insulation, good drainage needs to be provided to prevent continuous saturation of the insulation, and subsequent damage (Peck & Kuhn, 2001). With inverted roofs, the green roof components must allow moisture to move upwards from the insulation and to eventually evaporate (Krupka, 1992).
4. Provide plant free zones to facilitate access for inspections and maintenance and prevent plants from spreading moisture onto exposed structural components. They can also function as a measure against fire and wind-uplift. They should be at least 50 cm wide and located along the perimeter, all adjacent facades and covered expansion joints, and around each roof penetration.
5. Fire breaks of non-combustible material, such as gravel or concrete pavers, 50 cm wide, should be located every 40 m in all directions, and at all roof perimeter and roof penetrations (FLL, 2002). Other fire control options include use of sedums or other succulent plants that have a high water content, or a sprinkler irrigation system connected to the fire alarm (Peck & Kuhn, 2001).
6. There are several choices of waterproof membranes. Thermoplastic membranes, such as PVC (polyvinyl chloride) or TPO (thermal polyolefin) using hot air fusion methods are commonly used for green roof applications. Elastomeric membranes like EPDM (ethylene-propylene rubber materials) have high tensile strength and are well-suited to large roof surfaces with fewer roof penetrations. Modified bitumen sheets are usually applied in two layers and are commonly available. Liquid-applied membranes are generally applied in two liquid layers with reinforcement in between. The quality is variable. A factor in choosing a waterproofing system is resistance to root penetration (see point 7 below).
7. Provide protection against root penetration of the waterproof membrane by either adding a root barrier or using a membrane that is itself resistant to root penetration

Photo Credit: Lanarc Consultants Ltd.



Newly planted extensive green roof showing plant-free zones at drain and edges – White Rock Operations Building

(more cost efficient). Resistance to root penetration is not being tested in Canada at time of writing¹. Thermoplastic and elastomeric membranes in suitable thicknesses are usually resistant to root penetration. Roofing membranes, existing or new, which contain bitumen or other organic materials are susceptible to root penetration and micro-organic activity. These types of roofing membranes need to be separated from the growing medium by a continuous root barrier unless they contain an adequate root repelling chemical or copper foil (Ngan, 2003).

8. Chemically incompatible materials such as bitumen and PVC require a separation layer (FLL, 2002).
9. When the roofing membrane installation is complete, but prior to installing layers above the waterproof membrane, it should be tested by flooding and thorough inspection. Any leaks should be repaired prior to installing materials above the membrane (Ngan, 2003).
10. Install a protection layer to protect the waterproof membrane/root barrier from physical damage caused by construction activities, sharp drainage materials such as lava rock or broken expanded clay, and subsequent levels of stress placed on the roof (Ngan, 2003).
11. The drainage layer may be drain rock, but is often a lightweight composite such as lava, expanded clay pellets, expanded slate or crushed brick. If weight is a concern, rigid plastic materials that allow rapid lateral drainage may be used. The drainage layer may also function to store water and make it available to the vegetation during dry periods. The top of the drainage layer is normally separated from the growing medium by non-woven filter cloth.

¹ Check with the manufacturer to determine if the membrane is resistant to root penetration according to the German FLL Root Penetration Test, 2002.

Table 5-1: Weights of Common Building Materials
(Oberlander *et al.*, 2002: 26)

Material	Kg/m ³
Light weight concrete	1298-1622
Precast concrete	2108
Reinforced concrete	2433
Gravel	1946
Timber – hardwood (av.)	730
Timber – softwood (av.)	568
Sand (dry)	1460-1784
Sand (wet)	1784-2108
Water	1013
Light-weight growing medium (moist condition)	884-1121

12. Light weight growing medium is often a combination of pumice, lava rock, expanded clay or other lightweight absorbent filler, with a small amount of organic matter. The FLL recommends between 6 and 8% organic matter. When properly sized (see Figure 11), a mineral-based growing medium is able to retain stormwater as effectively as soil high in organic matter without the disadvantage of compacting and breaking down over time. For additional detailed information on the properties of green roof growing media, refer to the FLL guidelines(2002):




Figure 5-1: Particle (grain) size distribution range for substrates used in multiple layer extensive green roofs (FLL, 1995: 34)

13. In calculating structural loads, always design for the saturated weight of each material (Oberlander *et al.*, 2002). See Table 5-1 for weights of common building materials.

14. Light weight growing medium can be subject to wind erosion when dry. If planting is delayed through a dry weather season, provide a wind erosion control blanket over the growing medium.
15. Plant choices for extensive green roofs are limited to plants that can withstand the extremes of temperature, wind, and moisture condition on a roof. Typically, extensive green roofs use a variety of mosses, sedums, sempervivums, alliums, other bulbs and herbs, and grasses.
16. Avoid specifying or allowing volunteer plant materials with aggressive root systems (e.g. bamboo, couch grass, tree seedlings). Supply and install growing medium that is free of weeds (Ngan, 2003).
17. Design planting to respect microclimate and sun/aspect conditions. Collaborate with mechanical engineers on placement of exhaust vents, and design plantings accordingly (Oberlander *et al.*, 2002).
18. Avoid swaths of one species. The chances of creating a self-maintaining plant community are increased when a wide mix of species is used.
19. Planting methods include seeding, hydroseeding, spreading of sedum sprigs, planting of plugs or container plants, and installing pre-cultivated vegetation mats.
20. If automatic irrigation is required, low volume and rainwater reuse systems are preferred.
21. Provide intensive maintenance for the first two years after the plant installation – including watering in dry periods, removal of weeds, light fertilization with slow release complete fertilizers, and replacement of dead plants. It is recommended that the maintenance contract for the first 3-5 years be awarded to the same company that installed the green roof and that the service be included in the original bid price (Peck & Kuhn, 2001). Once established, a typical extensive green should require only one or two annual visits for weeding of undesired plants, clearing of plant-free zones and inspecting of drains and the membrane.


Photo Credit: Goya Ngan




Green roof test plots - Saskatoon

22. Installers should have experience with green roof systems. It may be preferable to have one company handle the entire project from roofing to planting to avoid scheduling conflicts and damage claims (Peck & Kuhn, 2001). If it is not possible, make a clear separation between the responsibilities of the roofing contractor and those of the green roof contractor (Krupka, 1992).
23. Although green roof membranes will last longer than others, leaks can still occur at flashings or through faulty workmanship. Some companies are recommending an electronic leak detection system to pinpoint the exact location of water leaks, thus allowing easy repair (Peck & Kuhn, 2001).
24. Consider the environmental impact of each green roof material. How much energy was required to extract, manufacture and deliver the material? Is there a suitable material derived from local recycled products? What effect does the material have on water quality? How often must it be replaced? How will it be disposed of? Is it recyclable?
25. Several companies provide the GVRD with complete green roof service, and offer a range of long-term guarantees on the entire assembly. This type of comprehensive installation may be more expensive than comparable 'off the shelf' products not specifically designed for green roof use. The decision on risk management is with the owner (Peck & Kuhn, 2001).

- | | |
|---|-----------------------|
| ① WALL CAP FLASHING | ⑨ THERMAL INSULATION |
| ② DRAIN ROCK, PAVING SLAB, OR OTHER BUFFER EQUIVALENT | ⑩ WATERPROOF MEMBRANE |
| ③ WOOD, STEEL OR CONCRETE CURB/EDGING (OPTIONAL) | ⑪ VAPOUR BARRIER |
| ④ PLANTING | ⑫ AREA DRAIN |
| ⑤ GROWING MEDIUM | ⑬ STRUCTURAL SLAB |
| ⑥ FILTER LAYER | ⑭ BUILDING INTERIOR |
| ⑦ DRAINAGE LAYER | ⑮ WALL FLASHING |
| ⑧ PROTECTION LAYER AND ROOT BARRIER | |



NOTE: UNLESS THE WATERPROOF MEMBRANE IS RESISTANT TO ROOT PENETRATION, A ROOT BARRIER IS REQUIRED BETWEEN THE PROTECTION LAYER AND WATERPROOF MEMBRANE. A SEPARATION LAYER MAY BE REQUIRED BETWEEN CHEMICALLY INCOMPATIBLE MATERIALS.




MULTIPLE LAYER EXTENSIVE GREEN ROOF


Not To Scale

Section

- | | |
|---|-----------------------|
| ① WALL CAP FLASHING | ⑨ WATERPROOF MEMBRANE |
| ② DRAIN ROCK, PAVING SLAB, OR OTHER BUFFER EQUIVALENT | ⑩ THERMAL INSULATION |
| ③ WOOD, STEEL OR CONCRETE CURB/EDGING (OPTIONAL) | ⑪ VAPOUR BARRIER |
| ④ PLANTING | ⑫ AREA DRAIN |
| ⑤ GROWING MEDIUM | ⑬ STRUCTURAL SLAB |
| ⑥ FILTER LAYER | ⑭ BUILDING INTERIOR |
| ⑦ DRAINAGE LAYER | ⑮ WALL FLASHING |
| ⑧ PROTECTION LAYER AND ROOT BARRIER | |




NOTE: UNLESS THE WATERPROOF MEMBRANE IS RESISTANT TO ROOT PENETRATION, A ROOT BARRIER IS REQUIRED BETWEEN THE PROTECTION LAYER AND WATERPROOF MEMBRANE. A SEPARATION LAYER MAY BE REQUIRED BETWEEN CHEMICALLY INCOMPATIBLE MATERIALS.



MULTIPLE LAYER EXTENSIVE GREEN INVERTED ROOF

Not To Scale

Section



- | | |
|---|----------------------|
| ① PLANTING | ⑤ THERMAL INSULATION |
| ② GROWING MEDIUM (SPECIAL COARSE COMPOSITION) | ⑥ VAPOUR BARRIER |
| ③ PROTECTION LAYER | ⑦ STRUCTURAL SLAB |
| ④ WATERPROOF MEMBRANE | |

5
C

SINGLE LAYER EXTENSIVE GREEN ROOF

Not To Scale Section

This page is intentionally left blank.

Infiltration Trench & Soakaway Manhole

Description

An **Infiltration Trench** System includes an inlet pipe or water source, catch basin sump, perforated distribution pipe, infiltration trench and overflow to the storm drainage system. Although commonly in a linear trench shape, the same principles apply to underground drain rock infiltration devices of any shape (See Drawing 6D).

An **Soakaway Manhole** System includes an inlet pipe, a sedimentation manhole, and one or more Soakaway Manholes with connecting pipes (See Drawings 6A, 6B, 6C).

Other common terms used are *Infiltration Sump*, *Dry Well*, or *Infiltration Shaft*.

Application

- ❑ Infiltration Trenches are often used to allow roof runoff to soak away into the ground. With water quality pre-treatment, they can be used for infiltration of other surface waters. Although ideally located under surface soils that will allow some evaporation, there are applications where an infiltration trench can be installed under pavement, provided that structural design of pavement is appropriate.
- ❑ Provision of underground overflow allows use of the technique in most soils, including clay with infiltration rates as low as 0.6mm/hr.
- ❑ Suitable for clean, unpolluted runoff from many development situations – residential areas, municipal office complexes, rooftop runoff, parks and greenspace, golf courses (Stephens *et al.*, 2002). Not suited for parking and heavy traffic roadway runoff unless there has been water quality pre-treatment to remove hydrocarbons and heavy metals.

Limitations

Use of Infiltration Trench or Soakaway Manhole will be limited by hydro-geotechnical conditions in much of GVRD.

- ❑ To avoid groundwater pollution, do not direct un-treated polluted runoff to Infiltration Trench or Soakaway Manhole:
 - Direct clean runoff (roof, non-automobile paving) to Infiltration Trench or Soakaway Manhole.

Photo Credit: Lanarc Consultants Ltd.



Perforated pipe over drain rock reservoir at infiltration trench under construction in Maple Ridge.

Photo Credit: Lanarc Consultants Ltd.



Same infiltration trench as above, before backfill, showing filter cloth wrap, and showing trench dam of native material between infiltration trench 'cells'.

Photo Credit: Lanarc Consultants Ltd.



Infiltration facilities near urban structures should only be installed in neighbourhoods that have footing drains or other methods to protect basements from flooding.

- For polluted runoff (roads > 1000 vehicles / day, parking areas, other pollution sources), provide upstream source control for pollutant reduction prior to release to Infiltration Trench or Soakaway Manhole.
- ❑ Use Infiltration Trench or Soakaway Manhole only in areas with footing drains. If steep slopes or drinking water wells exist within 200m horizontally from the proposed Infiltration Trench or Soakaway Manhole, provide a hydro-geotechnical report to analyze site-specific risks and determine setbacks. Guidelines for setbacks to steep slopes are 60m from the tops of slopes more than 3m high and steeper than 2h:1v. Setbacks to drinking water wells should at least equal the BC Ministry of Health setback from well to septic field (30.5 m at time of writing).
- ❑ Minimum depth from base of drain rock reservoir to water table 600 mm.
- ❑ Identify pollutant sources, particularly in industrial/commercial hotspots, that require pre-treatment or source control upstream of this BMP. (Maryland Dept. Environmental Resources Program, 2000).
- ❑ Design should provide for drain rock reservoir to drain in 96 hours to allow aerobic conditions for water quality.

Design Guidelines

Infiltration Trench System:

1. Locate Infiltration Trench at least 3m from any building, 1.5m from property lines, and 6m from adjacent infiltration facilities (or as recommended by a geotechnical engineer).
2. If any surface water is to enter the system, provide pre-treatment erosion control to avoid sedimentation in the Infiltration Trench. Provide non-erodable material and sediment cleanout basins at point-source inlets (Maryland Dept. Environmental Resource Programs, 2001).
3. Provide vegetated erosion control along any surface water conveyance swales (e.g. between rain water leader and sump inlet). Swale planting is typically sodded lawn. Low volume swales can be finished with a combination of grasses, shrub, groundcover and tree planting to provide a 100% vegetated cover within 2 years of planting.
4. Sump: Concrete, plastic, or other non-degradable box with strength suitable to withstand surface loads. Provide a lid for periodic inspection and cleanout. Include a T-inlet pipe to trap oils, sediments and debris. Provide weep holes to dewater the sump, for mosquito management.

5. Infiltration Trench: installation of perforated distribution pipe and bottom of drainrock to be level. If more than one section of infiltration trench is required, design so that underground water is temporarily 'ponded' in each infiltration section, using underground weirs of undisturbed native material or constructed ditch blocks designed to create underground pooling in the reservoir sufficient for infiltration performance.
6. Infiltration Trench bottom width - 600mm minimum, 2400mm maximum.
7. Install the Infiltration Trench in native ground, and avoid over-compaction of the trench sides and bottom, which reduces infiltration.
8. Observation well for each Infiltration Trench (optional): vertical standpipe, with perforated sides, and locking lid, to allow the monitoring of water depth.
9. Size the Infiltration Trench or Soakaway Manhole system by continuous flow modelling. For single family areas, check with local governments to see if there are sizing guidelines for your watershed or neighbourhood.
10. A non-erodible outlet or spillway must be established to discharge overflow (Maryland Dept. Environmental Resource Programs, 2001).
11. Avoid utility or other crossings of the Infiltration Trench. Where utility trenches must be constructed crossing below the Infiltration Trench, install trench dams to avoid infiltration water following the utility trench.

Photo Credit: Lanarc Consultants Ltd.



Infiltration trench can be in any plan shape – the photo shows a rectangular 'soakaway' under construction at a single family subdivision in BC.

Soakaway Manhole System:

1. Provide a report from a geotechnical engineer including on-site test data of infiltration rates at the depth of the proposed infiltration. The bottom of the Soakaway Manhole shall be at least 600mm above the seasonal high water table or bedrock, or as recommended by the engineer.
2. Provide a sedimentation manhole, and a maximum of two Soakaway Manholes in series, unless otherwise approved. Minimum distance between Soakaway Manholes shall be 8m.
3. Provide an overflow from Soakaway Manhole to the storm drainage system or major storm flow path.
4. Size the Soakaway Manhole system by continuous flow modelling.

Guideline Specifications

Materials shall meet Master Municipal Construction Document 2000 requirements, and:

1. Infiltration Drain Rock: clean round stone or crushed rock, 75mm max, 38mm min, 40% porosity (Maryland Dept. Environmental Resource Programs, 2001).
2. Pipe: PVC, DR 35, 100 mm min. dia. with cleanouts.
3. Geosynthetics: as per Section 02498, select for filter criteria or from approved local government product lists.
4. Sand: Pit Run Sand as per Section 02226.
5. Growing Medium over trench: As per Section 02921 Topsoil and Finish Grading, Table 2.
6. Seeding: to Section 02933 Seeding or 02934 Hydraulic Seeding (note – sodding will be required for erosion control in most swales, subject to the erosion control professionals decision).
7. Sodding: to Section 02938 Sodding.
8. All precast sections shall conform to the requirements of ASTM C 478.
9. Invert shall be level and smooth.
10. Soakaway Manhole barrel shall not be perforated within 1200mm of the cone.


Construction Practices shall meet Master Municipal Construction Document 2000 requirements, and:

1. Isolate the infiltration site from sedimentation during construction, either by use of effective erosion and sediment control measures upstream, or by delaying the excavation of 300mm of material over the final subgrade until after all sediment-producing construction in the drainage area has been completed (Maryland Dept. Environmental Resource Programs, 2001).
2. Prevent natural or fill soils from intermixing with the Infiltration Drain Rock. All contaminated stone aggregate must be removed and replaced (Maryland Dept. Environmental Resource Programs, 2001).
3. Infiltration Drain Rock shall be installed in 300mm lifts and compacted to eliminate voids between the geotextile and surrounding soils (Maryland Dept. Environmental Resource Programs, 2001).
4. Provide a min. of 150mm of 25mm or 19mm clean crushed rock under all pipes.

Photo Credit: Lanarc Consultants Ltd.



Infiltration trench with catch basin inlet at Silver Maples Subdivision in Maple Ridge, prior to surface cover with filter cloth and growing medium.





6 SEDIMENTATION MANHOLE AND SOAKAWAY MANHOLES

A Not To Scale

Section


NOTES:
ALL PRECAST SECTIONS SHALL CONFORM TO THE REQUIREMENTS OF ASTM C 478.
PROVIDE A MIN. OF 150mm OF 25mm OR 19mm CLEAN CRUSHED ROCK UNDER ALL PIPES.
INVERT SHALL BE LEVEL AND SMOOTH.
SUMP BARREL SHALL NOT BE PERFORATED WITHIN 1200mm OF THE CONE.



6 SOAKAWAY MANHOLE

B Not To Scale

Section




6 SEDIMENTATION MANHOLE

C Not To Scale

Section

- 1 PVC SOLID PIPE C/W INLET TEE
- 2 INTERCONNECTING PVC SOLID PIPE
- 3 STANDARD MANHOLE FRAME AND COVER
- 4 FINISH GRADE
- 5 SEAL JOINTS WITH CEMENT GROUT OR APPROVED MASTIC
- 6 STREET INLET CONNECTION
- 7 LADDER RUNG
- 8 25mm CRUSH GRAVEL OR DRAIN ROCK BASE
- 9 NATIVE SOIL BACK FILL
- 10 UNDISTURBED GROUND
- 11 GEOTEXTILE BETWEEN DRAIN ROCK AND NATIVE SOIL
- 12 50mm DRAIN ROCK
- 13 1200mm PERFORATED BARREL (LANGLEY CONCRETE OR EQUAL)
- 14 OVERFLOW TO STORM DRAINAGE SYSTEM

- | | |
|--|---|
| ① GRASS OR OTHER PLANTING | ⑪ 100mm DIA PVC SOLID PIPE C/W INLET TEE |
| ② FINISH GRADE | ⑫ OBSERVATION WELL (OPTIONAL) |
| ③ GROWING MEDIUM BACKFILL | ⑬ INVERT TO TOP OF INFILTRATION PIPE (APPROX.) |
| ④ 100mm DIA PVC DR28 PERFORATED PIPE | ⑭ 100mm DIA PVC SOLID PIPE |
| ⑤ LIGHT NON-WOVEN GEOTEXTILE C/W MIN. 400mm LAPS | ⑮ DISCHARGE TO STORM DRAINAGE SYSTEM. ENSURE DRAINAGE DOES NOT IMPACT NEIGHBOURING USES. DIRECT DISCHARGE TO ROAD RIGHT-OF-WAY IF NECESSARY |
| ⑥ 50mm DRAIN ROCK OR ROCK OF EQUAL POROSITY | ⑯ INFILTRATION TRENCH WITH LEVEL BOTTOM |
| ⑦ MAXIMUM GROUNDWATER ELEVATION | ⑰ CATCH BASIN |
| ⑧ NON-POLLUTED DRAINAGE FROM BUILDING OR TERRACE | ⑱ BUILDING FOOTING DRAIN (NOT CONNECTED TO INFILTRATION FACILITY) |
| ⑨ ALTERNATE SURFACE ROUTE - WITH SPLASH PAD AND VEGETATED SWALE TO CB | ⑲ BUILDING |
| ⑩ CB LID / ACCESS HATCH FOR CLEANOUT, INSPECTION AND INFLOW / OVERFLOW FROM SUMP | ⑳ 50mm DIA MIN. DRAIN HOLE |



6 INFILTRATION TRENCH

Not To Scale

Section

**DESIGN, CONSTRUCTION
AND MAINTENANCE
PROCESS**
For Stormwater Source
Controls

The Stormwater Source Control Design Process

Just as rainfall hits all areas of a development site, the design of stormwater source controls should be integrated with the entire development concept. This chapter outlines a design process for stormwater source control practices - identifying key steps and their arrangement in a typical development process.

Table F1: Stormwater Source Control Design Process

Design Stage	Objective
Design Targets <i>for stormwater source controls</i>	Identify the senior and local government requirements for stormwater source control, and the related design targets or criteria.
Site Analysis <i>for stormwater source controls</i>	Gather critical data: rainfall patterns, existing vegetation cover, infiltration constraints, soils mapping and infiltration tests.
Development Concepts <i>that integrate stormwater source controls</i>	Integrate stormwater source controls into the development concept: what mix and sizing of techniques fit with the site and the land use?. Develop Stormwater Management Plan Concept.
Detail Design <i>of stormwater source controls</i>	Design and size source controls. Create technical details in plan, cross section and profile. Incorporate stormwater source controls in construction and maintenance specs.
Construction Staging <i>of stormwater source controls</i>	Schedule the installation of stormwater source controls to avoid problems with disturbance and sedimentation during construction.
Field Review & Monitoring <i>of stormwater source controls</i>	Provide critical field inspections to ensure performance. Use post-construction monitoring and adaptive management to reduce costs.

Do include stormwater source control designers in your design team from the earliest stage of the design development. This will ensure that stormwater source controls are integrated into the development in the most cost effective way.

Don't treat stormwater source controls as a last minute, after everything else is decided, extra. This will lead to more difficult or expensive design solutions, greater land requirements, and will create significant redundancy and revisions in design effort.

The key disciplines involved in source control design are civil engineers, geotechnical engineers, and landscape architects. A team approach is encouraged to ensure that the facilities are designed properly and perform as intended, and are aesthetically pleasing and suitable for the subject community.

Design Targets for Stormwater Source Controls

Fisheries and Oceans Canada

The *Urban Stormwater Guidelines and Best Management Practices for Protection of Fish and Fish Habitat, 2001* from Fisheries and Oceans Canada (DFO) stipulates a three-fold stormwater criteria:

Table F2: DFO Stormwater Guidelines

Objective	Target
Volume Reduction	Retain the 6-month/24-hour post-development volume from impervious areas on-site and infiltrate to ground. If infiltration is not possible, the rate-of-discharge from volume reduction Best Management Practices (BMPs) will be equal to the calculated release rate of an infiltration system.
Water Quality	Collect and treat the volume of the 24-hour precipitation event equalling 90% of the total rainfall from impervious areas with suitable BMPs.
Detention or Rate Control	Reduce post-development flows (volume, shape and peak instantaneous rates) to pre-development levels for the 6-month/24-hour, 2-year/24-hour, and 5 year/24-hour precipitation events.
Notes: Flood conveyance events are not addressed in the DFO guidelines, but are stipulated by municipalities.	

Source controls address volume reduction and water quality aspects of the guidelines, and therefore should be designed to capture and hold on-site the 6-month, 24-hour post-development flow volume. An analysis of rainfall data from a number of GVRD climate stations shows that the 6-month, 24-hour event ranged from 67% to 76% of the 2-year, 24-hour event volume, with an average of 72%. This result is consistent with other regional results (Washington State, 2001) and can be used in the absence of site specific data.




Figure F1: Typical 24 Hour Rainfall Depths in the GVRD

Province of BC

The Ministry of Water, Air, and Land Protection released *Stormwater Planning: A Guidebook for British Columbia* in 2002; the stormwater guidelines are summarized as follows.

Table F3: Stormwater Criteria from Provincial Stormwater Guidebook

Objective	Target
Runoff Volume Reduction and Water Quality Control	Capture 0 to 50% of the MAR ⁽¹⁾ (90% of the rainfall volume in a typical year) at the source (building lots and streets) and infiltrate, evaporate, or reuse it.
Runoff Rate Reduction	Store 50% to 100% of MAR runoff and release at a rate that approximates the natural forested condition. Decrease the erosive impact of the large storm events.
Peak Flow Conveyance	Ensure that the drainage system is able to convey extreme storm events (up to 100-yr. return period) with only minimal damage to public and private property.
Notes:	
1. MAR is Mean Annual Rainfall Event (i.e. approximates the 2-year 24-hour storm event – refer to Guidebook)	

The selection of which criteria (DFO or Province of BC) is the decision of the designer. However, as DFO approval is often required in the GVRD, it is recommended that the DFO guidelines be applied for design of stormwater source controls.

Local Governments in GVRD

Municipalities are undertaking Integrated Stormwater Management Plans (ISMPs) on a watershed basis. The ISMPs meet community needs and allow development and re-development to occur, while preserving watershed health as a whole. ISMPs may allow for tradeoffs so that impacts in one area within a watershed can be offset by gains in other areas, thereby meeting the ISMP principle of no net loss of watershed health as a whole.

Developed ISMPs may stipulate alternate stormwater targets to the ones outlined by DFO and MWALP. For instance, this can be a result of increased targets in areas with good infiltration capability soils and decreased targets in steep slope areas with poor soils.

Site Analysis for Stormwater Source Controls

Limitations and Precautions to Implementing Source Controls

The implementation of source controls is prohibited in hazardous areas of potential slope instability. Source controls encourage infiltration that saturate soils and further reduce the stability of these hazardous slopes. Adequate setbacks from the top of these slopes should be delineated by a qualified geotechnical engineer.

As with all drainage works, source controls should be designed to ensure that facility overflows and interflows drain to the municipal minor/major drainage system or natural drainage path, and do not discharge to or through adjacent sites. Emergency overflows should be designed as a part of all source controls.

It is also important to consider the impacts of groundwater contamination and the presence and potential influences on existing water wells in the vicinity. A hydrogeologist should confirm that infiltrated water does not put groundwater resources at risk.

Rainfall Data

Rainfall data can be obtained from representative climate stations closest to the subject site. Three types of rainfall data are used in the analysis and design of source controls:

- Numerical values taken from the intensity-duration-frequency (IDF) curves to determine rainfall depth. This rainfall depth can be used in simplistic calculations to roughly determine the rainfall-runoff capture volume for the subject site.
- Hourly rainfall data for a typical year from the period of record. This is used in the hydrologic computer modelling in the sizing of source controls.
- IDF curves are also used to determine extreme flows that would occur during flood events (e.g. 10-year or 100-year events). Source controls must provide adequate overflows to accommodate large events. Flood events are quantified using the Rational Method or using design storm events in hydrologic computer modelling.

Existing Vegetation Cover on the Development Site

Trees and vegetation have been shown to intercept significant amounts of annual rainfall:

- 15% interception by leafless deciduous trees (Xiao *et al*, 2000), relative to a typical year.
- 27-28% interception by evergreen trees (Xiao *et al*, 2000) (Johnston, 1990).

In addition to their canopy interception, trees and vegetation provide significant evapo-transpiration – removing water from the soils, and thereby freeing up soil pore space to accept and store infiltrated rainwater.

Erosion control is also provided in a most effective way by surface vegetation. Leaving surface vegetation in place until development proceeds at UniverCity in Burnaby has provided 100% erosion control on individual parcels (Reid, 2004).

Initial site investigations for development projects should map the existing vegetation, and consider its role prior, during and after construction. Development strategies that have been successful in maintaining, or delaying removal of, vegetation are listed in the Vegetation Management Checklist on the facing page.

Designers should summarize, on a site analysis drawing, the opportunities and constraints presented by existing vegetation. Make this information available to all members of the design and approvals team.

Vegetation Management Checklist

- ❑ **Leave existing vegetation in place during the planning and approvals stages.** Pre-clearing vegetation results in increased costs for temporary revegetation and erosion control, at the same time as increasing runoff and sedimentation unnecessarily.
- ❑ **Clear the site in stages as development proceeds.** For instance, for larger developments, clear only road and utility corridors during each phase of subdivision, leaving the development parcels vegetated until they are sold, designed, approved and ready for construction.
- ❑ **Identify areas where vegetation can permanently remain in the development.** These may be areas of steep slope, stream riparian or wetland areas, wildlife or greenway corridors, specimen trees or other site areas with site constraints.
- ❑ **Protect the soils under vegetation to be retained during construction.** It is critical to their stormwater performance that these areas not be disturbed or compacted by equipment or storage during construction. Temporary fencing is likely required.
- ❑ **In stormwater calculations, consider the contribution that leave areas of existing vegetation and soils make to stormwater capture targets.** These areas will count as pervious area.
- ❑ **Consider the possibility for some stormwater management techniques to make use of tree leave areas for stormwater capture.** For example, parking areas may be graded toward leave areas of existing vegetation, encouraging both filtration and infiltration of surface water. Roof drainage could also be directed towards forested leave areas, provided the drainage is dispersed before entering the leave area. Only sheet flow is permitted, not concentrated flow that can be erosive and have higher concentrations of pollutants. Sheet discharge should be restricted to limited impervious areas only where the leave area is owned by the subject site owner and not the property of others. Calculations should be undertaken to ensure the leave area can “capture” the target runoff volume. Infiltration trenches or swales can encourage infiltration just uphill from leave areas, so that shallow groundwater interflow occurs through the leave area. Although root zones should not be disturbed, development schemes have included the addition of drain rock / compost / soil check dams to create vernal infiltration pools in leave areas.

Constraints to Infiltration Techniques

All sites in the GVRD can incorporate some form of stormwater source control, even though in some poor drainage soil or site conditions the choices will be limited to constructed solutions like green roof, flow through planters or infiltration techniques with flow restrictors.

The most cost and space effective techniques will be those that rely on significant infiltration into site soils. To determine if infiltration based source controls are advisable on the development site, professional geotechnical engineers and designers should identify site or neighbourhood features that may act as constraints.

The Infiltration Constraint Checklist below provides a partial list of constraints to the use of infiltration that should be mapped to determine if they would affect a site design.

Infiltration Constraint Checklist

- ❑ **Drinking Water Wells:** Infiltration should be separated from drinking water wells, against both surface water intrusion and ground water pollution. Standards for separation may vary by municipality, soil conditions, and well operation, but should, at a minimum, equate the separation required between septic fields and drinking water wells by BC Ministry of Health. At time of writing, this separation was a minimum of 30.5 m horizontally.
- ❑ **Land Uses that are Pollutant Hot Spots:** Infiltration should not be undertaken from land uses that present a high risk of groundwater pollution e.g. automobile service yards, wrecking yards, sites storing industrial chemicals or wastes, unless appropriate pretreatment is included.
- ❑ **Contaminated Soils:** Sites that have previously contaminated soils will need geotechnical analysis to determine if they can be remediated, and if they are suitable for infiltration once remediated.
- ❑ **Seasonally High Water Table:** For infiltration to be effective, the bottom of the infiltration facility should be at least 600 mm above seasonally high water table. Site test holes and mapping should be completed if areas of high water table are indicated.

- ❑ **Shallow Bedrock:** Infiltration may be constrained by shallow bedrock, or by cemented layers in soils. The infiltration facility bottom should be at least 600mm above monolithic, unfractured bedrock. Note, however, that many types of bedrock including fractured sandstone are highly pervious and suitable for infiltration. Some other types of bedrock e.g. karst limestone are excessively permeable, and infiltration directed at them may need careful pretreatment for water quality. Some cemented layers in soils are underlain by highly permeable strata, and facilities can be designed to remove pollutants from surface water and then infiltrate it to these deeper permeable soils.
- ❑ **Steep Slopes:** Existing or proposed steep slopes can be a constraint to infiltration. Designers must consider the stability of the slope, and the interaction of deep and shallow groundwater interflow on the stability of the slope. Infiltration designs within 30m of steep slopes, or that direct surface or groundwater at a steep slope area are prohibited unless reviewed and deemed acceptable by engineers with experience in geotechnical engineering.
- ❑ **Unstable Soils:** The stability of soils for foundation conditions or against mass slumping may be affected by infiltration. If expandable clays are present on a site, geotechnical advice should be sought on setbacks from infiltration facilities to foundations – 3-5m setback distances are common. Other unstable soils, such as peat or organic muck, may be affected by increased water content related to infiltration, and geotechnical advice should be sought.
- ❑ **Riparian Area or other Protected Habitat:** Infiltration techniques that require excavation are commonly restricted in areas of protected habitat. However, non-invasive techniques that provide drain/soil/compost check dams to create vernal pools, or facilities outside the protected area that allow treated runoff to distribute and slowly flow through the protected area are appropriate.

Soils Mapping and Infiltration Testing

General soils mapping for the Lower Mainland area can be found on:

- GeoMap Vancouver, Geological Map of the Vancouver Metropolitan Area, Geological Survey of Canada Open File 3511, 1998.
- 1:50,000 surficial geology mapping, Geological Survey of Canada, 1980.
- Municipalities also may have soil mapping.

These maps provide generalized information only, and are appropriate for planning level studies only. Site specific soils and infiltration information should be obtained by a geotechnical engineer at the design phase.

On-site infiltration testing at the elevation of the proposed infiltration facility is required. The BC Environment Percolation Test Requirements recommend using the double ring infiltrometer testing methodology. Infiltration rates should be reported in mm/hr.

A correction factor can be applied to the determined infiltration rate to allow for average soil variability, degree of long-term facility maintenance, and total suspended sediments reduction through pretreatment. Selection of a correction factor is based on the judgement of the designer. A factor of 2 is commonly used for infiltration; however, for facilities designed for stormwater source control (volume reduction and water quality treatment) where emergency overflows are provided, it is recommended that no correction factor be applied.

Integrated Stormwater Management Plans

Municipalities in the GVRD are active in creating Integrated Stormwater Management Plans (ISMPs). These are typically created at a watershed scale, and identify objectives and proposed techniques for flood control and fish habitat protection. Many ISMPs will create source control targets and strategies for a watershed or parts of watersheds.

Large-scale developments may also create Stormwater Management Plans that identify, in more detail, the role of stormwater source control for a development. Stormwater Management Plans may set 'rainfall capture targets' for roads and development parcels, to set out the amount of rainfall that should be captured on a development site, either by infiltration, evaporation, or re-use. Both Design Targets and ISMPs should be reviewed prior to development planning.

Development Concepts that Integrate Stormwater Source Controls

Identify Candidate Stormwater Source Controls

Every development and site combination merit a customized solution for stormwater source controls. However, Table F4 illustrates the typical relationship between source controls and site / land use combinations at the parcel or street level.

Table F4: Typical Source Control Applications

Development Type	Absorbent Landscape	Infiltration Swale	Rain Garden	Pervious Paving	Infiltration Trench or Shaft	Green Roof
Park / Open Space <i>may include parking / buildings</i>	X	X	X	X	X	X
Low Volume Road <i>with roadside landscape or medians</i>	X	X	X		X	
Surface Parking <i>on-street or off-street w/ islands</i>	X	X	X	X	X	
Single Family / Low Density <i>30 – 50% building coverage*</i>	X	X	X	X	X	X
High Density / Industrial/ Commercial/Institutional <i>50 – 90% building coverage*</i>	X	X	X	X	X	X
Ultra High Density <i>>90% building coverage*</i>						X

*In Table F4, the building coverage figures refer to the percent of building footprint covering the site. This should not be confused with % impervious area, or FSR (floor site ratio).

Stormwater Treatment Chains

Designers are encouraged to think about combinations of stormwater source controls. A 'Stormwater Treatment Chain' is a series of source controls that are arranged in series.

The diagrams in Figure F1 illustrate alternative concepts for stormwater source controls on a development parcel.

- The Treatment Chain on the left relies equally on Green Roof, Rain Gardens, and Soakaway Manhole to each capture 33% of its on-site rainfall capture target. This concept may apply to a medium density development that has a balance of rooftop and landscape area.
- The Treatment Chain on the right has Green Roof take up 60% of its rainfall capture volume, and 30% in Rain Garden, with less reliance on Soakaway Manhole. This may be necessary on a high density development with limited landscape area.

Conceptually, the diagrams show these elements in series on the site. Rainfall would move from Green Roof to Rain Garden to Soakaway Manhole to Overflow.

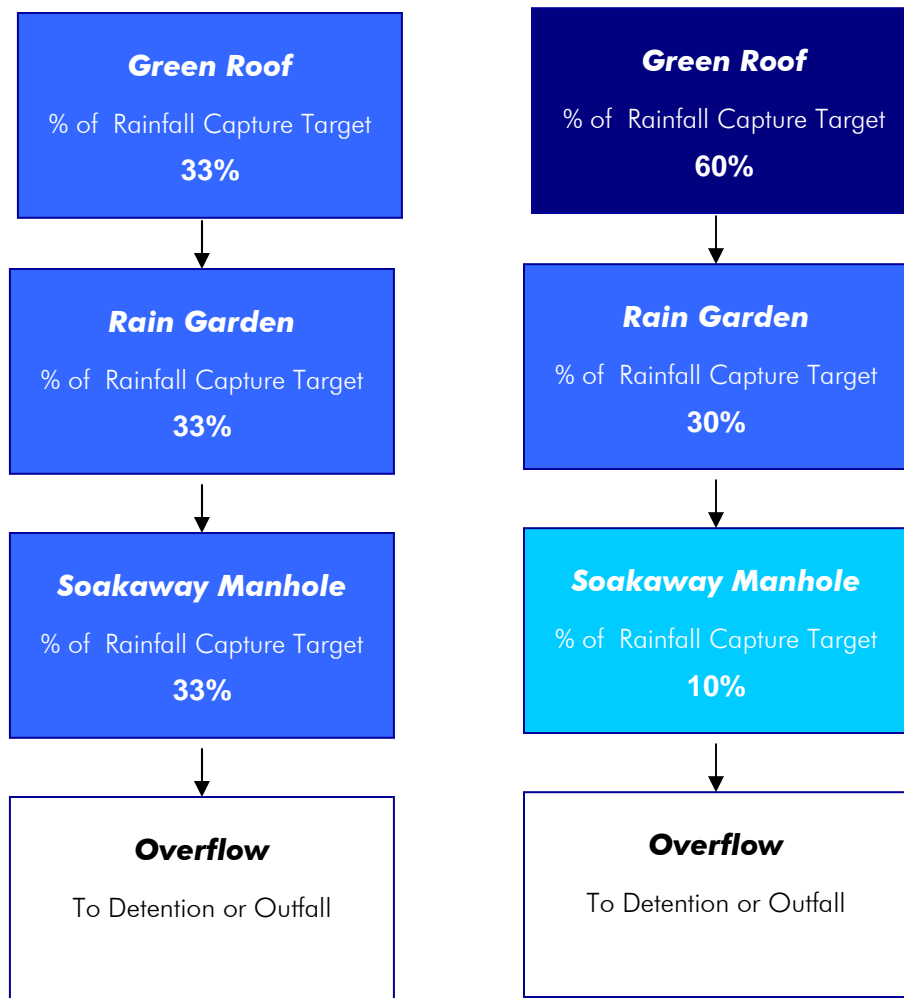


Figure F2: Alternative Stormwater Treatment Chain for High Density Development

Parallel sequences of treatment chains are also possible.

The diagrams in Figure F2 show one alternative for parallel stormwater source controls that is typical of Low to Medium Density development.

Two treatment chains are shown in parallel:

- On the left, an area of impervious paving such as road or travelled lane drains to pervious paving in parking areas or walkways. This pervious paving overflows to infiltration swales, which have an overflow to the major storm flow path.
- On the right, building rooftop without green roof drains to storage devices such as cisterns or shallow surface storage area such as pools over the rain gardens. Drainage from this storage flows at a low but continuous rate into rain gardens or other infiltration system. This slow release rate of rainwater takes the most advantage of limited infiltration rates in soils, by distributing infiltration in time. The Rain Gardens have an overflow to the major storm flow path.

On-parcel stormwater source controls must be designed with an awareness of the role of neighbourhood detention ponds, and regional flow paths for major storm events.

On-parcel or on-street stormwater source controls should always be designed with an overflow to the major flow path.

Rainwater re-use is a technique that can also be explored to act as a part of a stormwater source control chain. Many projects have used rainwater to flush toilets, for laundry purposes, or for landscape irrigation. Un-polluted roof drainage is ideal for these purposes.

Designers are encouraged to describe the path of rainwater hitting the site through stormwater source controls to outfall early in the development concept stage. Communication of this concept to all members of the design team, and to approval authorities, will allow creative synergy and integration of the source controls into overall design.

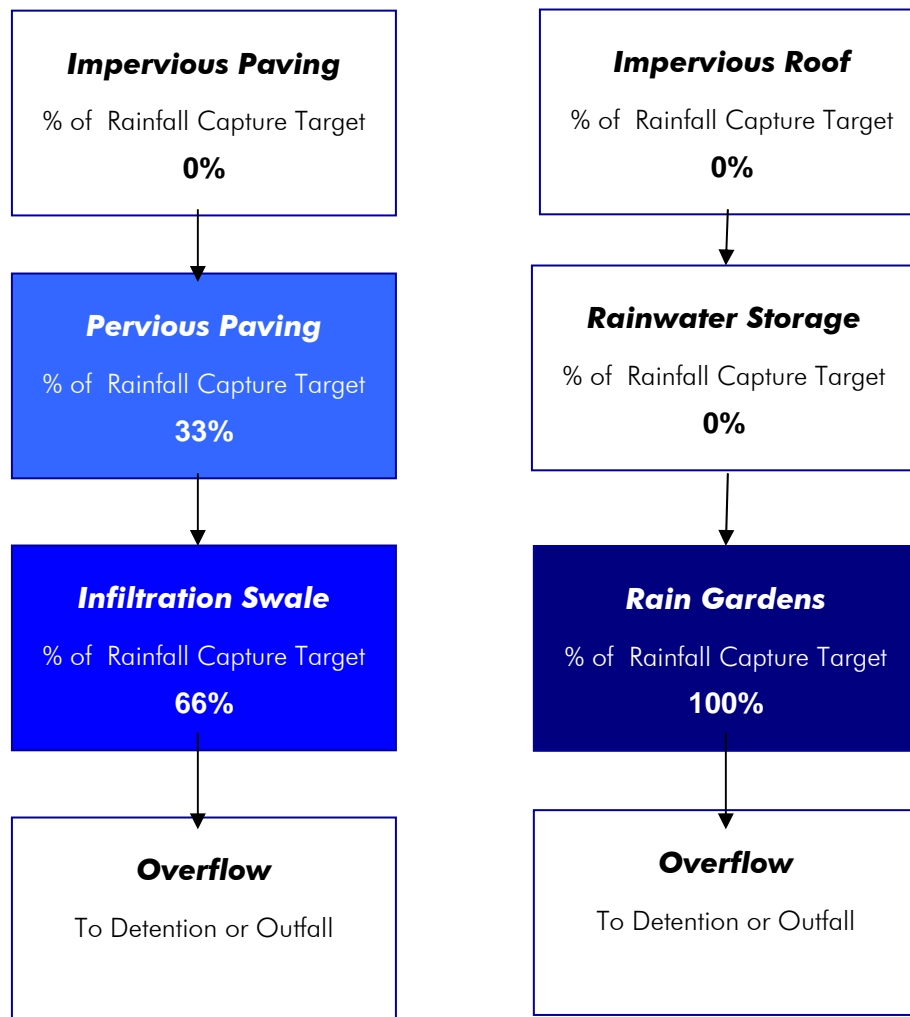


Figure F3: Alternative Stormwater Treatment Chain for Low Density Development

Conceptual Sizing and Space Allocation for Stormwater Source Controls

Prior to a conceptual Stormwater Source Control Treatment Chain being finalized, it is important to identify, at the concept level, the approximate size and location for stormwater source controls.

The amount of space required for stormwater source controls is a direct function of:

- The volume and intensity of rainfall hitting the site, and the associated rainfall capture target.
- The amount of impervious area on the site.
- The area of infiltration surface on the site.
- The rate of infiltration into the infiltration surface.
- The amount of rainfall storage that can be provided to temporarily hold water until it can infiltrate into the ground.

To prepare a gross initial approximation of the space needed for stormwater source control, try the following steps:

1. Disturbed pervious areas should be replaced with adequate soil layers to capture the rainfall target. The target is calculated by taking 72% of the 2-year, 24-hour rainfall depth from the nearest climate station IDF curve. Determine the required soil layer depth for absorbent landscapes by assuming a reasonable void space in the soil layer. E.g. Surrey Kwantlen Park climate station 2-year, 24-hour rainfall depth = 54.5 mm. 72% of 54.5 = 39 mm. Soil layer required with 0.2 void space = 200 mm.
2. Calculate the impervious area of the site. Minimize this number by providing absorbent landscape, pervious paving, or by hydraulic disconnects – where small impervious surfaces drain into large absorbent landscapes (size soil layer to accommodate impervious runoff), thereby not creating runoff.
3. Using the rainfall capture target, calculate the volume of rainfall that must be infiltrated or reused on the site, in cubic metres (impervious area x rainfall capture target). (e.g. Surrey Kwantlen Park rainfall target is 39 mm x impervious area = capture volume.)
4. Determine surface area, soil layer depth, and rock reservoir depth (if needed) required for selected source controls to achieve the capture volume target. Account for infiltration using the on-site tested infiltration rate

multiplied by 24 hours, volume storage in the source control soil layer and rock reservoir (if used) void spaces.

5. Investigate feasibility of selected source controls with the site plan.

Table F5 summarizes rainfall capture targets (72% of the 2-year, 24-hour event based on DFO guidelines) for a few local municipalities.

Table F5: Typical Rainfall Capture Targets

Rainfall Capture Targets	
Climate Station	Rainfall Capture Target
North Vancouver Lynn Creek (upper elevations)	86 mm
North Vancouver Municipal Hall (lower elevations)	58 mm
West Vancouver CS (upper elevations)	81 mm
West Vancouver Municipal Hall (lower elevations)	56 mm
Maple Ridge Reservoir	65 mm
Langley Lochiel	46 mm
Surrey Kwantlen Park	39 mm
White Rock STP	37 mm
Vancouver Airport	36 mm

The above process provides only a rudimentary approximation of source control sizing. However, the process is useful to generate concepts that are suitable for detailed investigation. For accurate sizing of stormwater source controls, it is necessary to complete a continuous flow model – these models calculate the water levels in a source control facility using site development data and continuous rainfall data from historic weather records.

Optimizing the Space Needs and Sizing of Stormwater Source Controls

The fine-tuning of space needs and sizing of stormwater source controls is an iterative process. Designers use computer-based modelling to test how a tentative solution will work given historic rain data. Several scenarios can be tested, and the best scenario selected for detailing.

Several computer modelling tools are candidates for sizing source controls in Coastal British Columbia. The Water Balance Model for BC is introduced below, and newer versions of SWMM that can model disconnected surfaces can be considered.

Water Balance Model for BC

The Water Balance Model for BC (WBM) has been developed jointly by an Inter Governmental Partnership that includes federal, provincial and local government representatives, as well as consultants and industry partners.

The model can be accessed on a free trial basis at www.waterbalance.ca. Users can register and use the model. But scenarios are purged from the server database after 7 days. For those wishing to use the model on an ongoing basis an annual subscription account is available.

The WBM is designed for larger scale land use simulations, allowing users to model the impacts of land use planning decisions and stormwater source controls at a watershed or basin scale. The WBM can also be applied at a site scale for source control facility sizing.

The WBM is not calibrated, and its results are not guaranteed to be accurate. In its disclaimer statement the WBM stresses that it is intended to be used as a planning-level decision support tool, and that the interpretation and application of scenario modeling results are the sole responsibility of individual users of the Water Balance Model for BC.

Input fields in the Water Balance Model include:

- Rainfall Data - several regional databases of hourly rainfall data are pre-installed. Custom data may be added.
- Soil Characteristics - users need to input hydraulic properties of soils including its: saturated hydraulic conductivity, maximum water content, field capacity, wilting point, and soil water half life – these can be obtained from literature values.
- Land Use and Impervious Area Calculations - users input percentages or areas that characterize their site or development.

- Proposed Stormwater Source Controls - users may select from Absorbent Landscape, Infiltration Swale, Rain Garden, Infiltration Trench, Pervious Paving and Green Roof, and input the size and general characteristics of these practices.

Output from the Water Balance Model includes:

- Proportion of Annual Rainfall that is infiltrated, evaporated, or becomes surface runoff or drainflow from subdrains.
- Hydrograph showing the annual runoff pattern.
- Water level fluctuations within stormwater source controls.

Limitations of the Water Balance Model include:

- It is not yet calibrated with field test data.
- Surface flow is not modelled within the WBM. That is, infiltration swales and rain gardens are assumed to be flat, so that surface ponding will remain up to the allowable depth that is input by the user, until such time as the surface pond can infiltrate. This could result in standing surface water for an unacceptably long period in winter months in parts of the GVRD. Users should review the water level output, and consider use of Source Controls with Reservoir (and perhaps Subdrain) if surface water ponding durations are too high.
- Groundwater flow is also not modelled in the WBM. Site conditions where groundwater flow or interflow enter the stormwater source control from upstream are not considered. Designers should be aware that such groundwater flow may reduce the available infiltration capacity of a proposed stormwater source control.

SWMM

The SWMM model (RUNOFF and HYDRAULICS Blocks) was originally developed in 1971 by the US Environmental Protection Agency (EPA). Since that time the model has been updated numerous times and now incorporates modelling of disconnected surfaces required for Source Control modelling. Several versions of SWMM are available on the market from different software suppliers, as well as directly from the EPA as a public domain version.

The SWMM software is capable of carrying out hydrologic and hydraulic simulation and features:

- industry-standard SWMM analysis engine that is well-proven.
- capability for both event (design and/or real storms) and continuous (multi-event, multi-year) modeling.
- block modules that allow for expansion to fully dynamic backwater analysis (HYDRAULICS block) and water quality modeling (TRANSPORT block).

Because the SWMM model includes a groundwater routine, it provides a complete water balance calculation allowing source control facilities to be sized. The physically-based model parameters provide greater confidence in extending model results beyond those contained in flow monitoring data set (i.e. to lower or higher return periods).

The inputs required for the model include:

- rainfall data
- evaporation rate data
- soil parameters
- catchment characteristics such as area, impervious percentage, overland flow length, and slope

Most source controls can be modeled using the groundwater and soil parameters. Because SWMM includes a hydraulic model, additional parameters can be entered to size and test conveyance systems and/or detention facilities. Additional parameters include pipe sizes or open channel cross sections, conduit inverts, roughness values, storage versus elevation relationships, weir, orifice, and pump data, and variable downstream water level boundaries (recorded stage or tidal).

Outputs from the SWMM model include:

- catchment runoff flow rates
- shallow groundwater or interflow flow rates
- evaporation volumes
- water levels in conduits or detention ponds
- soil moisture and groundwater table elevation
- statistical summaries on water balance for model run duration

The SWMM model can be used for site, subdivision and watershed level analysis. Using previously-established general parameters will give reasonable results with further improvements possible by calibrating a limited set of variables to site specific observations.

Strategies to Deal with Limited Infiltration Rates

There are a wide variety of soil conditions in the GVRD, and infiltration rates will vary considerably. Depending on soil conditions, various designs of full or partial infiltration source controls are appropriate. Table F6 provides general guidance on the match between source control type and infiltration rate. Use these as guidelines, not rules.

Table F6: Tentative Match: Source Control Type to Soil Infiltration Rate

Soil Infiltration Rate tested at the site of proposed infiltration.	Full Infiltration	Full Infiltration with Reservoir	Partial Infiltration with Reservoir and Subdrain	Partial Infiltration with Flow Restrictor
>30 mm/hr.	X	?	?	
15-30 mm/hr.	?	X	?	
1-15 mm/hr.		?	X	
<1 mm/hr.			X	X

When infiltration rates are high - greater than 30mm/hr., such as in sand soils – full infiltration designs should be pursued. Full infiltration provides the highest water quality treatment of all options, and is the least expensive source control to construct.

In soils which have moderate infiltration rates – 15-30mm/hr., such as in sandy loam soils – the addition of a drain rock reservoir under a soil layer provides underground storage. This system removes water from the surface, and ponds it in the reservoir until it can be infiltrated by the subsoils.

In soils with low infiltration rates – 1-15 mm/hr., such as silt loams - the addition of a subdrain at the top of the drain rock reservoir removes water to the downstream storm drainage system when the reservoir fills up. This design provides opportunities for infiltration, while minimizing surface ponding. This type of design is also advantageous for planting of trees and other non-aquatic plants in the soils above the subdrain, as the subdrain keeps roots from being saturated for excessive periods.

In soils with very low infiltration rates – less than 1 mm/hr., such as compact till –infiltration still occurs. An infiltration rate of 1mm/hour is 24mm/day, which would absorb a significant portion of annual rainfall. However, when rainfall is relatively continuous in winter months, the reservoir in these designs may remain full between rain events, with rainfall-runoff moving directly to drainflow through the subdrain. To provide additional storage, and a controlled release rate, a flow control structure can be added to the subdrain. The small orifice on the flow control structure provides a gradual decanting of the storage above the drain pipe. In this sense, the technique operates like a miniature detention pond. However, the path of the rainfall-runoff through the soil medium provides excellent filtration and water quality improvement.

Strategies to Deal with Limited Space

Land is a significant cost in the GVRD. A key advantage of integrating Stormwater Source Controls into the overall design of a project is to avoid requirements for additional land.

Strategies to minimize the requirement for extra land for stormwater source control are listed in the Source Control Strategies for Limited Space Checklist.

Source Control Strategies for Limited Space Checklist

- ❑ **Use required landscape areas as stormwater source control** – make concave landscape areas at the site periphery and in parking lot islands and courtyards, rather than berms.
- ❑ **Consider that even formal, rectilinear urban planters can be designed as rain gardens.**
- ❑ **Design roadside boulevards and medians as infiltration areas.**
- ❑ **Infiltrate into tree wells and structural soils.** The use of structural soils for tree planting in paved areas is a well established technique. Drainage of small paved areas into these structural soils should be considered where the infiltration rate of the subsoils will allow the removal of the water within 24 hours, or where adequate under drainage is provided.
- ❑ **Increase the depth and organic matter content of landscape soils.** Soil stores up to 20% of its volume in water. Greater soil depth allows the storage of additional surface runoff. Sufficient organic matter maintains soil percolation rates.
- ❑ **Create hydraulic disconnects** – that is, drain small paved areas into absorbent landscape rather than to the storm drain system. A good example is draining sidewalks to boulevard rather than directly to curb and gutter. Another example is allowing small roof areas to drain from roof leaders to the surface of absorbent landscape. If these hydraulic disconnects are properly designed, the 'disconnected' impervious surface is effectively pervious, and can be eliminated from calculation of impervious area.
- ❑ **Install pervious paving.** Pervious paving of several types is highly suitable for pedestrian areas, overflow parking, and main parking areas.
- ❑ **Place infiltration trench or soakaway manhole under paved areas.** For example, the drain rock reservoir under infiltration swales can extend under driveways, thus increasing the infiltration area.

- ❑ **Allow surface storage.** Temporary ponding on the surface of infiltration swales or rain gardens is approximately 3x more efficient than underground storage in a drain rock reservoir.
- ❑ **Provide underground storage.** Temporary storage of rainfall, and slow release into infiltrating soils, can greatly increase the effectiveness of limited infiltration capacity or area. Underground storage can be by concrete cistern, welded plastic pipes, or by several proprietary brands of underground infiltration structure (e.g. Infiltrator Chamber, Rainstore, Atlantis Cells, etc.).
- ❑ **Install green roof,** either intensive or extensive, to provide rainfall capture above buildings and parkades.
- ❑ **Consider rainwater re-use,** for flushing toilets, irrigation and/or laundry uses. This technique is common in Australia and Europe.

Detail Design of Stormwater Source Controls

Plan Details

Plan details (one or more views) for Stormwater Source Controls should show the features listed in the Plan Detail Checklist, as appropriate to the design.

Plan Detail Checklist

- ☐ Extent of impervious surface.
- ☐ Outline of Stormwater Source Control.
- ☐ Edge treatment at the Stormwater Source Control e.g. drop curb, flush curb, bollards, border, etc.
- ☐ Piping and drainage diagrams, sizes and slopes.
- ☐ Utility crossings and seepage cutoff details.
- ☐ Spot elevations, slope arrows and/or contours to show grading design, including pipe inverts, catch basin elevations, breaks in grade.
- ☐ Proposed weir locations, other features.
- ☐ Extent of proposed growing medium installation.
- ☐ Extent of proposed drain rock reservoir installation.
- ☐ Erosion control and runoff dispersion features at steep slopes and inlet points.
- ☐ Planting plan showing trees, shrubs, ground covers, and use of grasses as applicable.
- ☐ Watering or irrigation plan showing provisions for establishment watering.

Figure F4: Example of Engineering Plan (Silver Ridge – KWL Associates Ltd.)

Roadside Infiltration Swale


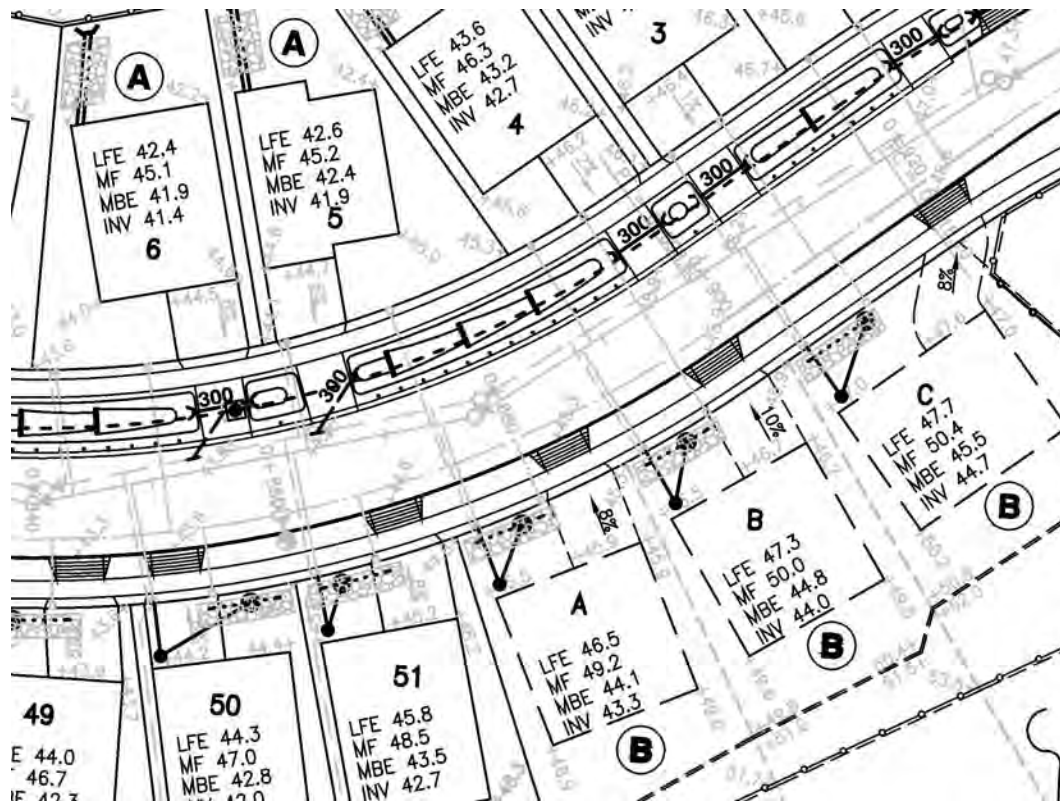


Figure F5: Example of Landscape Plan (Silver Ridge – Lanarc Consultants Ltd.)



Cross Section Details

Cross Section details (one or more views) for Stormwater Source Controls should show the features listed in the Cross Section Checklist, as appropriate to the design.

Cross Section Checklist

- ☐ Surface grades.
- ☐ Paving and base course layers, if included in design.
- ☐ Extent of proposed growing medium installation, layering of growing medium types.
- ☐ Extent of proposed drain rock reservoir installation.
- ☐ Piping and drainage locations in relation to growing medium and reservoir.
- ☐ Erosion control and runoff dispersion features at steep slopes and inlet points.
- ☐ Edge treatment at the Stormwater Source Control e.g. drop curb, flush curb, bollards, border, etc.
- ☐ Front view of proposed weirs.
- ☐ Typical cross section of planting and mulching treatment.
- ☐ Specialty materials for Green Roof, such as lightweight soils, root barrier, drainage layer.

Figure F6: Example of Engineering Cross Section Detail (Silver Ridge – KWL Associates Limited)

Roadside Infiltration Swale with Reservoir and Subdrain





Figure F7: Example of Landscape Cross Section Detail (Silver Ridge – Lanarc Consultants Ltd.)



Profile Details

Profile details (one or more views) for Stormwater Source Controls should show the features listed in the Profile Checklist, as appropriate to the design.

Profile Checklist

- ❑ Surface grades.
- ❑ Extent of proposed growing medium installation.
- ❑ Extent of proposed drain rock reservoir or drainage layer installation (top, and level bottom).
- ❑ Undisturbed native or check dam details between discrete reservoir or infiltration trench cells.
- ❑ Piping locations in relation to soil and reservoir, pipe gradients.
- ❑ Side view of proposed weirs.

Figure F8: Example of Engineering Profile (Silver Ridge – KWL Associates Limited)

Roadside Infiltration Swale with Reservoir and Subdrain





Figure F9: Example of Landscape Profile (Silver Ridge – Lanarc Consultants Ltd.)



Construction and Establishment Maintenance Specifications

Specifications for Construction should include either references to accepted standards or customized clauses on the topics listed in the Specifications Checklist.

Specifications Checklist

- ❑ Construction staging guidelines, and request for Contractor's Construction Plan to avoid disturbance, compaction or sedimentation of infiltration areas.
- ❑ Growing medium materials, amendments mixing, installation and maintenance for the establishment period.
- ❑ Reservoir and drainage materials, installation and maintenance during construction.
- ❑ Geotextile materials, installation and maintenance during construction.
- ❑ Erosion control materials, installation and maintenance during construction.
- ❑ Plants and planting materials, installation and establishment maintenance.
- ❑ Seeding and sodding materials, installation and establishment maintenance.
- ❑ Watering or Irrigation materials, installation and establishment maintenance.
- ❑ Specialty materials for Green Roof, such as lightweight soils, root barrier, drainage layer.

Long-Term Maintenance Arrangements

Like any other development, Stormwater Source Controls rely on appropriate maintenance for their longevity and performance. Where Stormwater Source Controls are situated on private land, local governments may place maintenance agreements or covenants in place to ensure appropriate long term maintenance. Key ingredients of these include the items in the Maintenance Checklist.

Maintenance Checklist

- ❑ Maintain surface drainage paths to lawn basins;
- ❑ Keep lawn basin grates clear of debris to ensure proper drainage;
- ❑ Clean lawn basin sumps on an annual basis (preferably in November) to remove organic debris collected in the sump;
- ❑ Conduct an annual inspection of the lawn basin, building footing drain sump and overflow outlet piping for proper function; clean interconnecting piping if required;
- ❑ Regularly cut, aerate and fertilize the lawn.

Regular maintenance is required to ensure proper drainage function and a healthy landscape.

Construction Staging of Stormwater Source Controls

Natural soils generally have infiltration capabilities. Most infiltration problems are created during construction - commonly associated with disturbance, compaction and sedimentation of proposed infiltration areas. Operations of grading and building construction are highly disruptive, with much competition for space on a construction site, leading to most of the site being compacted. Rainfall during the construction period can also readily erode exposed soils, and transport fine sediment to proposed infiltration areas, creating a surface crust that impedes infiltration.

Successful strategies that have been used to avoid disturbance, compaction and sedimentation of infiltration areas are listed in the Construction Staging Checklist.

Construction Staging Checklist

- ❑ Provide temporary fencing during construction if proposed infiltration areas are in areas of natural vegetation, and require that vegetation remain in place.
- ❑ Ensure effective erosion control practices are in place during the construction period. If fine sediments are deposited on infiltration areas by accident, remove the surface crust prior to opening the infiltration facility.
- ❑ If possible, have stormwater outfalls bypass the proposed infiltration area during construction.
- ❑ Do not place erosion control sediment traps in infiltration areas. Only if absolutely necessary, build erosion control sediment traps above infiltration areas, protecting the infiltration soils with temporary cover of plastic, sand, or other mechanism that will capture all surface sediments without compacting the infiltration area, and that can be removed prior to opening the infiltration facility.
- ❑ When infiltration facilities involve the excavation of native material, consider staging infiltration area excavation until after all adjacent construction is complete. Building trades will disturb and compact the native surface soils, but when they are removed for the final infiltration facility construction, the compaction will also be removed.
- ❑ For infiltration facilities that involve excavation, ensure that the bottom and sides of infiltration excavations are scarified to remove glazing and improve infiltration.
- ❑ When infiltration facilities involve installation of growing medium, ensure that layers of growing medium are tilled so that a transition of soil texture occurs. Do not compact between layers. Layers of different soil texture or compaction can create perched water tables.
- ❑ Unvegetated infiltration areas that are subjected to heavy rainfall will set up a surface crust – even in sand. Although only a new millimetres thick, the surface crust will impede infiltration. Any infiltration area, or growing medium, that is left open to heavy rainfall, must be scarified prior to adding additional layers or opening for infiltration use.
- ❑ Cultivate in organic matter to the surface of growing medium infiltration areas. The organic matter and associated soil life will increase soil infiltration.
- ❑ Avoid the intrusion of road sands and construction traffic sediment into infiltration facilities, and pervious paving in particular. Provide regular street sweeping of roads as a part of the erosion control system. After construction , pervious paving should also be maintained by dry sweeping at least twice annually.

Field Review & Monitoring of Stormwater Source Controls

Required Field Reviews

Critical field reviews during construction include those in the Field Review Checklist.

Field Review Checklist

- ☐ Protection of proposed infiltration areas from disturbance, compaction and sedimentation.
- ☐ Scarification of subgrade.
- ☐ Filter cloth and rock reservoir installation, including rejection of contaminated drain rock and inspection of filter cloth overlap.
- ☐ Pipe, drainage utilities, structures and bedding.
- ☐ Laboratory testing of growing medium components, for texture, fertility and amendment requirements.
- ☐ Growing medium installation and depth. Scarification of growing medium surfaces after heavy rainfall and prior to installation of subsequent layers.
- ☐ Plant material review at the nursery or assembly point prior to planting.
- ☐ Irrigation piping and bedding, hydrostatic testing, operational performance.
- ☐ Plant material and surface mulch installation.
- ☐ Substantial and Final Performance.
- ☐ Periodic Establishment Maintenance Review.
- ☐ Review at end of Maintenance Period and Warranty Period.
- ☐ Provide record drawings.

Post-Construction Environmental Monitoring Strategies

The objective of post-construction monitoring is to measure the performance of the source controls. The results are interpreted to determine if the stormwater capture targets were met, and provide real data of performance and effectiveness to municipalities, practitioners, and developers for the adaptive management process. The results can be used both locally and regionally to refine source control designs and/or recommend additional environmental protection measures if needed.

Post-construction monitoring can consist of rainfall, groundwater levels, and flow downstream of the constructed source control. Flow can be compared with the identified stormwater target.

In large, multi-phase developments, post construction monitoring can provide data for adaptive management for later phases. In some cases, requirements for stormwater source controls may be reduced because monitoring indicates targets are being exceeded.

This page is intentionally left blank.

Key Contacts

Last revised 11 April 2005

Country	Jurisdiction/ Organization	Name	Key expertise	Address	Telephone	Email
Australia	South Australia, University of	Prof. John Argue	infiltration			John.Argue@unisa.edu.au
Belgium	Flanders	Dr. Guido Vaes	research on source control from the hydrological and hydraulics perspective, guidelines on urban drainage for the Flemish government	HydroScan NV Tiensevest 25/4 B-3000 Leuven www.hydroscan.be tel: +32 (0)16 24 05 05 fax: +32 (0)16 24 05 09 guido.vaes@hydroscan.be	32 (16) 32 16 58	guido.vaes@bwk.kuleuven.ac.be
Belgium		Jeroen Mentens	water balance model for extensive green roofs	Laboratory for Forest, Nature and Landscape Research/Lab. Soil and Water; K.U.Leuven Vital Decosterstraat 102 3000 Leuven	32 (16) 329753	jeroen.mentens@agr.kuleuven.ac.be
Canada	National Research Council	Dr. Karen Liu	green roofs, especially thermal aspects	Institute for Research in Construction 1200 Montreal Road, Bldg M20 Ottawa, ON K1A 0R6	(613) 993-4584	karen.liu@nrc.ca
Canada	Public Works Canada	Cheryl Nelms	stormwater runoff monitoring at the Vancouver Public Library roof and perhaps others	Public Works & Government Services Canada 800 Burrard Street, Room 641 Vancouver, BC, Canada V6Z 2V8	(604) 775-6690	cheryl.nelms@pwgsc.gc.ca
Canada	University of British Columbia	Patrick Condon	stormwater design, sustainable design	Professor, Landscape Architecture	(604) 822-9291	Email: patrick.condon@ubc.ca
Canada	B.C. Institute of Technology	Maureen Connelly	intensive green roofs	Architectural/Building Engineering Technology BC Institute of Technology 3700 Willingdon Avenue Burnaby, British Columbia Canada, V5G 3H2	604-451-7029	Maureen_Connelly@bcit.ca
France		Sylvie Barraud	engineering research on source control	Institut National des Sciences Appliquées de Lyon 69621 VILLEURBANNE CEDEX	33 (4) 72 43 83 88	barraud@urqc-hu.insa-lyon.fr

Key Contacts

Last revised 11 April 2005

Country	Jurisdiction/ Organization	Name	Key expertise	Address	Telephone	Email
France	Bordeaux	Jean-Claude Lallieue	water and drainage department of the Bordeaux regional district	Direction Opérationnelle de l'Eau et de l'Assainissement Communauté urbaine de Bordeaux Esplanade Charles de Gaulle 33076 Bordeaux cedex	33 (5) 56 99 85 92	icjalieue@cu-bordeaux.fr
France		Georges Raimbault	chairman for the "Working Group on Source Control for Stormwater Management" of the IWA, porous paving	Laboratoire Central des Ponts et Chaussées route de Bouaye BP 4129 44341 Bouguenais Cedex	33 (2) 40 84 58 63	Georges.Raimbault@lcpcc.fr
France	Lyon	Elisabeth Sibeud	responsible for project studies	Direction de l'Eau Communauté Urbaine de Lyon 20, rue du lac 69 399 Lyon Cedex 03	33 (4) 78 95 89 53	esibeud@grandlyon.org
Germany	North Rhine Westphalia	Christof Mainz	responsible for a statewide subsidy encouraging ecological stormwater management	Ministerium für Umwelt und Naturschutz, Landwirtschaft und Verbraucherschutz, des Landes Nordrhein-Westfalen, 40190 Düsseldorf	49 (211) 4566-304	christof.mainz@munlv.nrw.de
Germany	North Rhine Westphalia	Abwasserberatung NRW e.V.	Wastewater advisory association	Kaiserswerther Straße 199/201 40474 Düsseldorf	49 211-43077-0	info@abwasserberatungnrw.de
Germany		Dr. Ing. Dieter Grotehusmann	consulting engineer in urban hydrology, key auth of ATV A138 Guidelines, RWS software for A138	ifs (Ingenieurgesellschaft für Stadthydrologie mbH) Stiftstrasse 12 30159 Hannover	49 511 70 13 9 0	info@ifs-hannover.de
Germany	Hanover	Dr. Ing. Horst Menze	engineer for the city drainage department, contact for the Kronsberg project, director for Wasser Hannover	Stadtentwässerung Hannover Sachgebiet Planung und Entwurf Sorststr. 16 / 30165 Hannover Wasser Hannover e. V. Vahrenwalder Str. 7 30165 Hannover	49 (511) 168-47312 49 (511) 9357-540	Horst.Menze@Hannover-Stadt.de info@wasser-hannover.de
Germany		Dr. Manfred Köhler	green roof research, landscape architecture	University of Applied Sciences Landscape Architecture Brodaerstr. 2 17033 Neubrandenburg	49 (395) 5693210203	manfred.koehler@fh-nb.de

Key Contacts

Last revised 11 April 2005

Country	Jurisdiction/ Organization	Name	Key expertise	Address	Telephone	Email
Germany		Hans-Gerd Kleymann	consulting landscape architect using source control	planerzirkel Ankerstrasse 15 06108 Halle	49 (345) 299 868 0	kleymann@planerzirkel.de
Germany		Heiko Sieker	consulting engineer, DayWater partner, TRINTSIM (swale-trench system) software	Ingenieurgesellschaft Prof. Dr. Sieker mbH Berliner Str. 71 D-15366 Dahlwitz-Hoppegarten	49 (3342) 3595-0	info@sieker.de
Germany	Aachen (city of)	Karl-Heinz Stolz	environmental expertise	Untere Wasserbehörde 52058 Aachen	49 (241) 432-3631	Karl.Heinz.Stolz@mail.aachen.de
Germany	Hanover	Kathrin Brandt	city drainage department	Stadtentwässerung Hannover Sachgebiet Planung und Entwurf Sorststr. 16 / 30165 Hannover	49 (511) 168 47313	Kathrin.Brandt@Hannover-Stadt.de
Germany	Berlin	Kay Joswig	engineer at the Berlin water concern	Berlin Wasserbetrieb AöR Fachbereich Generelle Planung Neue Jüdenstraße 1 10179 Berlin	49 (30) 86 44 57 90	kay.joswig@bwv.de
Germany	Emscher and Lippe Watersheds	Ulrike Raasch	ecologist, sustainable stormwater management	Emschergenossenschaft/Lippeverb and Königswall 29 44139 Dortmund	49 (231) 9151-118	ulrike.raasch@eglv.de
Germany	Westphalia Technical University	Walter Kleiker	stormwater management at the Westphalia Technical University	FH Aachen Fachbereich Bauingenieurwesen Wasser- und Abfallwirtschaft Bayernallee 9 52066 Aachen	49 (241) 6009-1184	kleiker@fh-aachen.de
Germany	Aachen (city of)	Wolfgang Schmidt	transportation and civil engineering	Grundstücksentwässerung 52058 Aachen	49 (241) 432-6642	SCHMIA66@mail.aachen.de
Netherlands	Utrecht	Theo Kuijpers	water concept contact for Leidsche Rijn project	Wijkbureau Leidsche Rijn Verlengde Vleutense weg 32a 3541 BG Utrecht	31 (30) 286 7209	t.kuijpers@utrecht.nl
Netherlands		Cees Kwakernaak	water expert for Alterra			cees.kwakernaak@wur.nl

Key Contacts

Last revised 11 April 2005

Country	Jurisdiction/ Organization	Name	Key expertise	Address	Telephone	Email
Netherlands		Govert Geldof	former chair of Working Group on Source Control in Stormwater Management of IWA, Daywater partner	TAUW, Netherlands Handelsskade 11 PO Box 133 7400 AC Deventer	00 31 57 06 99 331	gdg@tauw.nl
Netherlands		Jos Cuijpers	consultant specialising in water in the city and historic water systems	Adviesbureau Cuijpers Veemarktkade 8 5222 AE 's-Hertogenbosch	31 (73) 621 42 65	info@adviesbureauluijpers.nl
Netherlands		Roel During	planning expert for Alterra - a research institute for the environment			roel.during@wur.nl
UK	Middlesex University, United Kingdom	Dr. Lian Scholes	research fellow studying constructed wetlands, DayWater partner	Middlesex University, United Kingdom Urban Pollution Research Centre Bounds Green Road N11 2NQ London	00 44 20 83 62 53 08	l.scholes@mdx.ac.uk
US	Eugene, City of	Paul Klope	construction and specifications for street edge alternatives, porous pavement	City of Eugene, 244 E. Broadway St., Eugene, OR 97401	??	paul.w.klope@cl.eugene.or.us
US	Oregon, University of, Center for Housing Innovation Neighborhoods Lab	Ron Kellett and Cynthia Girling	green neighborhoods, stormwater master planning and design, best management practices, urban forestry	5250 University of Oregon Eugene, Oregon	503-346-3647	kellett@darkwing.uoregon.edu
US	Oregon, Urban Watershed Institute	April Hildner	Urban Watershed Issues, PNW	Urban Watershed Institute, 19600 S. Molalla Ave., Oregon City, OR 97045	??	aprilhildner@home.com
US	Portland Metropolitan area	Kelley Webb	green streets project, trees for green streets, wildlife crossings, stormwater best management practices, street design	Metro Portland, 600 NE Grand Avenue, Portland, OR 97232	503-797-1894	webbk@metro.dst.or.us

Key Contacts

Last revised 11 April 2005

Country	Jurisdiction/ Organization	Name	Key expertise	Address	Telephone	Email
US	Portland, City of	Steve Fancher	Development Engineering / Stormwater Manual	City of Portland, Bureau of Environmental Services, 1120 SW 5th Ave., Room 1100, Portland, OR 97204	(503) 823-7126	stevef@bes.ci.portland.or.us
US	Portland, City of	Tom Liptan	green roof	City of Portland, Bureau of Environmental Services 1120 SW 5th Avenue Room 1100 Portland, Oregon 97204-1972		toml@bes.ci.portland.or.us
US	Seattle, City of	John Arnesen	SEA project manager	Seattle Public Utilities, 710 Second Street., Suite 660, Seattle, WA 98104-9712	??	john.arneson@ci.seattle.wa.us
US	Seattle, City of	Tracy Chollak	SEA drainage design engineer	Seattle Public Utilities, 710 Second Street., Suite 660, Seattle, WA 98104-9712	??	tracy.chollak@ci.seattle.wa.us
US	Washington State University	Curtis Hinman	Economic and Hydrologic Analysis of Low Impact Development	Extension Faculty, Puget Sound Water Quality Field Agent, WSU, 3049 S 36th St., Suite 300, Tacoma, WA 98409	??	chinman@wsu.edu
US	Washington, Univ. of and Western Wash. Univ.	Chris May	relationships between development and habitat impacts	16700 Seminole Rd., Poulsbo, WA 98370	??	may@apl.washington.edu

This page is intentionally left blank.

Key References

Last revised 11 April 2005

Key Author	Date	Title - *Copy or **Excerpts included in applicable binder or Miscellaneous Resources	Description/Keywords	Available from	Country
Alexander, R.	2002	* National Specifications for Highway Use of Compost. BioCycle April 2002: 74-77	absorptive landscapes		USA
American Hydrotech Inc.	2000	* Monolithic Membrane 6125@ Long Form Specification. 11 p.	green roof	http://www.hydrotechusa.com/	USA
Anon.	2000	* Case Study: Reebok Corporate Headquarters, Massachusetts alternative stormwater management systems. Jame Taylor Chair in Landscape and Liveable Environments UBC Technical Bull. 3. 4 p.	underground infiltration structures	www.sustainable-communities.agsci.ubc.ca	Canada
Argue, John R.	2002b.	* WSUD and Stormwater Management in Urban Catchments: basic concepts and examples. University of South Australia. 23 p.		Miscellaneous resources collection	Australia AU006
Argue, John R.	2002a.	* A New Stormwater 'Source Control' Handbook For Australian Practice: An Outline. Presented 9th Internat. Conf. Urban Storm Drainage, Portland, Oregon Sept. 2002. 10 p.		Miscellaneous resources collection	Australia AU005
Atlantis Corp.	2000	* The Atlantis Drainage Cell Logs. 4 p.	underground infiltration structures	www.atlanticorp.com.au/products/	USA
Auckland Regional Council (ARC).	2003	** Stormwater management devices: Design guidelines manual. 2nd edition.	underground infiltration structures, swales, green roofs	http://www.arc.govt.nz/arc/environment/water	New Zealand NZ001
Australia Dept. of Environment and Heritage.	2002	Introduction to Urban Stormwater Management in Australia. Commonwealth of Australia. 103 p.		http://www.deh.gov.au/coasts/publications/sformwater/	Australia AU001
B.C. Society of Landscape Architects and B.C. Landscape and Nursery Association.	2001	* BC Landscape Standard 6th Edition. Vancouver. 132 p.	absorptive landscapes		Canada CA001

Key References

Last revised 11 April 2005

Key Author	Date	Title - *Copy or **Excerpts included in applicable binder or Miscellaneous Resources	Description/Keywords	Available from	Country
Barry, K., P. Pavelic, P. Dillon, K. Ratray, K. Dennis and N. Gergis.	2002	Aquifer Storage and Recovery of Stormwater Andrews Farm, South Australia: Compilation of Data from the 1993-98 Trial. CSIRO Land and Water, Technical Report 17/02. 21 p.	Deep well infiltration		Australia
Bayerischen (Bavarian) Staatsministerium des Innern.	1998	* Naturnaher Umgang mit Regenwasser. Arbeitsblätter für die Bauleitplanung Nr. 15. 65 p.		Miscellaneous resources collection	Germany
Bettess, R.	1996	* Infiltration Drainage: Manual of Good Practice, CIRIA (Construction Industry Research & Information Association) Report 156. London. 108 p.	permeable paving, swales, bioretention, infiltration devices	Copy - Miscellaneous resources collection; http://www.ciria.org/suds/	UK UK003
Bordeaux Metropole.	1998	* Les Solutions Compensatoires d'Assainissement Pluviale – Guide de Realisation. 91 p. + appendices	permeable paving, swales, bioretention, underground facilities	Miscellaneous resources collection	France FR001
Borgwardt, S.	1994	* Expert Opinion (Uni Eco-Stone). University of Hannover. 10 p.	Permeable paving		Germany
Brattebo, B.O. and D.B. Booth.	2004	* Long-Term Stormwater Quantity and Quality Performance of Permeable paving Systems. Centre for Water and Watershed Studies Department of Civil and Environmental Engineering, University of Washington. 15 p.	permeable paving; 6-year review of permeable parking lot research project.	http://depts.washington.edu/cwews/Research/Reports/permeableparking.pdf	USA
Breitschneider, B.	1994	* Summary Expert Opinion on Uni Eco-Stone. 5 p. + enclosures.	Permeable paving		Germany
Building Research Establishment	1991	Soakaway Design, BRE Digest 365.	Soakaways	http://www.brebookshop.com/details.jsp?id=844	UK UK002
Cahill, T.H., M. Adams and C. Marm.	2003	* Porous Asphalt - the Right Choice for Porous Pavements. Hot Mix Asphalt Tech. Sept/Oct 2003: 26-40	Permeable paving		USA
California Stormwater Quality Assoc.	2003	* Pervious pavements SD-20. From California Stormwater BMP Handbook - New Development and Redevelopment. 10 p.	Permeable paving	www.cabmphandbooks.com	USA

Key References

Last revised 11 April 2005

Key Author	Date	Title - *Copy or **Excerpts included in applicable binder or Miscellaneous Resources	Description/Keywords	Available from	Country
Canadian Mortgage and Housing Corp. (CMHC).	2003	** Alternative Stormwater Management Practices for Residential Projects - website	Green roof, infiltration trench, absorbent landscapes	http://www.cmhc-schl.gc.ca/en/imquaf/himu/wacon/wacon_03_1_index.cfm	Canada CA004
Cao, S., D. Poduska and D. Zollinger.	1998	* Drainage Design and Performance Guidelines for UNI Eco-Stone Permeable paving. UNI-GROUP U.S.A. 22 p. +appendices.	Permeable paving		USA
Caraco, D. and R. Claytor.	1997	** Stormwater BMP Design Supplement for Cold Climates. Centre for Watershed Protection for US EPA.	swales, bioretention, underground devices	Miscellaneous resources collection; www.cwp.org	USA US018
Casco Bay Estuary Project (Maine)	2003	Proceedings - Stormwater Management in Cold Climates: Planning, Design and Implementation - Nov.3-5, 2003 (website)		http://www.cascobay.usm.maine.edu/proceed.html	USA
Centre d'études sur les réseaux, les transports, l'urbanisme et les constructions publiques (CERTU).	2003	* La ville et son assainissement: principes méthodes et outils pour une meilleure intégration dans le cycle de l'eau. CD.	Principles, methods and tools for disconnecting stormwater from sewers		France FR002
Chapgier, J, E Sibeud and J C Varnier.	?	La mise en œuvre d'une politique d'infiltration des eaux pluviales à l'échelle d'une agglomération : L'est du Grand Lyon. Service études de la direction de l'eau, Communauté urbaine de Lyon.			France
Chollak, T. and P. Rosenfeld.	1999	* Guidelines for Landscaping with Compost-Amended Soils. City of Redmond, Washington.	absorptive landscapes	http://www.ci.redmond.wa.us/insidcityhall/publicworks/environment/pdfs/compostamendedsoils.pdf	USA US004
Chollak, T., R. Earl and A. Yamabe.	2001	* Porous Pavement Phase 1 Evaluation Report. FINAL DRAFT. 10 p.	Permeable paving		USA
Claytor, R.A. and T.R. Schueler	1996	** Design of Stormwater Filtering Systems. Chesapeake Research Consortium, Center for Watershed Protection, Maryland.	swales, bioretention, underground infiltration structures		USA US010
Coombes, P., J. Argue and G. Kuczera. 200	?	* Figtree Place: A Case Study in Water Sensitive Urban Development. 11p.	Deep well infiltration		Australia

Key References

Last revised 11 April 2005

Key Author	Date	Title - *Copy or **Excerpts included in applicable binder or Miscellaneous Resources	Description/Keywords	Available from	Country
Deutsche Vereinigung für Wasserwirtschaft, Abwasser und Abfall.	2002	Planung, Bau und Betrieb von Anlagen zur Versickerung von Niederschlagswasser, Arbeitsblatt ATV-DVWK-A 138.	Structural design of stormwater source controls (industry standard)		Germany
Droscher, T. and T.W. Holz	2003	*In the Absence of Standards, Low Impact Development might equate to High Impact Development. 14 p.		Miscellaneous references collection	USA
Droscher, T. and T.W. Holz.	2003	*In the Absence of Standards Low Impact Development Might Equate to High Impact Development. Unpub.paper, 13 p.			USA
Environment Agency (UK).	2003	Sustainable urban drainage systems - an introduction.	website - sustainability, techniques, policy, planning, guidance, R&D	http://www.environment-agency.gov.uk/business/444304/502508/464710/?version=1&lang=e	UK
Eppe, Jürgen.	2003	Versickerungsfactor Pflanze. Stadt + Grün, 8: 14-18.			Germany
Evangelisti & Assoc., T. Wong and A. Tingay & Assoc.	1998	Manual for Managing Urban Stormwater Quality in Western Australia. For Western Australia Water and Rivers Commission. 137 p.		http://www.wrc.wa.gov.au/public/WSUD_ma_nual/	Australia
Ferguson, B.K.	1994	Stormwater Infiltration. Florida. 269 p.	absorptive landscapes, swales, underground devices		USA
Florida Concrete and Products Assoc.		Portland Cement Pervious Pavement Manual.	pervious concrete	http://www.fcpa.org	USA
Florida Dept. of Environmental Protection.	2003	Wastewater Underground Injection Control Program. Website.	Deep well infiltration	http://www.dep.state.fl.us/water/uic/index.htm	USA
Formpave.	2003	* Formpave - Quality concrete paving products. Brochure 26 p.	Permeable paving		USA
Formpave.	2002	* Stormwater source control systems. Brochure 16 p.	Permeable paving		USA
Forschungsgesellschaft Landschaftsentwicklung Landschaftsbau e.V. (FLL).	2002	* Richtlinie für die Planung, Ausführung und Pflege von Dachbegrünung. Bonn. 95 p.	Guidelines for the Design, Construction and Maintenance of Green Roofs (industry standard).	Green roof collection	Germany
					GE002

Key References

Last revised 11 April 2005

Key Author	Date	Title - *Copy or **Excerpts included in applicable binder or Miscellaneous Resources	Description/Keywords	Available from	Country
Forschungsgesellschaft Landschaftsentwicklung Landschaftsbau e.V. (FLL).	1995	* Guidelines for the Planning, Execution and Upkeep of Green-Roof Sites - Roof-Greening Guidelines 1995 edition. English translation by T.N. Kirkpatrick-Wilson, 1997 of Richtlinie für die Planung, Ausführung und Pflege von Dachbegrünung . Bonn. 95 p.	German industry standards for green roof	Green roof collection	Germany
GE002					
Geiger, W and H. Dreiseltl.	2001	* Neue Wege für das Regenwasser. Handbuch zum Rückhalt und zur Versickerung von Regenwasser in Baugebieten. München. 303 p.	New Ways for Stormwater. Handbook on Retention and Infiltration of Stormwater in Built-up Areas.		Germany
GE008					
Georgia, State of.	2001	**Georgia Stormwater Management Manual		http://www.georgiastormwater.com/	USA
US014					
Gibb A., H. Kelly, R. Horner, T. Schueler, J. Simmler, and J. Knutson	1999	**Best Management Practices Guide For Stormwater. For Greater Vancouver Sewerage and Drainage District.		http://www.gvrd.bc.ca/sewerage/management_guide.htm	Canada
CA003					
Glanville, T., T. Richard and R. Persyn.	2003	* Impacts of Compost Blankets on Erosion Control, Revegetation, and Water Quality at Highway Construction Sites in Iowa. Final Report - Executive Summary. Iowa State University. 8 p.	Absorptive landscapes	http://www.abe.iastate.edu/compost/	USA
France					
Grand Lyon, Direction de l'Eau.	1998	Demand d'autorisation au titre de la loi sur l'Eau.			France
Grothusmann, D. and R.W. Harms.	2002	* Versickerung. Kommentar zum Arbeitsblatt ATV-DVWK-A 138. 93 p.	Design, Construction and Operation of Stormwater Infiltration Systems. German Association for Water, Wastewater and Waste	Miscellaneous resources collection	Germany
GE003					
Hämmerle, Fritz.	2002	Grün wächst. DDH Das Dachdecker-Handwerk Heft 14/02. pp.22-24			Germany
Hoeck, J.	2002	* Presentation Outline for Innovations in Erosion Control: Effective and Beneficial Techniques Using Compost. 5 p.	absorptive landscapes		USA

Key References

Last revised 11 April 2005

Key Author	Date	Title - *Copy or **Excerpts included in applicable binder or Miscellaneous Resources	Description/Keywords	Available from	Country
Horner, R.R., H. Lim and S.J. Burges.	2002	*Hydrologic Monitoring of the Seattle Ultra-urban Stormwater Management Projects. Water Resources Series Technical Report no. 170. 31p.		Miscellaneous references collection	USA US019
Horner, R.R.	2003	*Stormwater runoff flow control benefits of urban drainage system reconstruction according to natural principles. Paper . 10 p.		Miscellaneous references collection	USA US021
Infiltrator Systems Inc.	1994	* The Infiltrator@ Leach Field System Support underground infiltration Documentation. 16 p.	structures	http://www.infiltratorsystems.com	USA
Invisible Structures Inc.	2001	* Rainstore 3. 14 p.	underground infiltration structures		
James, W. and C. Gerrits.	2003	* Maintenance of Infiltration in Modular Interlocking Concrete Pavers with External Drainage Cells. Pp.417-435 in: Practical Modeling of Urban Water Systems, Monograph 11. W.James, Ed. CHI, Guelph, Canada.	Permeable paving		USA
Johaentges, K. and E. Holtz	2000	Leben au/Living on Kronsberg. Die Deutsche Bibliothek. 84 p.	Text/photo description of a sustainable, ecological settlement built on a 1200 ha site planned to house 12-16,000 people.		Germany
Kaiser, M.	2000?	* Die Route des Regenwasser. Emschergenossenschaft, Essen. 89 p.	17 case studies of source controls in Emscher watershed.	Miscellaneous resources collection	Germany CA009
Kiefer, Gabriele.	2000	Niederschlagswasserbewirtschaftung und Landschaftsarchitektur: Vom Regen in die...? In Proc. Infoforum Regenmanagement, Berlin pp. 70-72.			Germany
King County (Washington) Department of Natural Resources.	1998	** Surface Water Design Manual.	swales, bioretention, underground infiltration devices	http://dnr.metrokc.gov/wlir/dss/manual.htm	USA US002

Key References

Last revised 11 April 2005

Key Author	Date	Title - *Copy or **Excerpts included in applicable binder or Miscellaneous Resources	Description/Keywords	Available from	Country
Kipkie, C.W. and W. James.	2000	* Feasibility of a Permeable paving Option in SWMM for Long-term Continuous Modelling. Applied Modeling of Urban Water Systems Vol.8 in the Monograph Series on Modeling Stormwater Impacts. W.James, ed. CHI, Guelph, Canada.	Permeable paving, SWMM		USA
Konrad, C.P.	1995	** On-Site Residential Stormwater Management Alternatives. For Washington State Dept. of Ecology and Center for Urban Water Resources Management, University of Washington.	absorptive landscapes, permeable paving, swales, underground infiltration structures		USA
Kresin, C., W. James and D. Elrick.	1997	* Observations of Infiltration Through Clogged Porous Concrete Block Pavers. Pp. 191-205 in: Advances in Modeling the Management of Stormwater Impacts - Vol.5. W. James, Ed. CHI, Guelph, Canada.	Permeable paving		USA
Krupka, Bernd W.	2001	* Extensive Dachbegrünung: Praxisempfehlungen und Kostenbetrachtungen. For Landesinstitut für Bauwesen des Landes NRW.	Extensive green roofs. Supplementary detail info on water retention.	Miscellaneous resources collection	Germany
Lake Macquarie City Council (Australia)	2003	* Handbook of Drainage Design Criteria.		http://www.lakemac.com.au	Australia
Liplan, T. and R. Murase	2002	Watergardens as Stormwater Infrastructure in Bioretention facilities, rain Portland, Oregon. In: R. France (ed.), 2002, "Handbook of Water Sensitive Planning and Design". Lewis Publishers.	Bioretention facilities, rain gardens.	http://www.cleanrivers-pdx.org/pdf/watergarden_report.pdf	USA
Lower Hunter & Central Coast Regional Environmental Management Strategy.	2001b	* Porous Paving. Fact Sheet 2. 4 p.	Permeable paving		Australia

Key References

Last revised 11 April 2005

Key Author	Date	Title - *Copy or **Excerpts included in applicable binder or Miscellaneous Resources	Description/Keywords	Available from	Country
Lower Hunter & Central Coast Regional Environmental Management Strategy.	2001a	* Infiltration Trenches and Basins. Fact Sheet 3. 4 p.	Underground infiltration structures		Australia
Lyon, Communaute Urbaine de	?	Reconciling water and the city: Alternative techniques for rainwater management. Brochure 4 p.	Alternative stormwater management techniques used at Porte des Alpes technology park.		France
Martin, P., B. Turner, K. Waddington, J. Dell, C. Pratt, N. Campbell, J. Payne and B. Reed.	2000	* Sustainable urban drainage systems - design manual for England and Wales. CIRIA (Construction Industry Research & Information Association) C522. London. 112 p.	Design criteria principles, selection techniques, approval procedures; permeable paving, swales, underground devices	Copy - Miscellaneous resources; http://www.ciria.org/suds/	UK
Maryland Dept. of Environmental Resource Programs and Planning Division	2000	** Low Impact Development Design Strategies: An Integrated Design Approach	swales, bioretention, underground infiltration structures	http://www.msde.state.md.us/Programs/WaterPrograms/SedimentandStormwater/tormwater/stormwater_design/index.asp	USA
Maryland, State of	2000	** Stormwater Design Manual volumes 1 and 2.	Underground infiltration structures	http://www.msde.state.md.us/Programs/WaterPrograms/SedimentandStormwater/tormwater/stormwater_design/index.asp	USA
Master Municipal Construction Documents Association (Canada)	2000	**Instructions to Tenderers Part II: General Conditions, Specifications, Standard Detail Drawings.	permeable paving	Excerpts in binder	Canada
Melbourne Water (Australia).	2003b	** Water Sensitive Urban Design – guidelines, tools, etc. Website.	Infiltration trenches, swales, absorptive landscapes, permeable paving	http://wsud.melbournnewater.com.au	Australia
Melbourne Water (Australia).	2003a	WSUD Technical Manual Scoping Study. 49 p.		http://library.melbournnewater.com.au/content/wsud/WSUD_Technical_Manual.pdf	Australia
Mentens, J., D. Raes and M. Herm.	2003b	* Greenroofs as a part of urban water management. 11 p.	green roof		Belgium

Key References

Last revised 11 April 2005

Key Author	Date	Title - *Copy or **Excerpts included in applicable binder or Miscellaneous Resources	Description/Keywords	Available from	Country
Mentens, J., D. Raes and M. Hermy.	2003a	* Effect of Orientation on the Water Balance of Greenroofs. Greening Rooftops for Sustainable Communities: Chicago 2003. 9 p.	green roof	http://www.greenroofs.ca	Belgium
Miller, C.	2001e	* Roof Benefits. Memorandum, Roofscapes Inc. 4 p.	green roof		USA
Miller, C.	2001d	* Role of Green Roofs in Managing Thermal Energy. Memorandum, Roofscapes Inc. 2 p.	green roof		USA
Miller, C.	2001b	* Use of Vegetated Roof Covers in Runoff Management. Memorandum, Roofscapes Inc. 5 p.	green roof		USA
Miller, C.	2001a	* Compatible Waterproofing Materials. Memorandum, Roofscapes Inc. 2 p.	green roof		USA
Miller, C.	1998	* Vegetated Roof Covers: a New Method for Controlling Runoff in Urbanized Areas. Prc. 1998 Pennsylvania Stormwater Management Symposium, Villanova Univ. 9 p.	green roof		USA
Miller, C. and G. Pyke.	1999	* Methodology for the Design of Vegetated Roof Covers. Proc. 1999 Int. Water Resource Engineering Conf., ASCE, Seattle, WA. 10 p.	green roof		USA
Ministerium für Umwelt und Naturschutz, Landwirtschaft und Verbraucherschutz des Landes Nordrhein-Westfalen (MUNLV-NRW).	2001	* Naturnahe Regenwasserbewirtschaftung. Zukunftsfähige Wasserwirtschaft in Industrie- und Gewerbegebieten. 118 p.	Detailed descriptions of source controls applicable to industrial and commercial sites. Page 104-105 lists projects, specific source control, contact person.		Germany GE004
Ministerium für Umwelt und Naturschutz, Landwirtschaft und Verbraucherschutz des Landes Nordrhein-Westfalen (NRW).	1998	* Naturnahe Regenwasserbewirtschaftung. Zukunftsfähige Wasserwirtschaft im Einklang mit ökologischen und ökonomischen Anforderungen. 74 p.	Detailed descriptions of source controls applicable to residential sites. Lists projects, specific source control, contact person.		Germany GE005

Key References

Last revised 11 April 2005

Key Author	Date	Title - *Copy or **Excerpts included in applicable binder or Miscellaneous Resources	Description/Keywords	Available from	Country
Montgomery, Carla W.	1987	Physical Geology. Wm.C. Brown Publishers. 555 p.		absorbent landscapes	USA
Nationaal Dubocentrum, Utrecht.	1999	Nationaal Pakket Duurzame Stedebouw.	"National Sustainable Design Package"		Netherlands
National SUDS Working Group.	2003	Framework for Sustainable Drainage Systems (SUDS) in England and Wales.		http://www.environment-agency.gov.uk/commanddata/105385/suds_book.pdf	UK UK005
Netherlands Commission on Integrated Water Management.	2003	Water in Focus 2003. Annual report on water management in the Netherlands.			Netherlands
Netherlands/Dutch Ministry of Housing, Spatial Planning and Environment	2000	* Water in the Town - Quality on Location. Brochure 43 p.	Inventory of 75 projects illustrating more sustainable use of water in urban areas; covers surface drainage, groundwater discharge, water recycling, nature conservation, process and management.		Netherlands
Netherlands/Dutch Ministry of Traffic and Water Control.	2003	Handreiking Watertoets: Waarborg voor water	Water Tests Manual		Netherlands
Newcastle, City of, Stormwater Trust and University of Newcastle.	?	* Figtree Place: a case study in Water Sensitive Urban Design. Brochure 4 p.	Deep well infiltration		Australia
Newman, A.P., C.J.Pratt, S.J. Coupe and N. Cresswell.	2002	* Oil Biodegradation in Permeable pavings by microbial communities - ABSTRACT. Published in Water Science & Technology 45(7): 51-56.	Permeable paving	http://www.iwaponline.com/wst/04507/wst04_5070021.htm	UK
Newman, A.P., S.J. Coupe, J.Henderson, J.A.Morgan, T.Puehmeier and C.J.Pratt.	2001	* Oil Retention and Microbial Ecology in Porous Pavement Structures. Coventry University and Horticulture Research International. 12 p.	Permeable paving	http://www.eme.asso.fr/eme/infoenviro/publications/pluvial/pavesporeux99.pdf	UK
Ngan, G.	2004	"Green Roof Policies: Tools for Encouraging Sustainable Design"	green roof	http://www.gnla.ca/	Canada

Key References

Last revised 11 April 2005

Key Author	Date	Title - *Copy or **Excerpts included in applicable binder or Miscellaneous Resources	Description/Keywords	Available from	Country
Ngan, G.	2003	* Green Roof Waterproofing: Expertise from Germany. Report for Public Works and Government Services Canada. 27 p	green roof		Canada
North Carolina State University.	2000	* Hydraulic Design for Permeable paving Worksheet. 4 p.	Permeable paving		USA
Oberlander, C.H., E. Whitelaw and E. Matsuzaki.	2002	* Introductory Manual for Green Roofs - Version 1.1. For Public Works and Government Services Canada. 32 p.	green roof		Canada
Olympia, City of.	1995	Impervious Surface Reduction Study. Olympia Community Planning and Development Department, Olympia, Washington. 81 p		http://depts.washington.edu/cwws/Research/Reports/jpds.pdf	USA
Peck, S.	2002	* Green Roofs for Healthy Cities Opens its Doors. The Green Roof Infrastructure Monitor 4(2): 1-12	green roof	http://www.greenroofs.ca	USA
Peck, S. and M. Kuhn.	2001	* Design Guidelines for Green Roofs. For Ontario Assoc of Architects and CMHC. 22 p.	green roof	http://www.cmhc-schl.gc.ca/en/imquaf/himu/loader.cfm?url=/commonspot/security/getfile.cfm&PageID=32570	Canada
Pentec Environmental.	2000	* BMP - Permeable Interlocking Concrete Pavement. Paper for Mutual Materials. 17 p. +figures.	Permeable paving		USA
Phillips, A.	2003	** City of Tucson Water Harvesting Guidance Manual. For City of Tucson, Dept. of Transportation, Stormwater Section. 35 p.	underground infiltration structures	http://www.ci.tucson.az.us/planning/whm.pdf	USA
Portland Metro (Washington)	2002	** Green Streets: Innovative Solutions for Stormwater and Stream Crossings (also: Trees for Green Streets and Creating Liveable Streets)	absorptive landscapes, permeable paving, swales, underground devices	http://www.metro-region.org/	USA
Portland, City of, Environmental Services.	?	* Protect Our Rivers - Disconnect Your Downspouts. 10 p.	underground infiltration structures	http://www.cleanrivers-pdx.org/	USA

Key References

Last revised 11 April 2005

Key Author	Date	Title - *Copy or **Excerpts included in applicable binder or Miscellaneous Resources	Description/Keywords	Available from	Country
Portland, City of.	2002	** Stormwater Management Manual Revision #2. 300 p.+ appendices.	permeable paving, swales, bioretention, infiltration devices	http://www.cleantivers-pdx.org/tech_resources/2002_swmm.htm	USA UK008
Pratt, C., S. Wilson and P.Cooper.	2001	* Source control using constructed pervious surfaces – hydraulic, structural and water quality performance issues. CIRIA C582. London. 152 p.	permeable paving	http://www.ciria.org/suds/publications.htm	UK UK004
Pratt, C.J.	2001	* Sustainable Urban Drainage – a Review of Published Material on the Performance of Various SUD Devices. Coventry University. For UK Environment Agency. 25 p.	permeable paving, swales, infiltration devices	Miscellaneous references collection; http://www.ciria.org/suds/pdf/suds_review_jan02.pdf	UK UK007
Priesnitz, W.	2003	* How Green is your Roof? Natural Life Magazine #87. 3 p.	Green roof	http://www.life.ca/nl/87/roof.html	US
Puget Sound Action Team	2003	Natural Approaches to Stormwater Management – low impact development in Puget Sound.	absorptive landscapes, permeable paving, bioretention, green roofs	http://www.psat.wa.gov/Publications/LID_studies/LID_approaches.htm	USA US012
Raimbault, G., H. Andrieu, E. Berthier, C. Joannis and M. Legret.	2002	Rainwater infiltration through urban surfaces: from impermeable surfacing to reservoir-structures. Bulletin des laboratoires des Ponts et Chaussées, n° 238, May-June 2002, pp.39-50			France
Rollings, R.S.and M.P. Rollings.	1999	* SF-RIMATM - A Permeable Paving Stone System. SF Concrete Technology Inc. 27 p.	Permeable paving		USA
Roofscapes Inc.	2000	* Green Technology for the Urban Environment. 8 p.	green roof		USA
Schueler, T.	1987	Controlling Urban Runoff: A Practical Manual for Planning and Designing BMPs. For Washington Metropolitan Water Resource Planning Board.	permeable paving, swales, underground devices		USA US008
Scottish Environment Protection Agency.	2004	* Permeable Car Parks eat oil. 2 p.	Permeable paving	http://www.sepa.org.uk/guidance/urban-drainage/oil.htm	UK

Key References

Last revised 11 April 2005

Key Author	Date	Title - *Copy or **Excerpts included in applicable binder or Miscellaneous Resources	Description/Keywords	Available from	Country
Seattle, City of.	2000	** Source Control Technical Requirements Manual. Title 22.800 Stormwater, Grading and Drainage Control Code. 50 p + apps.		http://www.cityofseattle.net/dclu/codes/DrD/R2000-27.pdf	USA
Smith, David	2001	*Permeable Interlocking Concrete Pavements: Selection, Design, Construction, Maintenance. 2nd Ed. International Concrete Pavement Institute (ICPI). 42 p.	permeable paving	http://www.icpi.org	USA US017
Soprema Inc.	2000	* Environap Modified Bitumen Geomembranes. Waterproofing Structures and Environmental Projects. 16 p.	green roof		Canada
Soprema Inc.	1998	* Green Roof Systems/Soprema 02909. 15 p.	green roof		Canada
Stabilizer Solutions Inc.	2003	* Stabilizer Ballyard Products - offering innovations in field materials and maintenance. 6 p.	absorptive landscapes		USA
Stadtentwässerung Hannover.	2001?	* Water Concept Kronsberg: part of the EXPO Case studies and application of Miscellaneous resources collection Project "Ecological Optimization Kronsberg". 34 p.	source controls		Germany GE006
Stephens, K., P. Graham and D. Reid.	2002	** Stormwater Planning: A Guidebook for British Columbia. B.C. Ministry of Water, Land and Air Protection (MWLAP). 200 p (approx.)	absorbent landscapes, water balance, infiltration structures, bioretention, green roof, adaptive management	http://wlapwww.gov.bc.ca/epd/epdpmpp/stormwater/stormwater.html	Canada CA002
Stormwater Managers' Resource Centre	2003	** Stormwater Design Manual Toolbox - website	swales, bioretention, underground devices	http://www.stormwatercenter.net	USA US015
Tosomeen, C.	1999	* Summary of porous concrete sidewalk. City of Olympia. 2 p.	Permeable paving		USA
Tyler, R.	2003?	* Wake up and Smell the Compost! 8 p.	absorptive landscapes		USA
UNI-GROUP U.S.A.	1999-2003	* Case Studies - Brochures. UNI-GROUP.	Permeable paving		USA
UNI-GROUP U.S.A.	2002	* UNI Eco-Stone Guide and Research Summary. UNI-GROUP. 46 p.	Permeable paving		USA

Key References

Last revised 11 April 2005

Key Author	Date	Title - *Copy or **Excerpts included in applicable binder or Miscellaneous Resources	Description/Keywords	Available from	Country
United States Environmental Protection Agency.	1999	* Storm Water Technology Fact Sheet - Porous Pavement. EPA 832-F-99-023. 6 p.	Permeable paving		USA
Urban Water Resources Centre, University of South Australia.	?	Porous Pavement Parking Bays at Kirkcaldy Ave., Charles Sturt	Permeable paving	http://www.unisa.edu.au/uwrc/project.htm	Australia
Urban Water Resources Centre, University of South Australia.	2003	Stormwater management problems and the source control philosophy.	Website	http://www.unisa.edu.au/uwrc/project.htm	Australia
Vaes, G. and J. Berlamont.	2002	* Design rules and impact assessment for source control measures based on continuous long term simulations. Water Science & Technology 45(7): 21-29.		http://www.iwaponline.com/wst/04507/wst045070021.htm	Belgium
Viklander, M., M. Backstrom, m. Forster and D. Thevenot.	2003	* Urban Stormwater Source Control Strategy within DayWater Project (FP 5 RTD): General Feature and Specific Issues in Cold Climate. 1st Int. Conf. Urban Drainage and Highway Runoff in Cold Climate 25-27 March 2003, Sweden. 11 p.	green roof		USA
Vlaamse milieumaatschappij.	2003	Krachtlijnen voor geïntegreerd rioleringsbeleid in Vlaanderen. Code van goede praktijk voor hemelwaterputten en infiltratievoorzieningen.	New Flemish guidelines on source control		Belgium
Ward, A. and S. Trimble.	2003	Environmental Hydrology, 2nd Ed. Lewis Publishers, Florida. 475 p.	absorbent landscapes		USA
Washington State Dept. of Ecology.	2003	Stormwater Management for Eastern Washington DRAFT.		http://www.ecy.wa.gov/programs/wq/stormwater/eastern_manual/index.html	USA
Washington State Dept. of Ecology.	2001	** Stormwater Management for Western Washington –Volume V –Runoff Treatment BMPs. Publication No.99-15.	permeable paving, swales, underground devices	http://www.ecy.wa.gov/biblio/9915.html	USA

Key References

Last revised 11 April 2005

Key Author	Date	Title - *Copy or **Excerpts included in applicable binder or Miscellaneous Resources	Description/Keywords	Available from	Country
Xiao, Q., E. McPherson, S. Ustin, M. Grismer and J. Simpson.	2000	* Winter rainfall interception by two mature open-grown trees in Davis, California. Hydrol. evaporation, interception Process 14: 763-784.	absorbent landscapes,		USA

This page is intentionally left blank.